

This Owner's Manual is provided and hosted by [Appliance Factory Parts](#).



GENERAL AC-4 Owner's Manual

[Shop genuine replacement parts for GENERAL AC-4](#)




[Find Your GENERAL Air Cleaner Parts - Select From 69 Models](#)

----- Manual continues below -----

AC-4

HIGH EFFICIENCY AIR CLEANER

FOR INSTALLATION IN THE RETURN AIR DUCT OF ANY FORCED AIR HEATING AND COOLING SYSTEM

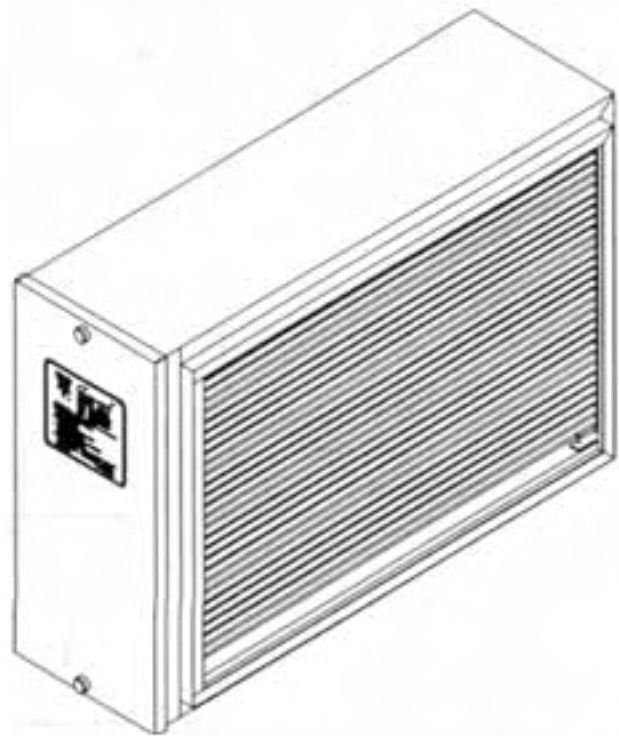

This air cleaner is designed for use in systems up to 1400 CFM. For higher airflows additional units are required.

IMPORTANT: A 26 inch clearance must be allowed for removal of the media frame assembly from the cabinet.

1. Loosen thumb screws and remove front cover.
2. Slide media frame assembly from air cleaner cabinet, discard packing material.
3. Turn off electricity to furnace.
4. Remove and discard existing furnace air filter.
5. Install cabinet in return air system. Properly install airflow direction arrows on interior of cabinet.
6. Refer to media change interactions on side of media frame for installation of air cleaner media.
7. Slide the media frame into the cabinet. Be sure the airflow arrow on the media frame is in the same direction as the airflow in the cabinet. The plastic pleat spacers are always on the downstream side of the filter media. Tighten the thumbscrews.
8. If a condition indicator is to be used, install on a vertical duct surface between the air cleaner and the furnace.
9. Turn on furnace and check performance of all equipment.

INSTALLER: PLEASE FILL OUT AND MAIL GUARANTEE CARD AFTER INSTALLATION IS COMPLETE. ALSO MAIL MAINTENANCE CARD AND INSTALLATION INSTRUCTIONS WITH HOME OWNER.

Typical Installations

