

This Owner's Manual is provided and hosted by [Appliance Factory Parts](#).



# COMFORT-AIRE GLUA75E-3C Owner's Manual

[Shop genuine replacement parts for COMFORT-AIRE  
GLUA75E-3C](#)



[Find Your COMFORT-AIRE HVAC Parts - Select From 1486 Models](#)

----- Manual continues below -----

HEAT CONTROLLER, INC.

# GLUA-C

Parts List  
18-October-2011



*This parts list is current as of the above revision date.*

Form Number: 92-42810-GLUA-C

# Table of Contents

Model Explanation .....	Page 3
Parts Numbers	
Panels - Miscellaneous .....	Page 4
Parts Bag .....	Page 5
Electrical Group .....	Page 6
Blower Group .....	Page 7
Heat Exchanger-Burner Group .....	Page 7
Gas Controls .....	Page 8
Orifice Selection Chart .....	Page 9
Drawings/Photographs	
Exploded View .....	Page 10
Drain Trap Parts .....	Page 11
Blower Assembly .....	Page 11
Burner Assembly .....	Page 12
Notes .....	Page 13

**MODEL NUMBER EXPLANATION**

<b>G</b>	<b>L</b>	<b>U</b>	<b>A</b>	<b>7</b>	<b>5</b>	<b>-</b>	<b>E</b>	<b>3</b>	<b>C</b>
1	2	3		4				5	6

- (1) **GAS**
- (2) **90% EFFICIENCY**
- (3) **UPFLOW/HORIZONTAL CONDENSING**
- (4) **HEATING INPUT DESIGNATION**  
75 = 75,000 BTU/HR      E = Electric
- (5) **DRIVE NOMINAL COOLING/REVISION LEVEL**  
3 = 3 Ton  
4 = 4 Ton
- (6) **REVISION LEVEL**

**SERIAL NUMBER EXPLANATION**

<b>G</b>	<b>Y</b>	<b>5</b>	<b>D</b>	<b>7</b>	<b>0</b>	<b>2</b>	<b>F</b>	<b>3</b>	<b>1</b>	<b>0</b>	<b>7</b>	<b>9</b>	<b>9</b>	<b>9</b>	<b>9</b>
1		2	3	4	5	6	7	8		9		10			

- |   |                                 |    |                          |
|---|---------------------------------|----|--------------------------|
| 1 | <b>GAS CODE</b>                 | 6  | <b>MOTOR HORSEPOWER</b>  |
| 2 | <b>LIMIT CONTROL</b>            | 7  | <b>PLANT</b>             |
| 3 | <b>BLOWER</b>                   | 8  | <b>WEEK</b>              |
| 4 | <b>HEATING ELEMENT</b>          | 9  | <b>YEAR</b>              |
| 5 | <b>SPECIAL AREA REQUIREMENT</b> | 10 | <b>PRODUCTION NUMBER</b> |

No.	Notes	MODEL HEATING INPUT VARIATIONS	GLUA 75E 3C	GLUA 75E 4C
<b>PANELS, SHEET METAL, MISCELLANEOUS</b>				
1		Blower/Filter Door	AS-67890-11	AS-67891-11
2		Burner Compartment Door	AS-61866-09	AS-61867-09
		Sight Glass	68-21893-03	68-21893-03
3		Pressure Switch	See Electrical Group	
4		Silicone Tubing (Pressure Switch)	AE-61737-23	AE-61737-23
5		Trap/Elbow Assembly	68-24048-01	68-24048-01
6		Hose Clamps (6)	64-22043-02	64-22043-02
7		Water Trap Mount Bracket	AE-61841-01	AE-61841-01
8		Tubing	79-25353-82	79-25353-82
9		Induced Draft Blower w/Gasket	See Electrical Group	
10		Gasket - Induced Draft Blower	68-24016-01	68-24016-01
11		Silicone Tubing (Pressure Switch)	AE-61737-02	AE-61737-02
12		Pressure Switch	See Electrical Group	
13		Blower Assembly	See Blower Group	
14		Door Switch - Push Button	See Electrical Group	
15		Junction Box	AE-61475-02	AE-61475-02
16		Junction Box Cover	AE-61476-02	AE-61476-02
		Wiring Harnesses	See Electrical Group	
21		Button Plug (2-1/2 in.)	45-22980-03	45-22980-03
22		Button Plug (2 in.)	45-22980-08	45-22980-08
23		Jacket	AS-61820-04	AS-61820-06
24		Baffle	AE-61875-02	AE-61876-02
25		Rear Baffle	AE-61878-01	AE-61878-02
26		Baffle	AE-61875-01	AE-61876-01
27/28		Male Adapter/Locknut Assembly	68-24114-01	68-24114-01
29		O-Ring Gasket	68-24032-01	68-24032-01
30		Outlet Air Pipe	68-24021-01	68-24021-01
31		Outlet Air Pipe Gasket	68-24022-02	68-24022-02
32		Top Plate	AS-61872-01	AS-61872-02
33		Vinyl Grommet - 2 in.	56-22114-06	56-22114-06
34		Heat Exchanger Assembly	See Heat Exchanger Group	
35		Limit - Main Limit (Heat Exchanger Panel)	See Electrical Group	
37		Connector/Transition	68-24047-07	68-24047-08
38		Elbow	68-24013-01	68-24013-01
39		Tubing	79-25353-82	79-25353-82
44		Capacitor - Blower Motor	See Blower Group	
45		Capacitor - Induced Draft Blower	See Electrical Group	
46		Control Mounting Plate	AE-67877-01	AE-67877-01
47		Integrated Furnace Control Board (IFC)	See Gas Controls	
48		Transformer	See Electrical Group	
57		Gas Valve	See Gas Controls	
59		Ignitor Bracket	See Gas Controls	
60		Ignitor	See Gas Controls	

No.	Notes	MODEL HEATING INPUT VARIATIONS	GLUA ALL ALL
<b>PARTS BAG</b>			
		Complete Parts Bag:	AS-100717-01
27/28		Male Adapter/Locknut Assembly	68-24114-01
29		O-Ring Gasket	68-24032-01
		1/2 in. PVC Pipe - 4 in.	68-22024-04
		1/2 in. Tee	68-21980-02
		Hose Clamp	64-22043-01
		Hose Clamp (2)	64-22043-02
		Plug - Nylon 7/8 in. (2)	45-22926-01
		Plug - Nylon 1-1/8 in.	45-22926-02
		PVC Vane	68-23473-01
		PVC Wind Vane	68-24049-01
		Grommet - Blower Shelf (5/8 in. ID) - Not included in Parts Bag	56-22521-03
		Grommet - Blower Shelf (1/2 in. ID) - Not included in Parts Bag	56-24008-01

No.	Notes	MODEL HEATING INPUT BLOWER DESIGNATION	GLUA 75E 3C	GLUA 75E 4C
<b>ELECTRICAL GROUP</b>				
3	Stk	High Pressure Switch	42-101956-09	42-101956-10
12	Stk	Low Pressure Switch	42-24195-03	42-24195-03
9	Stk	Induced Draft Blower w/Gasket	70-102691-01	70-102691-01
14		Door Switch - Push Button	42-22692-02	42-22692-02
17		Wiring Harness - 6 pin to (2 pin/2 flag terminals), 4 wires	45-24371-27	45-24371-27
18		Wiring Harness - 4 pin to 3 terminals (2 eyelets/1 insulated) and 1 strip back, 4 wires	45-24371-12	45-24371-12
19		Twist Lock Wiring Harness	See Gas Controls	
20		Wiring Harness - 9 pin to (9 pin/4 pin), 8 wires	45-24371-01	45-24371-01
35	Stk	Limit - Main Limit (Heat Exchanger Panel)	47-25350-09	47-25350-01
45	Stk	Capacitor - Induced Draft Blower	43-20847-43	43-20847-43
47		Integrated Furnace Control Board (IFC)	See Gas Controls	
48	Stk	Transformer	46-24124-03	46-24124-03
		Transformer Fuse (Long - 1-1/4 in.)	46-22863-84	46-22863-84
49	Stk	Limit - Manual Reset (Burner Compartment)	47-22861-02 (2)	47-22861-02 (2)

No.	Notes	MODEL	GLUA	GLUA
		HEATING INPUT	75E	75E
		BLOWER DESIGNATION	3C	4C
<b>BLOWER GROUP</b>				
13	Stk	Blower Assembly (Includes items 40 - 44)	AS-61697-86	AS-61697-87
40	Stk	Blower Wheel	70-22688-01	70-24119-01
41		Blower Housing	AS-61674-02	AS-61674-02
42	Stk	Blower Motor	51-24144-01	51-24146-01
43		Motor Mounting Leg (4)	AE-61698-02	AE-61698-02
44	Stk	Capacitor - Blower Motor	43-100509-42	43-100509-43

No.	Notes	MODEL	GLUA	GLUA
		HEATING INPUT	75E	75E
		BLOWER DESIGNATION	3C	4C
<b>HEAT EXCHANGER, BURNER / MANIFOLD GROUP</b>				
34	Stk	Heat Exchanger Assembly	AS-61805-24	AS-61805-26
35		Limit - Main Limit (Heat Exchanger Panel)	See Electrical Group	
49		Limit - Manual Reset (Burner Compartment)	See Electrical Group	
50		Bracket - (Limit - Manual Reset)	AE-61913-02 (2)	AE-61913-02 (2)
51		Burner Shield	AE-61807-03	AE-61807-03
52		Burner Diffuser	AE-61882-07	AE-61882-07
53	Stk	Burner Assembly	AS-61984-05	AS-61984-05
54		Burner Support Bracket (2)	AE-61808-01	AE-61808-01
55		Burner Support	AE-61809-13	AE-61809-13
56	Stk	Manifold (w/o Orifices)	81-24395-03	81-24395-03
58		Burner Orifice - Natural Gas	See Orifice Selection Chart	
58		Burner Orifice - LP	See Orifice Selection Chart	
		Number of Orifices	(5)	(5)

No.	Notes	MODEL GAS CODE	GLUA GY	GLUA EJ	GLUA EL
<b>GAS CONTROLS</b>					
47	Stk	Integrated Furnace Control Board (IFC)	62-25338-01	62-24140-04	62-24140-04
57	Stk	Gas Valve - Natural Gas	60-100394-02	60-22866-01	60-23490-01
57	Stk,1	Gas Valve - LP	See Note 1	See Note 1	See Note 1
59		Ignitor Bracket	AE-61885-02	AE-61885-02	AE-61885-02
60	Stk	Ignitor	62-24141-04	62-24141-04	62-24141-04
62	Stk	Flame Sensor	62-23543-01	62-23543-01	62-23543-01
19		Twist Lock Wiring Harness - 6 pin to 4 pin and 9 pin to 8 terminals, 12 wires	N/A	45-24393-01	45-24393-01
19		Twist Lock Wiring Harness - 6 pin to 6 pin and 9 pin to 8 terminals, 12 wires	45-102689-01	N/A	N/A
	Stk	LP Conversion Kit	FP-02	FP-02	FP-02

**90% GAS FURNACE - ORIFICE SELECTION CHART - NATURAL GAS**

**CAUTION:** Selection of the correct Natural Gas Orifice requires the following information for the specific installation:

1) Altitude in of the installation (ft.).

2) Average energy content of the Natural Gas fuel from the local supplier (BTU/cu. ft.).

For detailed information and instructions for Orifice selection, see the Gas Furnace LP Conversion Kit Index 92-21519-59 and the latest edition of the National Fuel Gas Code Handbook, or the National Standard of Canada, Natural Gas and Propane Installation Code, CAN B149.1.

**CAUTION:** This information is provided for replacement purposes only. Conversion for operation at High Altitude must be done using the kit specified on the product specification sheet for the unit.

NOTE: This Orifice sizing chart is based on 15,000 BTU/HR per burner.

NOTE: Factory installed orifices are calculated and sized based on a Natural Gas heating value of 1075 BTU/cu. ft. and an elevation of 0 - 2000 ft.

Energy Value (BTU/cu. ft.)	Elevation (ft.)							
	0 - 1999	2000 - 2999	3000 - 3999	4000 - 4999	5000 - 5999	6000 - 6999	7000 - 7999	8000 - 8999
<b>850</b>	62-22175-47	62-22175-48	62-22175-48	62-22175-49	62-22175-49	62-22175-49	62-22175-50	62-22175-50
<b>900</b>	62-22175-48	62-22175-49	62-22175-49	62-22175-49	62-22175-50	62-22175-50	62-22175-50	62-22175-51
<b>975</b>	62-22175-49	62-22175-50	62-22175-50	62-22175-50	62-22175-51	62-22175-51	62-22175-51	62-22175-52
<b>1075</b>	62-22175-50	62-22175-51	62-22175-51	62-22175-51	62-22175-51	62-22175-52	62-22175-52	62-22175-52
<b>1170</b>	62-22175-51	62-22175-51	62-22175-52	62-22175-52	62-22175-52	62-22175-53	62-22175-53	62-22175-53

**90% GAS FURNACE - ORIFICE SELECTION CHART - LP**

**CAUTION:** Selection of the correct LP Orifice requires the altitude of the specific installation (ft.).


For detailed information and instructions for Orifice selection, see the Gas Furnace LP Conversion Kit Index 92-21519-59 and the latest edition of the National Fuel Gas Code Handbook (NFG), or the National Standard of Canada, Natural Gas and Propane Installation Code, CAN B149.1.

**CAUTION:** This information is provided for replacement purposes only. Conversion to LP or for operation at High Altitude should be done using the kit(s) specified on the product specification sheet for the unit.


NOTE: This Orifice sizing chart is based on 15,000 BTU/HR per burner. Also, the chart is developed using the specified pressure setting of 10 in. water column instead of the 11.0 in water column used by the NFG and CANB149.1.

NOTE: Orifices supplied in the LP Conversion Kit are calculated and sized based on an altitude of 0 - 2000 ft.


Elevation (ft.)	Orifice							
0 to 2000 ft.	62-22175-91							
2001 to 3000	62-22175-91							
3001 to 4000	62-22175-90							
4001 to 5000	62-22175-58							
5001 to 6000	62-22175-59							
6001 to 7000	62-22175-60							
7001 to 8000	62-22175-62							
8001 to 9000	62-22175-63							
9001 to 1000	62-22175-64							

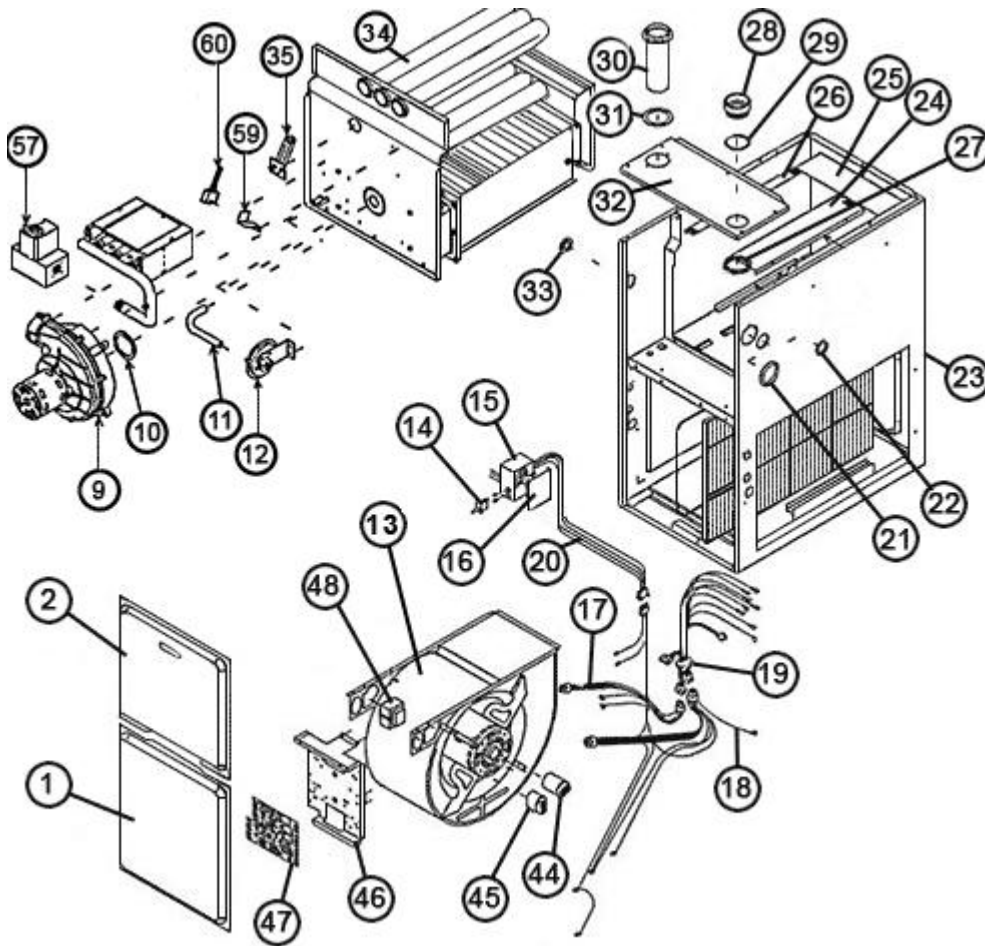


Exploded View

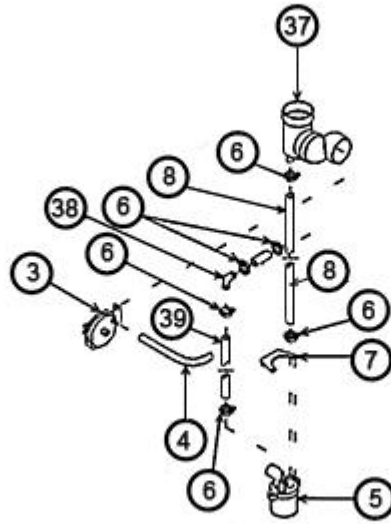

Drain Trap Parts

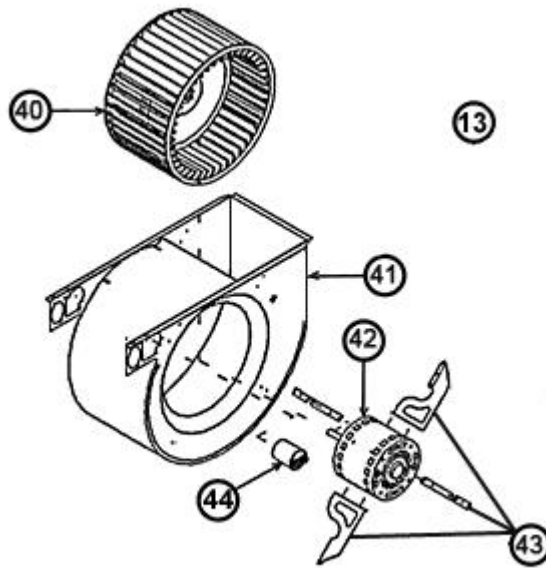

Blower Assembly

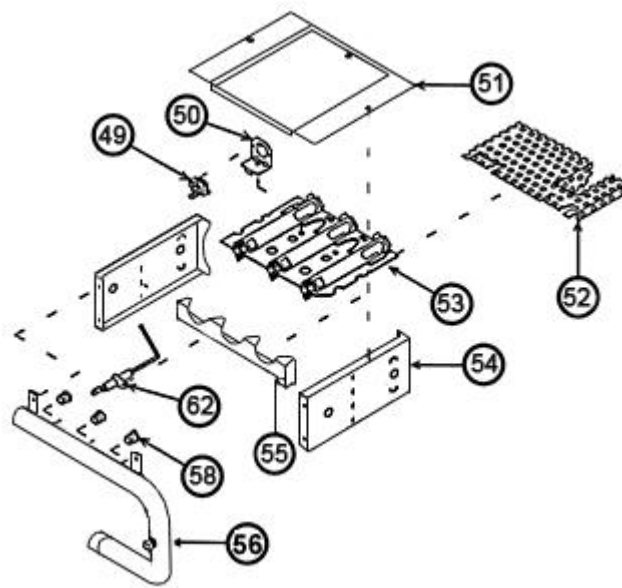

Burner Assembly

# NOTES

Stk It is recommended that stock be maintained for this part.  
N/A Not Applicable  
1 Order Gas Valve for Natural Gas along with LP Conversion Kit.