


This Owner's Manual is provided and hosted by [Appliance Factory Parts](#).



# PANASONIC CU4KE24NBU Owner's Manual

[Shop genuine replacement parts for PANASONIC  
CU4KE24NBU](#)

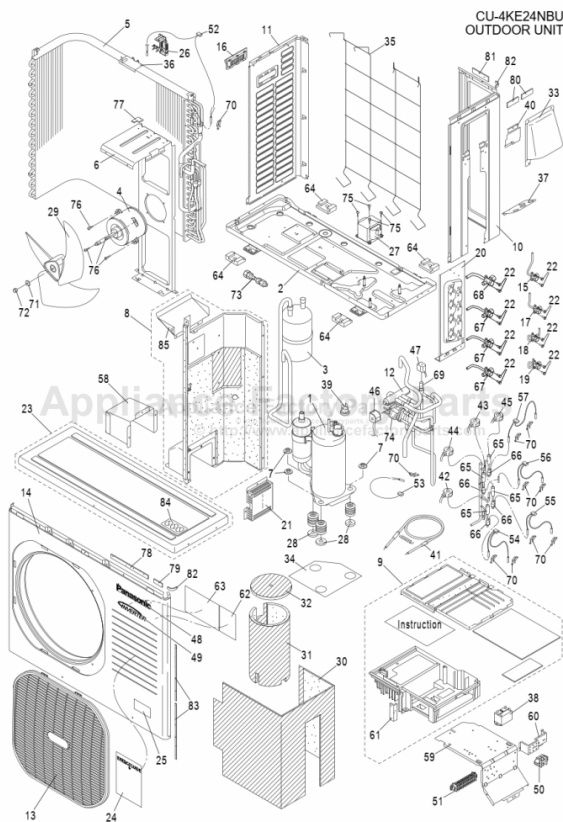

[Find Your PANASONIC Air Conditioner Parts - Select From 415 Models](#)

----- Manual continues below part list -----

**Available Replacement Parts for PANASONIC CU4KE24NBU**

[CV6231921909](#)

Pc Board


## TECHNICAL & SERVICE MANUAL

OUTDOOR UNIT : CU-3KE19NBU  
 CU-4KE24NBU  
 CU-4KE31NBU


## DC INVERTER MULTI-SYSTEM AIR CONDITIONER

Capacity at 230V	Outdoor Model No.	Product Code No.
19,100 BTU/h	CU-3KE19NBU	1 852 361 27
23,200 BTU/h	CU-4KE24NBU	1 852 361 28
30,600 BTU/h	CU-4KE31NBU	1 852 361 29


CU-3KE19NBU

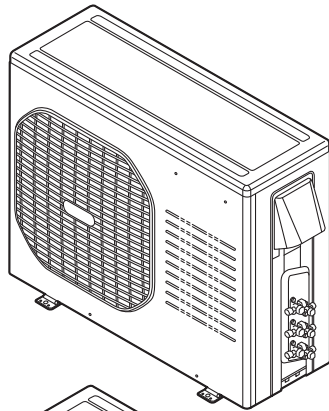

CU-4KE24NBU

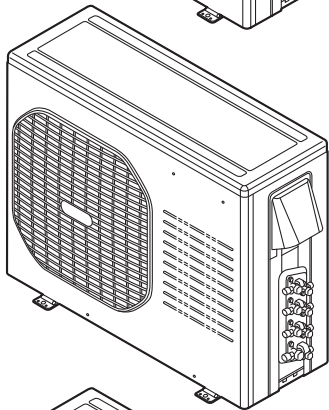

CU-4KE31NBU

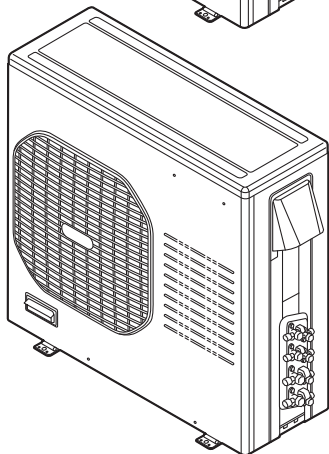

< Applicable Indoor Units >

- Wall mounted type
  - CS-MKE7NКУ
  - CS-MKE9NКУ
  - CS-MKE12NКУ
  - CS-MKE18NКУ
  - CS-MKE24NКУ
- Semi-concealed type
  - CS-MKE9NB4U & CZ-18BT1U
  - CS-MKE12NB4U & CZ-18BT1U
  - CS-KE12NB4UW & CZ-18BT1U

**IMPORTANT**















These air conditioners employ new refrigerant R410A.









Pay special attention when servicing the unit.













**R410A**

# SAFETY PRECAUTIONS

- Before doing repair work, please read the "⚠ SAFETY PRECAUTIONS" carefully and fully understand them.
- The precautionary items here are divided into "⚠ Warning" and "⚠ Caution" items.  
Items in particular which may cause death or serious injury to the service personnel if the work is not performed correctly, are included in the "⚠ Warning" table.  
However, even precautionary items identified as "⚠ Caution" also have the potential for serious consequences if not performed correctly.  
Important safety precautions are described for all items in both categories. Be sure to carefully follow all of them.
- Symbol Indication
  - ⚠ : This symbol indicates items to which we need to pay attention.  
In this triangle, a definite precautionary item is described.
  - : This symbol indicates the item to be prohibited.  
In or close to this circle, a prohibited item is described.
  - : This symbol indicates the items requiring special attention or instruction.  
In or close to this circle, a prohibited item is described.
- After doing repair work, perform a test run to confirm that there are no abnormalities.  
At the same time, explain the precautions in use to the user.

 <b>Warning</b>	
Before performing an overhaul, disconnect the power plug or power cable from the unit. Performing the work with the power supplied to the unit, may cause an electric shock.	
When repair work or circuit inspection that requires power supply for the air conditioner, is to be performed, do not touch the charging section. Doing so may cause an electric shock.	 Prohibit
For the step-up capacitor attached to the electric section, perform the repair work after sufficiently discharging it. Insufficient capacitor discharge may cause an electric shock.	
Do not perform repair work on the electric sections with wet hands. Doing so may cause an electric shock.	 Prohibit
Do not start or stop the air conditioner by means of connecting or disconnecting the power plug. Doing so may cause an electric shock or fire.	 Prohibit
When conducting repair work only use components included in the parts list for the corresponding unit and perform the work with the appropriate tools. Incorrect or poor repair work may cause an electric shock or fire.	
Never modify the unit. Doing so may cause an electric shock or fire.	 Prohibit
Perform all electric work according to local applicable regulations related to electrical equipment or interior wiring regulation and make sure to use the exclusive circuit. Insufficient capacity to the electric circuit or defective arrangement results may cause an electric shock or fire.	
Make sure to replace any power cable or lead wire showing any signs of scratch or deterioration. Failure to do so may cause an electric shock, overheating or fire.	
Make sure that there is no dust on or slack in the power plug and insert fully into the socket. Dust or incomplete connections may cause an electric shock or fire.	
Do not damage or process the power cord, as it may cause an electric shock or fire.	 Prohibit
For the wiring between the indoor unit and outdoor unit, securely fix the specified cable onto the terminal plate. Poorly fixed wiring may cause a heat or fire.	
After connecting the wiring between the indoor unit and outdoor unit, attach the terminal cover securely. Incomplete attachment of the terminal cover may cause overheating or fire.	

 <b>Warning</b>	
If refrigerant gas blows off during the work, do not touch the refrigerant gas as it may cause frostbite.	 Prohibit
If refrigerant gas leaks during the work, ventilate the room. If refrigerant gas catches fire, harmful gas may be generated.	
Do not mix any gas other than the specified refrigerant gas in the refrigerating cycle. If air or other contaminants mix with the gas, pressure will become extremely high in the refrigerating cycle, which may cause a unit breakdown."	 Prohibit
When the welded section of the compressor intake or discharge pipe is to be disconnected, perform it in a well-ventilated place after sufficiently recovering the refrigerant gas. Any residue gas may jet out refrigerant or refrigerating machine oil, which may cause an injury.	
When the work is to be performed in a high place (About 2 meters or more), make sure to wear a safety helmet, gloves and safety belt. Insufficient safety gear may cause a serious injury in case of a fall.	
When the unit is to be relocated, confirm that the new installation location has sufficient strength for the weight of the unit. Insufficient strength of the installation location and incomplete installation work may cause an injury due to the unit falling.	
When the remote controller batteries are replaced, dispose of the old batteries out of the reach of children. If a child swallows a battery, make sure that the child gets immediate medical attention.	

 <b>Caution</b>	
Do not wash the air conditioner with water, as this may cause an electric shock or fire.	 Prohibit
For the repair work in places with high humidity or moisture, make sure to ground the unit. Failure to do so may cause an electric shock.	
Confirm that the component attachment position, wiring condition, soldering condition and connector connection are normal. If not, it may cause overheating or fire.	
Confirm that the temperature around the compressor is not too high, and then perform the repair work. Failure to do so may cause a burn.	
Perform welding work in a place with good ventilation. If the work is performed in a poorly ventilated area, it might cause a lack of oxygen.	
If the installation plate or attachment frame has deteriorated due to corrosion, etc., replace it. Failure to do so may cause an injury due to the unit falling.	
When the cleaning is to be performed, make sure to turn off the power and pull out the plug. Touching the fan that is rotating at high speed may result in an injury.	
When the indoor unit is to be removed, do not place it on an incline. Doing so may cause wet furniture because water left inside may trickle down.	 Prohibit
Do not hold the sharp end of the unit or the aluminum fins, as it may cause an injury to your hand or finger.	 Prohibit
After repairs, make sure to measure the insulation resistance and confirm that the value is 1 Mohm or more. Any insulation error may cause an electric shock.	
After repairs, make sure to check the drainage of the indoor unit. Inappropriate drainage may cause wet furniture and floors due to water leakage.	

# Table of Contents

	Page
<b>⚠ SAFETY PRECAUTIONS</b> .....	2
<b>TABLE OF CONTENTS</b> .....	4
<b>■ APPLICABLE INDOOR UNITS</b> .....	6
<b>1. OPERATING RANGE</b> .....	7
<b>2. SPECIFICATIONS</b>	
2-1. Unit Specifications .....	8
2-2. Major Component Specifications .....	17
2-3. Other Component Specifications .....	20
<b>3. DIMENSIONAL DATA</b> .....	21
<b>4. REFRIGERANT FLOW DIAGRAM</b>	
4-1. Refrigerant Flow Diagram .....	24
<b>5. PERFORMANCE DATA</b>	
5-1. Temperature Charts .....	27
5-2. Cooling Capacity .....	50
5-3. Cooling Capacity (Low Ambient) .....	56
5-4. Heating Capacity .....	62
<b>6. ELECTRICAL DATA</b>	
6-1. Electric Wiring Diagrams .....	68
<b>7. FUNCTIONS</b>	
7-1. Explanation of Functions .....	71
7-2. Protective Functions .....	77
<b>8. TROUBLESHOOTING (BEFORE CALLING FOR SERVICE)</b>	
8-1. Precautions before Performing Inspection or Repair .....	80
8-2. Trouble Diagnosis by Error Monitor Lamps .....	81
8-3. Checking the Outdoor System .....	82
8-4. Trouble Diagnosis of Each Part .....	83
8-5. Trouble Diagnosis of Fan Motor .....	87

**9. REFRIGERANT R410A:****SPECIAL PRECAUTIONS WHEN SERVICING UNIT**

9-1. Characteristics of New Refrigerant R410A .....	88
9-2. Checklist before Servicing .....	89
9-3. Tools Specifically for R410A .....	90
9-4. Tubing Installation Procedures .....	90
9-5. In Case of Compressor Malfunction .....	91
9-6. In Case Refrigerant is Leaking .....	93
9-7. Charging Additional Refrigerant .....	94
9-8. Retro-Fitting Existing Systems .....	94

<b>APPENDIX A</b> <b>INSTALLATION INSTRUCTIONS</b> .....	A-1
--	-----

## ■ APPLICABLE INDOOR UNITS

### ● Wall Mounted Type

Indoor Unit / Multi-Outdoor Unit		CS-MKE7NKU	CS-MKE9NKU	CS-MKE12NKU	CS-MKE18NKU	CS-MKE24NKU
		3-Room	CU-3KE19NBU	YES	YES	YES
4-Room	CU-4KE24NBU	YES	YES	YES	YES	YES
4-Room	CU-4KE31NBU	YES	YES	YES	YES	YES

### ● Semi-Concealed Type

Indoor Unit / Multi-Outdoor Unit		CS-MKE9NB4U & CZ-18BT1U	CS-MKE12NB4U & CZ-18BT1U	CS-KE12NB4UW & CZ-18BT1U
		3-Room	CU-3KE19NBU	YES
4-Room	CU-4KE24NBU	YES	YES	YES
4-Room	CU-4KE31NBU	YES	YES	YES

# 1. OPERATING RANGE

	<b>Temperature</b>	<b>Indoor Air Intake Temp.</b>	<b>Outdoor Air Intake Temp.</b>
Cooling	Maximum	95 °F DB / 71 °F WB	115 °F DB
	Minimum	67 °F DB / 57 °F WB	14 °F DB
Heating	Maximum	80 °F DB / 67 °F WB	75 °F DB / 65 °F WB
	Minimum	– DB / – WB	– DB / 0 °F WB

## 2. SPECIFICATIONS

### 2-1. Unit Specifications

Outdoor Unit **CU-3KE19NBU**  
 Indoor Unit **CS-MKE9NKU × 2**

Duct Less Type Rated

< 230V >

Type		3-Room Multi Outdoor Unit	
Number of Connectable Indoor Units		3	
Number of Operatable Indoor Units		3	
Voltage Rating		230V Single-Phase 60Hz	
Performance	Total Capacity	BTU/h	17,000 ( 6,800 to 18,600 )
		kW	5.00 ( 1.90 to 5.45 )
	Sensible Capacity	BTU/h	14,300
	Latent Capacity	BTU/h	2,700
	Air Circulation (High)	ft <sup>3</sup> /min (m <sup>3</sup> /h)	1,707 (2,900)
Electrical Rating	Available Voltage Range	V	187 to 253
	Running Amperes	A	6.3
	Power Input	W	1,420
	Power Factor	%	98
	EER	BTU/h/W	12.0
	COP	W/W	-
	SEER	BTU/Wh	18.0
	HSPF	BTU/Wh	-
	Compressor Locked Rotor Amperes	A	14.5
	Fuse or Circuit Breaker Capacity	A	15
Features			<b>Outdoor Unit</b>
	Control		Microprocessor
	Fan Speeds		Auto (Hi, Me, Lo)
	Compressor		DC Twin Rotary (Inverter)
	Refrigerant / Amount charged at shipment	lbs (g)	R410A / 6.17 (2,800)
	Refrigerant Control		Electric Expansion Valve
	Operation Sound (High) Cool / Heat	dB-A	50 / 52
	Refrigerant Tubing Connections		Flare Type
	Max. allowable tubing length per unit	ft (m)	82 (25)
	Refrigerant	Narrow tube inch (mm)	1/4 (6.35) × 3
Tube Diameter	Wide tube inch (mm)	3/8 (9.52) × 3	
Dimensions & Weight			<b>Outdoor Unit</b>
	Unit Dimensions	inch	29-1/8 × 35-7/16 × 12-19/32
	Height × Width × Depth	(mm)	(740 × 900 × 320)
	Package Dimensions	inch	34-3/16 × 41-11/32 × 16-21/32
	Height × Width × Depth	(mm)	(868 × 1,050 × 423)
	Weight	Net lbs (kg)	143.3 (65.0)
	Shipping lbs (kg)	152.1 (69.0)	
Shipping Volume	cu.ft (m <sup>3</sup> )	13.41 (0.38)	

DATA SUBJECT TO CHANGE WITHOUT NOTICE.

Remarks:

- The values shown in performance section and electrical rating section above are based on the following unit combination.  
 For other combination unit, please refer to the "Unit Combination Tables" in this manual.  
 Indoor Unit : CS-MKE9NKU 2units Outdoor Unit : CU-3KE19NBU 1unit  
 The combination indoor unit is AHRI 210/240.
- Rating conditions are: Cooling : Indoor air temp. 80 °F DB / 67 °F WB Heating : Indoor air temp. 70 °F DB  
 Outdoor air temp. 95 °F DB / 75 °F WB Outdoor air temp. 47 °F DB / 43 °F WB

Outdoor Unit **CU-3KE19NBU**  
 Indoor Unit **CS-MKE9NKU × 3**

< 230V >

<b>Type</b>		3-Room Multi Outdoor Unit	
<b>Number of Connectable Indoor Units</b>		3	
<b>Number of Operatable Indoor Units</b>		3	
<b>Voltage Rating</b>		230V Single-Phase 60Hz	
<b>Performance</b>	Total Capacity	BTU/h	18,600 ( 9,800 to 18,600 )
		kW	5.45 ( 2.90 to 5.45 )
	Sensible Capacity	BTU/h	15,800
	Latent Capacity	BTU/h	2,800
	Air Circulation (High)	ft <sup>3</sup> /min (m <sup>3</sup> /h)	1,707 (2,900)
<b>Electrical Rating</b>	Available Voltage Range	V	187 to 253
	Running Amperes	A	6.5
	Power Input	W	1,470
	Power Factor	%	98
	EER	BTU/h/W	12.7
	COP	W/W	-
	Compressor Locked Rotor Amperes	A	14.5
	Fuse or Circuit Breaker Capacity	A	15
<b>Features</b>			<b>Outdoor Unit</b>
	Control		Microprocessor
	Fan Speeds		Auto (Hi, Me, Lo)
	Compressor		DC Twin Rotary (Inverter)
	Refrigerant / Amount charged at shipment	lbs (g)	R410A / 6.17 (2,800)
	Refrigerant Control		Electric Expansion Valve
	Operation Sound (High) Cool / Heat	dB-A	50 / 52
	Refrigerant Tubing Connections		Flare Type
	Max. allowable tubing length per unit	ft (m)	82 (25)
	Refrigerant	Narrow tube inch (mm)	1/4 (6.35) × 3
Tube Diameter	Wide tube inch (mm)	3/8 (9.52) × 3	
<b>Dimensions &amp; Weight</b>			<b>Outdoor Unit</b>
	Unit Dimensions	inch	29-1/8 × 35-7/16 × 12-19/32
	Height × Width × Depth	(mm)	(740 × 900 × 320)
	Package Dimensions	inch	34-3/16 × 41-11/32 × 16-21/32
	Height × Width × Depth	(mm)	(868 × 1,050 × 423)
	Weight	Net lbs (kg)	143.3 (65.0)
	Shipping lbs (kg)	152.1 (69.0)	
Shipping Volume	cu.ft (m <sup>3</sup> )	13.41 (0.38)	

DATA SUBJECT TO CHANGE WITHOUT NOTICE.

Remarks:

- The values shown in performance section and electrical rating section above are based on the following unit combination.  
 For other combination unit, please refer to the "Unit Combination Tables" in this manual.  
 Indoor Unit : CS-MKE9NKU 3units Outdoor Unit : CU-3KE19NBU 1unit
- Rating conditions are: Cooling : Indoor air temp. 80 °F DB / 67 °F WB Heating : Indoor air temp. 70 °F DB  
 Outdoor air temp. 95 °F DB / 75 °F WB Outdoor air temp. 47 °F DB / 43 °F WB

Outdoor Unit **CU-3KE19NBU**  
 Indoor Unit **CS-MKE9NKU × 3**

< 208V >

<b>Type</b>		3-Room Multi Outdoor Unit	
<b>Number of Connectable Indoor Units</b>		3	
<b>Number of Operatable Indoor Units</b>		3	
<b>Voltage Rating</b>		208V Single-Phase 60Hz	
<b>Performance</b>	Total Capacity	BTU/h	18,600 ( 9,800 to 18,600 )
		kW	5.45 ( 2.90 to 5.45 )
	Sensible Capacity	BTU/h	15,800
	Latent Capacity	BTU/h	2,800
	Air Circulation (High)	ft <sup>3</sup> /min (m <sup>3</sup> /h)	1,707 (2,900)
<b>Electrical Rating</b>	Available Voltage Range	V	187 to 253
	Running Amperes	A	7.2
	Power Input	W	1,470
	Power Factor	%	98
	EER	BTU/h/W	12.7
	COP	W/W	-
	Compressor Locked Rotor Amperes	A	14.5
	Fuse or Circuit Breaker Capacity	A	15
<b>Features</b>			<b>Outdoor Unit</b>
	Control		Microprocessor
	Fan Speeds		Auto (Hi, Me, Lo)
	Compressor		DC Twin Rotary (Inverter)
	Refrigerant / Amount charged at shipment	lbs (g)	R410A / 6.17 (2,800)
	Refrigerant Control		Electric Expansion Valve
	Operation Sound (High) Cool / Heat	dB-A	50 / 52
	Refrigerant Tubing Connections		Flare Type
	Max. allowable tubing length per unit	ft (m)	82 (25)
	Refrigerant	Narrow tube inch (mm)	1/4 (6.35) × 3
Tube Diameter	Wide tube inch (mm)	3/8 (9.52) × 3	
<b>Dimensions &amp; Weight</b>			<b>Outdoor Unit</b>
	Unit Dimensions	inch	29-1/8 × 35-7/16 × 12-19/32
	Height × Width × Depth	(mm)	(740 × 900 × 320)
	Package Dimensions	inch	34-3/16 × 41-11/32 × 16-21/32
	Height × Width × Depth	(mm)	(868 × 1,050 × 423)
	Weight	Net lbs (kg)	143.3 (65.0)
	Shipping lbs (kg)	152.1 (69.0)	
Shipping Volume	cu.ft (m <sup>3</sup> )	13.41 (0.38)	

DATA SUBJECT TO CHANGE WITHOUT NOTICE.

Remarks:

- The values shown in performance section and electrical rating section above are based on the following unit combination.  
 For other combination unit, please refer to the "Unit Combination Tables" in this manual.  
 Indoor Unit : CS-MKE9NKU 3units Outdoor Unit : CU-3KE19NBU 1unit
- Rating conditions are: Cooling : Indoor air temp. 80 °F DB / 67 °F WB Heating : Indoor air temp. 70 °F DB  
 Outdoor air temp. 95 °F DB / 75 °F WB Outdoor air temp. 47 °F DB / 43 °F WB

Outdoor Unit **CU-4KE24NBU**

Indoor Unit **CS-MKE7NKU × 2 + CS-MKE9NKU**

Duct Less Type Rated

< 230V >

<b>Type</b>		4-Room Multi Outdoor Unit	
<b>Number of Connectable Indoor Units</b>		4	
<b>Number of Operatable Indoor Units</b>		4	
<b>Voltage Rating</b>		230V Single-Phase 60Hz	
<b>Performance</b>	Total Capacity	BTU/h	22,400 ( 8,500 to 23,200 )
		kW	6.60 ( 2.50 to 6.80 )
	Sensible Capacity	BTU/h	18,800
	Latent Capacity	BTU/h	3,600
Air Circulation (High)	ft <sup>3</sup> /min (m <sup>3</sup> /h)	1,707 (2,900)	1,707 (2,900)
<b>Electrical Rating</b>	Available Voltage Range	V	187 to 253
	Running Amperes	A	8.7
	Power Input	W	1,950
	Power Factor	%	98
	EER	BTU/h/W	11.5
	COP	W/W	-
	SEER	BTU/Wh	18.0
	HSPF	BTU/Wh	-
	Compressor Locked Rotor Amperes	A	14.5
	Fuse or Circuit Breaker Capacity	A	20
<b>Features</b>			<b>Outdoor Unit</b>
	Control	Microprocessor	
	Fan Speeds	Auto (Hi, Me, Lo)	
	Compressor	DC Twin Rotary (Inverter)	
	Refrigerant / Amount charged at shipment	lbs (g)	R410A / 6.17 (2,800)
	Refrigerant Control	Electric Expansion Valve	
	Operation Sound (High) Cool / Heat	dB-A	50 / 52
	Refrigerant Tubing Connections	Flare Type	
	Max. allowable tubing length per unit	ft (m)	82 (25)
	Refrigerant	Narrow tube	inch (mm)
Tube Diameter	Wide tube	inch (mm)	3/8 (9.52) × 3 + 1/2 (12.7) × 1
<b>Dimensions &amp; Weight</b>			<b>Outdoor Unit</b>
	Unit Dimensions	inch	29-1/8 × 35-7/16 × 12-19/32
	Height × Width × Depth	(mm)	(740 × 900 × 320)
	Package Dimensions	inch	34-3/16 × 41-11/32 × 16-21/32
	Height × Width × Depth	(mm)	(868 × 1,050 × 423)
	Weight	Net	lbs (kg)
	Shipping	lbs (kg)	152.1 (69.0)
Shipping Volume		cu.ft (m <sup>3</sup> )	13.41 (0.38)

DATA SUBJECT TO CHANGE WITHOUT NOTICE.

Remarks:

- The values shown in performance section and electrical rating section above are based on the following unit combination.  
For other combination unit, please refer to the "Unit Combination Tables" in this manual.  
Indoor Unit : CS-MKE7NKU 2units / CS-MKE9NKU 1units      Outdoor Unit : CU-4KE24NBU 1unit  
The combination indoor unit is AHRI 210/240.
- Rating conditions are: Cooling : Indoor air temp. 80 °F DB / 67 °F WB      Heating : Indoor air temp. 70 °F DB  
Outdoor air temp. 95 °F DB / 75 °F WB      Outdoor air temp. 47 °F DB / 43 °F WB

Outdoor Unit **CU-4KE24NBU**  
 Indoor Unit **CS-MKE9NKU × 3**

< 230V >

<b>Type</b>		4-Room Multi Outdoor Unit		
<b>Number of Connectable Indoor Units</b>		4		
<b>Number of Operatable Indoor Units</b>		4		
<b>Voltage Rating</b>		230V Single-Phase 60Hz		
<b>Performance</b>	Total Capacity	BTU/h	23,200 ( 9,800 to 23,200 )	
		kW	6.80 ( 2.90 to 6.80 )	
	Sensible Capacity	BTU/h	19,600	
	Latent Capacity	BTU/h	3,600	
Air Circulation (High)	ft <sup>3</sup> /min (m <sup>3</sup> /h)	1,707 (2,900)	1,707 (2,900)	
<b>Electrical Rating</b>	Available Voltage Range	V	187 to 253	
	Running Amperes	A	9.0	
	Power Input	W	2,040	
	Power Factor	%	98	
	EER	BTU/h/W	11.4	
	COP	W/W	-	
	Compressor Locked Rotor Amperes	A	14.5	
	Fuse or Circuit Breaker Capacity	A	20	
<b>Features</b>			<b>Outdoor Unit</b>	
	Control	Microprocessor		
	Fan Speeds	Auto (Hi, Me, Lo)		
	Compressor	DC Twin Rotary (Inverter)		
	Refrigerant / Amount charged at shipment	lbs (g)	R410A / 6.17 (2,800)	
	Refrigerant Control	Electric Expansion Valve		
	Operation Sound (High) Cool / Heat	dB-A	50 / 52	
	Refrigerant Tubing Connections	Flare Type		
	Max. allowable tubing length per unit	ft (m)	82 (25)	
	Refrigerant	Narrow tube	inch (mm)	1/4 (6.35) × 4
Tube Diameter	Wide tube	inch (mm)	3/8 (9.52) × 3 + 1/2 (12.7) × 1	
<b>Dimensions &amp; Weight</b>			<b>Outdoor Unit</b>	
	Unit Dimensions	inch	29-1/8 × 35-7/16 × 12-19/32	
	Height × Width × Depth	(mm)	(740 × 900 × 320)	
	Package Dimensions	inch	34-3/16 × 41-11/32 × 16-21/32	
	Height × Width × Depth	(mm)	(868 × 1,050 × 423)	
	Weight	Net	lbs (kg)	143.3 (65.0)
	Shipping	lbs (kg)	152.1 (69.0)	
Shipping Volume		cu.ft (m <sup>3</sup> )	13.41 (0.38)	

DATA SUBJECT TO CHANGE WITHOUT NOTICE.

Remarks:

- The values shown in performance section and electrical rating section above are based on the following unit combination.  
 For other combination unit, please refer to the "Unit Combination Tables" in this manual.  
 Indoor Unit : CS-MKE9NKU 3units Outdoor Unit : CU-4KE24NBU 1unit
- Rating conditions are: Cooling : Indoor air temp. 80 °F DB / 67 °F WB Heating : Indoor air temp. 70 °F DB  
 Outdoor air temp. 95 °F DB / 75 °F WB Outdoor air temp. 47 °F DB / 43 °F WB

Outdoor Unit **CU-4KE24NBU**  
 Indoor Unit **CS-MKE9NKU × 3**

< 208V >

<b>Type</b>		4-Room Multi Outdoor Unit	
<b>Number of Connectable Indoor Units</b>		4	
<b>Number of Operatable Indoor Units</b>		4	
<b>Voltage Rating</b>		208V Single-Phase 60Hz	
<b>Performance</b>	Total Capacity	BTU/h	23,200 ( 9,800 to 23,200 )
		kW	6.80 ( 2.90 to 6.80 )
	Sensible Capacity	BTU/h	19,600
	Latent Capacity	BTU/h	3,600
	Air Circulation (High)	ft <sup>3</sup> /min (m <sup>3</sup> /h)	1,707 (2,900)
<b>Electrical Rating</b>	Available Voltage Range	V	187 to 253
	Running Amperes	A	10.0
	Power Input	W	2,040
	Power Factor	%	98
	EER	BTU/h/W	11.4
	COP	W/W	-
	Compressor Locked Rotor Amperes	A	14.5
	Fuse or Circuit Breaker Capacity	A	20
<b>Features</b>			<b>Outdoor Unit</b>
	Control		Microprocessor
	Fan Speeds		Auto (Hi, Me, Lo)
	Compressor		DC Twin Rotary (Inverter)
	Refrigerant / Amount charged at shipment	lbs (g)	R410A / 6.17 (2,800)
	Refrigerant Control		Electric Expansion Valve
	Operation Sound (High) Cool / Heat	dB-A	50 / 52
	Refrigerant Tubing Connections		Flare Type
	Max. allowable tubing length per unit	ft (m)	82 (25)
	Refrigerant	Narrow tube inch (mm)	1/4 (6.35) × 4
Tube Diameter	Wide tube inch (mm)	3/8 (9.52) × 3 + 1/2 (12.7) × 1	
<b>Dimensions &amp; Weight</b>			<b>Outdoor Unit</b>
	Unit Dimensions	inch	29-1/8 × 35-7/16 × 12-19/32
	Height × Width × Depth	(mm)	(740 × 900 × 320)
	Package Dimensions	inch	34-3/16 × 41-11/32 × 16-21/32
	Height × Width × Depth	(mm)	(868 × 1,050 × 423)
	Weight	Net lbs (kg)	143.3 (65.0)
	Shipping lbs (kg)	152.1 (69.0)	
Shipping Volume	cu.ft (m <sup>3</sup> )	13.41 (0.38)	

DATA SUBJECT TO CHANGE WITHOUT NOTICE.

Remarks:

- The values shown in performance section and electrical rating section above are based on the following unit combination.  
 For other combination unit, please refer to the "Unit Combination Tables" in this manual.  
 Indoor Unit : CS-MKE9NKU 3units Outdoor Unit : CU-4KE24NBU 1unit
- Rating conditions are: Cooling : Indoor air temp. 80 °F DB / 67 °F WB Heating : Indoor air temp. 70 °F DB  
 Outdoor air temp. 95 °F DB / 75 °F WB Outdoor air temp. 47 °F DB / 43 °F WB

Outdoor Unit **CU-4KE31NBU**  
 Indoor Unit **CS-MKE7NKU × 3 + CS-MKE9NKU**

Duct Less Type Rated

< 230V >

<b>Type</b>		4-Room Multi Outdoor Unit	
<b>Number of Connectable Indoor Units</b>		4	
<b>Number of Operatable Indoor Units</b>		4	
<b>Voltage Rating</b>		230V Single-Phase 60Hz	
<b>Performance</b>	Total Capacity	BTU/h	29,000 ( 9,800 to 29,000 )
		kW	8.50 ( 2.90 to 8.50 )
	Sensible Capacity	BTU/h	24,400
	Latent Capacity	BTU/h	4,600
Air Circulation (High)	ft <sup>3</sup> /min (m <sup>3</sup> /h)	1,942 (3,300)	1,942 (3,300)
<b>Electrical Rating</b>	Available Voltage Range	V	187 to 253
	Running Amperes	A	11.4
	Power Input	W	2,600
	Power Factor	%	99
	EER	BTU/h/W	11.2
	COP	W/W	-
	SEER	BTU/Wh	17.2
	HSPF	BTU/Wh	-
	Compressor Locked Rotor Amperes	A	17.0
	Fuse or Circuit Breaker Capacity	A	20
<b>Features</b>	<b>Outdoor Unit</b>		
	Control	Microprocessor	
	Fan Speeds	Auto (Hi, Me, Lo)	
	Compressor	DC Twin Rotary (Inverter)	
	Refrigerant / Amount charged at shipment	lbs (g)	R410A / 8.38 (3,800)
	Refrigerant Control	Electric Expansion Valve	
	Operation Sound (High) Cool / Heat	dB-A	53 / 55
	Refrigerant Tubing Connections	Flare Type	
	Max. allowable tubing length per unit	ft (m)	100 (30.5)
	Refrigerant	Narrow tube	inch (mm)
Tube Diameter	Wide tube	inch (mm)	3/8 (9.52) × 2 + 1/2 (12.7) × 2
<b>Dimensions &amp; Weight</b>	<b>Outdoor Unit</b>		
	Unit Dimensions	inch	35-1/32 × 35-7/16 × 12-19/32
	Height × Width × Depth	(mm)	(890 × 900 × 320)
	Package Dimensions	inch	40-1/8 × 41-11/32 × 16-21/32
	Height × Width × Depth	(mm)	(1,019 × 1,050 × 423)
	Weight	Net	lbs (kg)
	Shipping	lbs (kg)	189.6 (86.0)
Shipping Volume		cu.ft (m <sup>3</sup> )	15.88 (0.45)

DATA SUBJECT TO CHANGE WITHOUT NOTICE.

Remarks:

- The values shown in performance section and electrical rating section above are based on the following unit combination.  
 For other combination unit, please refer to the "Unit Combination Tables" in this manual.  
 Indoor Unit : CS-MKE7NKU 3units / CS-MKE9NKU 1units      Outdoor Unit : CU-4KE31NBU 1unit  
 The combination indoor unit is AHRI 210/240.
- Rating conditions are: Cooling : Indoor air temp. 80 °F DB / 67 °F WB      Heating : Indoor air temp. 70 °F DB  
 Outdoor air temp. 95 °F DB / 75 °F WB      Outdoor air temp. 47 °F DB / 43 °F WB

Outdoor Unit **CU-4KE31NBU**  
 Indoor Unit **CS-MKE9NKU × 4**

< 230V >

<b>Type</b>		4-Room Multi Outdoor Unit	
<b>Number of Connectable Indoor Units</b>		4	
<b>Number of Operatable Indoor Units</b>		4	
<b>Voltage Rating</b>		230V Single-Phase 60Hz	
<b>Performance</b>	Total Capacity	BTU/h	30,600 ( 9,800 to 30,600 )
		kW	9.00 ( 2.90 to 9.00 )
	Sensible Capacity	BTU/h	25,800
	Latent Capacity	BTU/h	4,800
Air Circulation (High)	ft <sup>3</sup> /min (m <sup>3</sup> /h)	1,942 (3,300)	1,942 (3,300)
<b>Electrical Rating</b>	Available Voltage Range	V	187 to 253
	Running Amperes	A	12.3
	Power Input	W	2,800
	Power Factor	%	99
	EER	BTU/h/W	10.9
	COP	W/W	-
	Compressor Locked Rotor Amperes	A	17.0
	Fuse or Circuit Breaker Capacity	A	20
<b>Features</b>			<b>Outdoor Unit</b>
	Control	Microprocessor	
	Fan Speeds	Auto (Hi, Me, Lo)	
	Compressor	DC Twin Rotary (Inverter)	
	Refrigerant / Amount charged at shipment	lbs (g)	R410A / 8.38 (3,800)
	Refrigerant Control	Electric Expansion Valve	
	Operation Sound (High) Cool / Heat	dB-A	53 / 55
	Refrigerant Tubing Connections	Flare Type	
	Max. allowable tubing length per unit	ft (m)	100 (30.5)
	Refrigerant	Narrow tube	inch (mm)
Tube Diameter	Wide tube	inch (mm)	3/8 (9.52) × 2 + 1/2 (12.7) × 2
<b>Dimensions &amp; Weight</b>			<b>Outdoor Unit</b>
	Unit Dimensions	inch	35-1/32 × 35-7/16 × 12-19/32
	Height × Width × Depth	(mm)	(890 × 900 × 320)
	Package Dimensions	inch	40-1/8 × 41-11/32 × 16-21/32
	Height × Width × Depth	(mm)	(1,019 × 1,050 × 423)
	Weight	Net	lbs (kg)
	Shipping	lbs (kg)	189.6 (86.0)
Shipping Volume		cu.ft (m <sup>3</sup> )	15.88 (0.45)

DATA SUBJECT TO CHANGE WITHOUT NOTICE.

Remarks:

- The values shown in performance section and electrical rating section above are based on the following unit combination.  
 For other combination unit, please refer to the "Unit Combination Tables" in this manual.  
 Indoor Unit : CS-MKE9NKU 4units Outdoor Unit : CU-4KE31NBU 1unit
- Rating conditions are: Cooling : Indoor air temp. 80 °F DB / 67 °F WB Heating : Indoor air temp. 70 °F DB  
 Outdoor air temp. 95 °F DB / 75 °F WB Outdoor air temp. 47 °F DB / 43 °F WB

Outdoor Unit **CU-4KE31NBU**  
 Indoor Unit **CS-MKE9NKU × 4**

< 208V >

<b>Type</b>		4-Room Multi Outdoor Unit	
<b>Number of Connectable Indoor Units</b>		4	
<b>Number of Operatable Indoor Units</b>		4	
<b>Voltage Rating</b>		208V Single-Phase 60Hz	
<b>Performance</b>	Total Capacity	BTU/h	28,600 ( 9,800 to 28,600 )
		kW	8.40 ( 2.90 to 8.40 )
	Sensible Capacity	BTU/h	24,200
	Latent Capacity	BTU/h	4,400
	Air Circulation (High)	ft <sup>3</sup> /min (m <sup>3</sup> /h)	1,942 (3,300)
<b>Electrical Rating</b>	Available Voltage Range	V	187 to 253
	Running Amperes	A	12.7
	Power Input	W	2,560
	Power Factor	%	99
	EER	BTU/h/W	11.2
	COP	W/W	-
	Compressor Locked Rotor Amperes	A	17.0
	Fuse or Circuit Breaker Capacity	A	20
<b>Features</b>			<b>Outdoor Unit</b>
	Control	Microprocessor	
	Fan Speeds	Auto (Hi, Me, Lo)	
	Compressor	DC Twin Rotary (Inverter)	
	Refrigerant / Amount charged at shipment	lbs (g)	R410A / 8.38 (3,800)
	Refrigerant Control	Electric Expansion Valve	
	Operation Sound (High) Cool / Heat	dB-A	53 / 55
	Refrigerant Tubing Connections	Flare Type	
	Max. allowable tubing length per unit	ft (m)	100 (30.5)
	Refrigerant	Narrow tube	inch (mm)
Tube Diameter	Wide tube	inch (mm)	3/8 (9.52) × 2 + 1/2 (12.7) × 2
<b>Dimensions &amp; Weight</b>			<b>Outdoor Unit</b>
	Unit Dimensions	inch	35-1/32 × 35-7/16 × 12-19/32
	Height × Width × Depth	(mm)	(890 × 900 × 320)
	Package Dimensions	inch	40-1/8 × 41-11/32 × 16-21/32
	Height × Width × Depth	(mm)	(1,019 × 1,050 × 423)
	Weight	Net	lbs (kg)
	Shipping	lbs (kg)	189.6 (86.0)
Shipping Volume		cu.ft (m <sup>3</sup> )	15.88 (0.45)

DATA SUBJECT TO CHANGE WITHOUT NOTICE.

Remarks:

- The values shown in performance section and electrical rating section above are based on the following unit combination.  
 For other combination unit, please refer to the "Unit Combination Tables" in this manual.  
 Indoor Unit : CS-MKE9NKU 4units Outdoor Unit : CU-4KE31NBU 1unit
- Rating conditions are: Cooling : Indoor air temp. 80 °F DB / 67 °F WB Heating : Indoor air temp. 70 °F DB  
 Outdoor air temp. 95 °F DB / 75 °F WB Outdoor air temp. 47 °F DB / 43 °F WB

## 2-2. Major Component Specifications

### 2-2-1. Outdoor Unit

Outdoor Unit **CU-3KE19NBU**

<b>Control PCB</b>	
Part No.	CB-CU-3KE19NBU
Controls	Microprocessor
Control Circuit Fuse	250V 25A

<b>Compressor</b>	
Type	DC Twin Rotary (Hermetic)
Compressor Model / Nominal Output	5KD240XAB21 / 1,700W
Compressor Oil ... Amount	Pints (cc) FV50S ... 1.91 (900)
Coil Resistance (Ambient Temp. 68 °F (20 °C))	Ohm U - V : 0.720 V - W : 0.708 W - U : 0.726
Safety Device	
CT (Peak current cut-off control)	Yes
Compressor Discharge Temp. Control	Yes
Operation cut-off control in abnormal ambient Temp.	Yes
Overload Relay	Model CS-7L-2515
	Operation Temp. Open : 239 °F (115 °C), Close : 212 °F (100 °C)
Run Capacitor	Micro F - VAC -
Crankcase Heater	230V 30W

<b>Fan</b>	
Type	Propeller
Q'ty ... Dia.	inch (mm) 1 ... D18-1/8 (D460)

<b>Fan Motor</b>	
Type	DC Motor
Model ... Q'ty	SIC-71FW-D490-1 ... 1
No. of Poles	8
Rough Measure RPM (Cool / Heat)	750 / 750
Nominal Output	W 90
Coil Resistance	Ohm - (Ambient Temp. 68 °F (20 °C))
Safety Device	
Type	Internal Controller
Over-Current Protection	Yes
Over-Heat Protection	Yes
Run Capacitor	Micro F - VAC -

<b>Heat Exchanger Coil</b>	
Coil	Aluminum Plate Fin / Copper Tube
Rows	2
Fins per inch	18.1
Face Area	ft <sup>2</sup> (m <sup>2</sup> ) 6.40 (0.595)

<b>External Finish</b>	Acrylic baked-on enamel finish
------------------------	--------------------------------

DATA SUBJECT TO CHANGE WITHOUT NOTICE.

Outdoor Unit **CU-4KE24NBU**

<b>Control PCB</b>	
Part No.	CB-CU-4KE24NBU
Controls	Microprocessor
Control Circuit Fuse	250V 25A

<b>Compressor</b>	
Type	DC Twin Rotary (Hermetic)
Compressor Model / Nominal Output	5KD240XAB21 / 1,700W
Compressor Oil ... Amount	Pints (cc) FV50S ... 1.91 (900)
Coil Resistance (Ambient Temp. 68 °F (20 °C))	Ohm U - V : 0.720 V - W : 0.708 W - U : 0.726
Safety Device	
CT (Peak current cut-off control)	Yes
Compressor Discharge Temp. Control	Yes
Operation cut-off control in abnormal ambient Temp.	Yes
Overload Relay	Model CS-7L-2515
	Operation Temp. Open : 239 °F (115 °C), Close : 212 °F (100 °C)
Run Capacitor	Micro F - VAC -
Crankcase Heater	230V 30W

<b>Fan</b>	
Type	Propeller
Q'ty ... Dia.	inch (mm) 1 ... D18-1/8 (D460)

<b>Fan Motor</b>	
Type	DC Motor
Model ... Q'ty	SIC-71FW-D490-1 ... 1
No. of Poles	8
Rough Measure RPM (Cool / Heat)	750 / 750
Nominal Output	W 90
Coil Resistance	Ohm - (Ambient Temp. 68 °F (20 °C))
Safety Device	
Type	Internal Controller
Over-Current Protection	Yes
Over-Heat Protection	Yes
Run Capacitor	Micro F - VAC -

<b>Heat Exchanger Coil</b>	
Coil	Aluminum Plate Fin / Copper Tube
Rows	2
Fins per inch	18.1
Face Area	ft <sup>2</sup> (m <sup>2</sup> ) 6.40 (0.595)

<b>External Finish</b>	Acrylic baked-on enamel finish
------------------------	--------------------------------

DATA SUBJECT TO CHANGE WITHOUT NOTICE.

Outdoor Unit **CU-4KE31NBU**

<b>Control PCB</b>	
Part No.	CB-CU-4KE31NBU
Controls	Microprocessor
Control Circuit Fuse	250V 25A

<b>Compressor</b>	
Type	DC Twin Rotary (Hermetic)
Compressor Model / Nominal Output	5JD420XAB22 / 3,000W
Compressor Oil ... Amount	Pints (cc)
	FV50S ... 2.55 (1,200)
Coil Resistance (Ambient Temp. 68 °F (20 °C))	Ohm
	U - V : 0.435 V - W : 0.441 W - U : 0.452
Safety Device	
CT (Peak current cut-off control)	Yes
Compressor Discharge Temp. Control	Yes
Operation cut-off control in abnormal ambient Temp.	Yes
Overload Relay	Model
	CS-7L-2515
	Operation Temp.
	Open : 239 °F (115 °C), Close : 212 °F (100 °C)
Run Capacitor	Micro F
	VAC
	-
	-
Crankcase Heater	230V 30W

<b>Fan</b>	
Type	Propeller
Q'ty ... Dia.	inch (mm)
	1 ... D18-1/8 (D460)

<b>Fan Motor</b>	
Type	DC Motor
Model ... Q'ty	SIC-71FW-D490-1 ... 1
No. of Poles	8
Rough Measure RPM (Cool / Heat)	800 / 800
Nominal Output	W
	90
Coil Resistance	Ohm
(Ambient Temp. 68 °F (20 °C))	-
Safety Device	
Type	Internal Controller
Over-Current Protection	Yes
Over-Heat Protection	Yes
Run Capacitor	Micro F
	VAC
	-
	-


<b>Heat Exchanger Coil</b>	
Coil	Aluminum Plate Fin / Copper Tube
Rows	2
Fins per inch	18.1
Face Area	ft <sup>2</sup> (m <sup>2</sup> )
	7.75 (0.72)

<b>External Finish</b>	Acrylic baked-on enamel finish
------------------------	--------------------------------


DATA SUBJECT TO CHANGE WITHOUT NOTICE.

## 2-3. Other Component Specifications

Sensor Name	Model No. of sensor	Quantity of Sensor		
		CU-3KE19NBU	CU-4KE24NBU	CU-4KE31NBU
Outdoor air temp sensor	TKS295B	1	1	1
Outdoor heat exchanger sensor	TKS292B	1	1	1
AW / AN sensor	TKS292B	1 / 1	1 / 1	1 / 1
BW / BN sensor	TKS292B	1 / 1	1 / 1	1 / 1
CW / CN sensor	TKS292B	1 / 1	1 / 1	1 / 1
DW / DN sensor	TKS292B	0	1 / 1	1 / 1



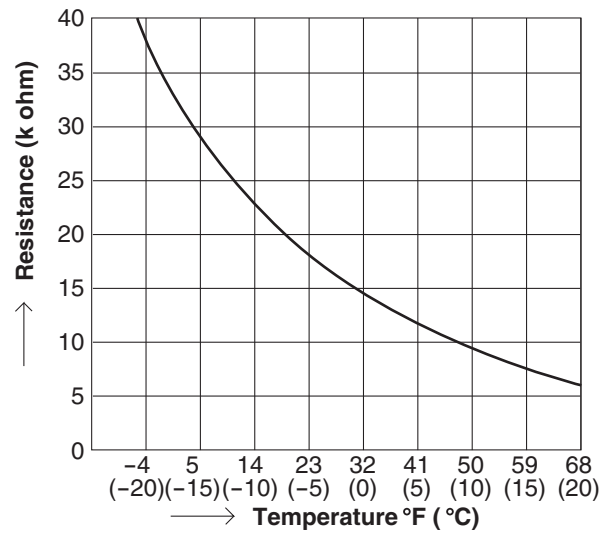


Sensor Name	Model No. of sensor	Quantity of Sensor		
		CU-3KE19NBU	CU-4KE24NBU	CU-4KE31NBU
Compressor temp sensor	TKS293B	1	1	1

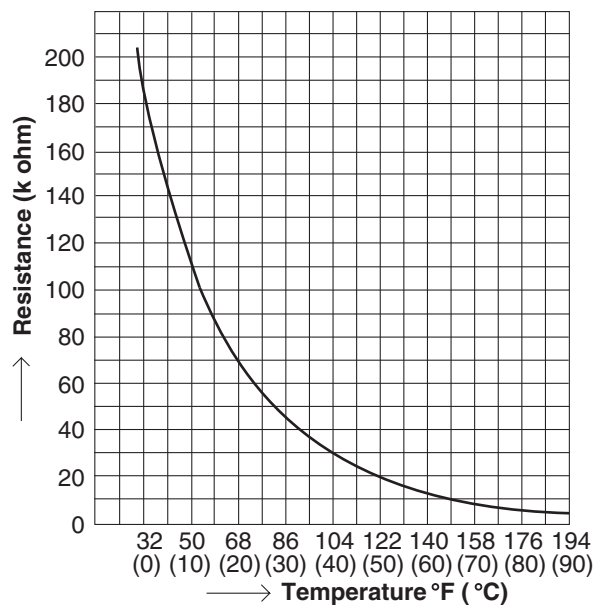




### 3. DIMENSIONAL DATA

Outdoor Unit CU-3KE19NBU

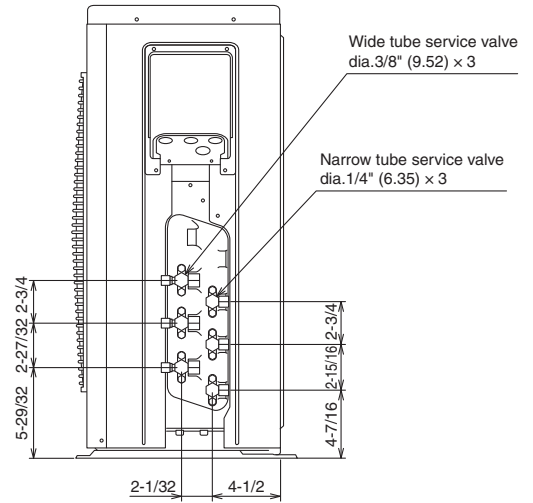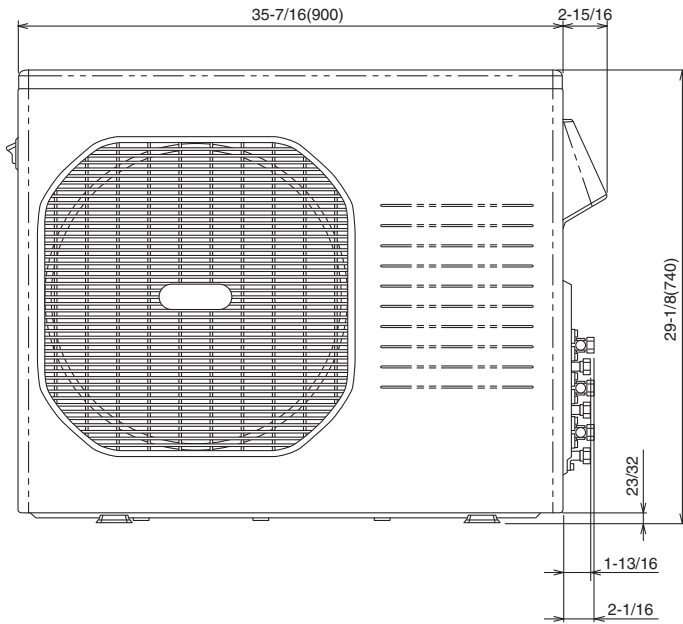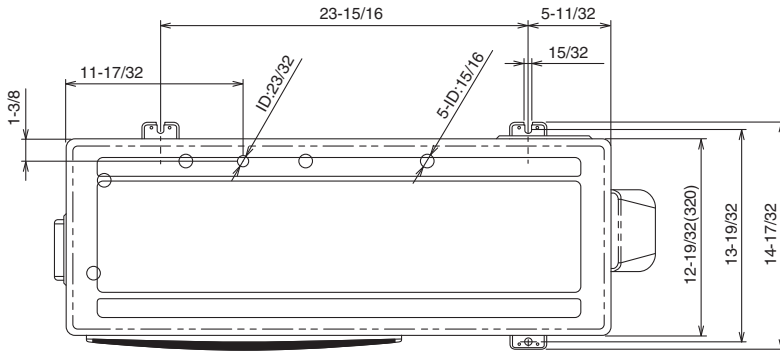




Unit: inch(mm)  
(852-0-0010-11200-0)

Outdoor Unit **CU-4KE24NBU**

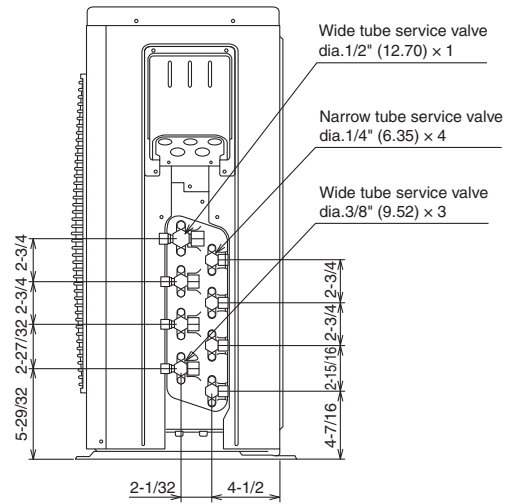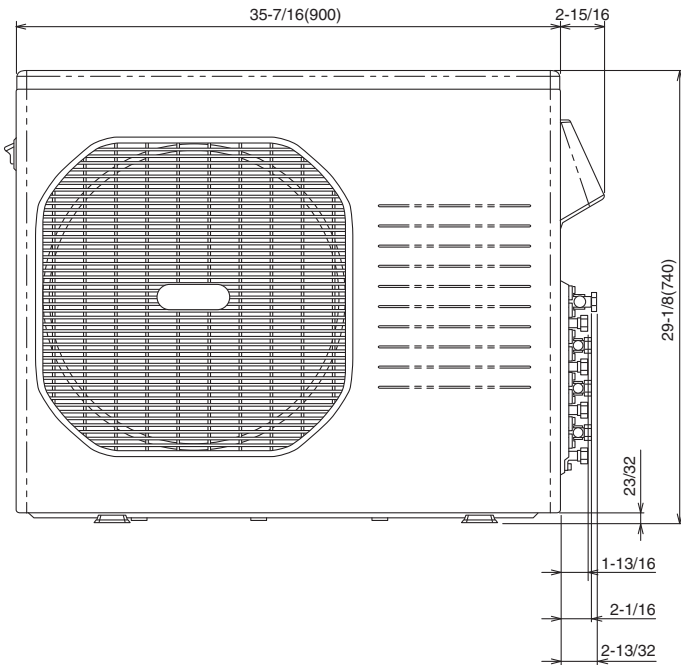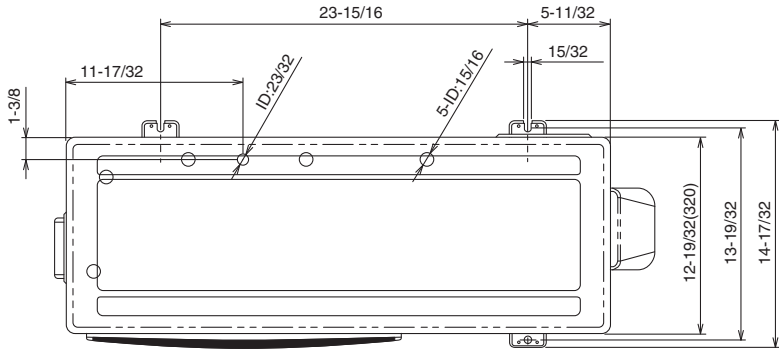

Unit: inch(mm)  
(852-0-0010-20400-0)

Outdoor Unit **CU-4KE31NBU**

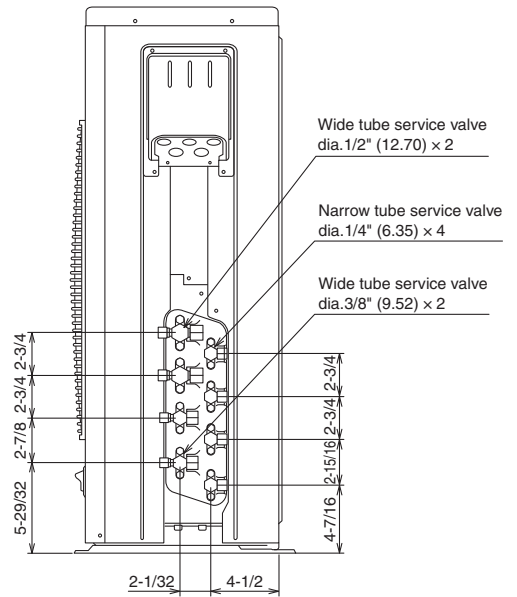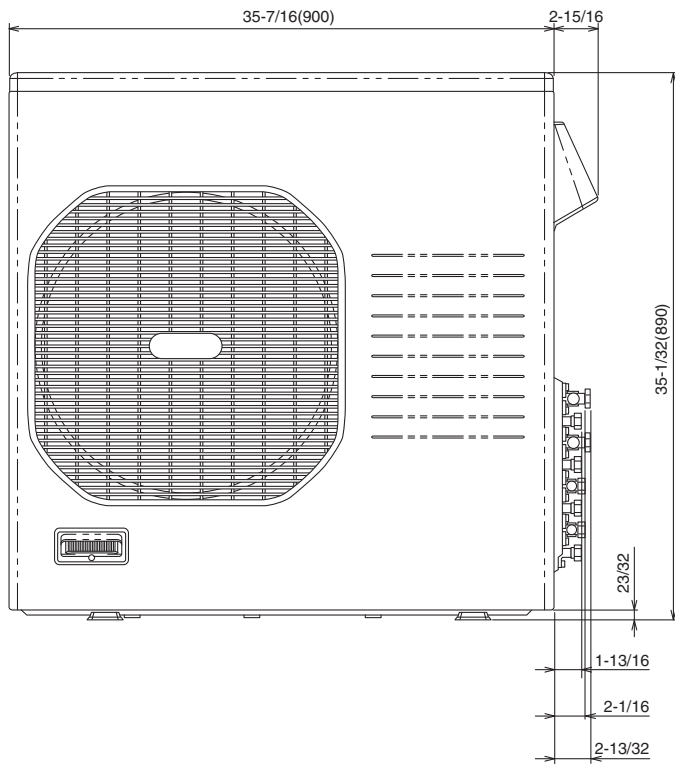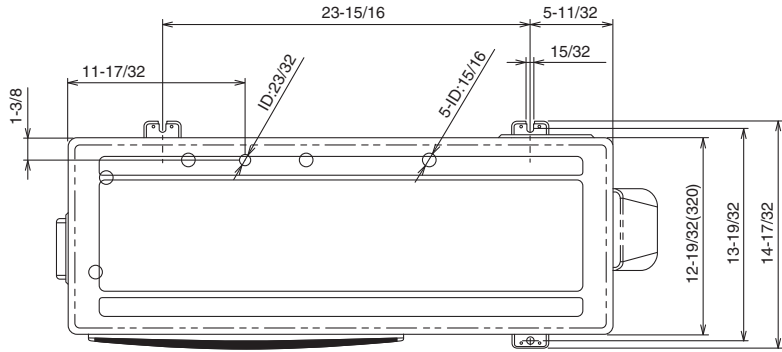


Unit: inch(mm)  
(852-0-0010-20300-0)

# 4. REFRIGERANT FLOW DIAGRAM

## 4-1. Refrigerant Flow Diagram


Outdoor Unit CU-3KE19NBU

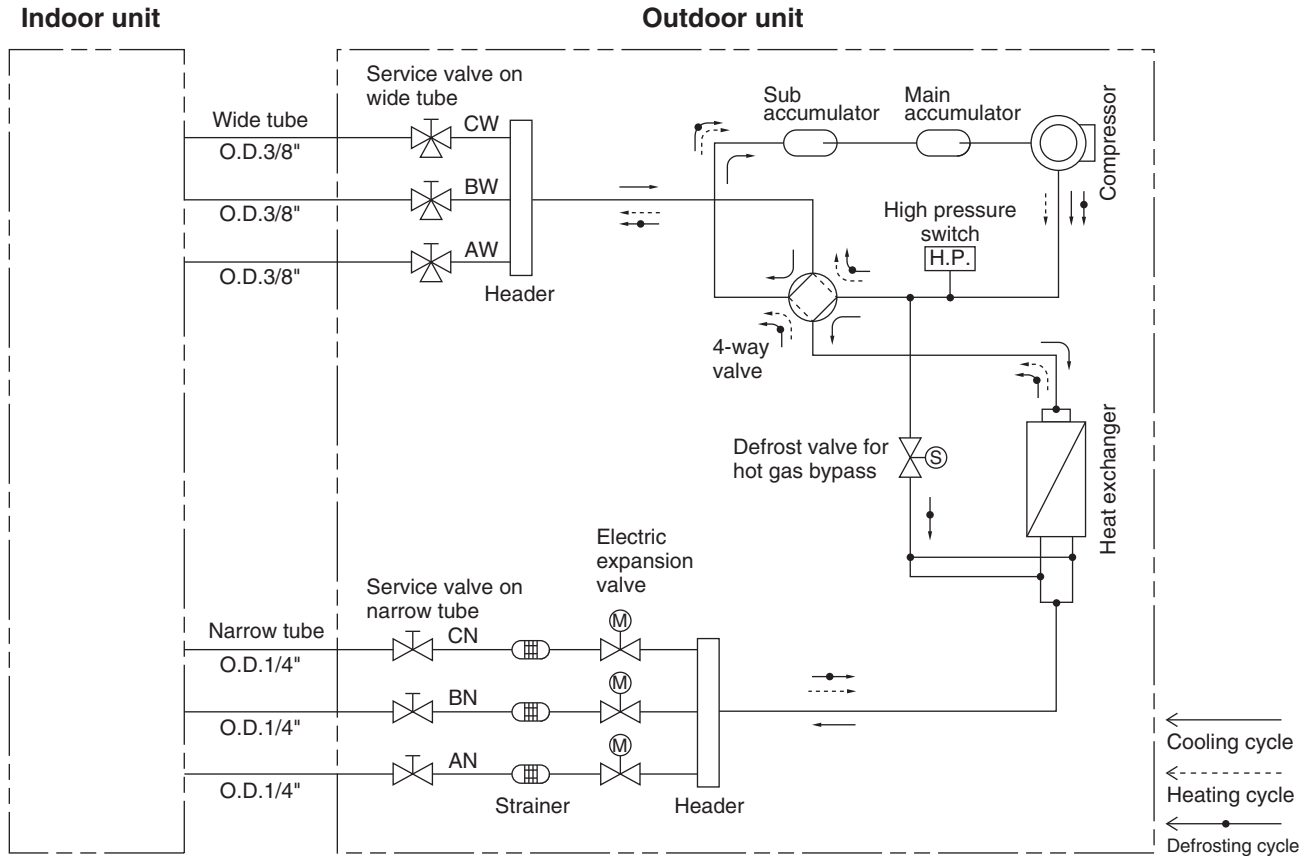

### Insulation of Refrigerant Tubing


#### IMPORTANT

Because capillary tubing is used in the outdoor unit, both the wide and narrow tubes of this air conditioner become cold. To prevent heat loss and wet floors due to dripping of condensation, **both tubes must be well insulated** with a proper insulation material. The thickness of the insulation should be a min.5/16"(8 mm).

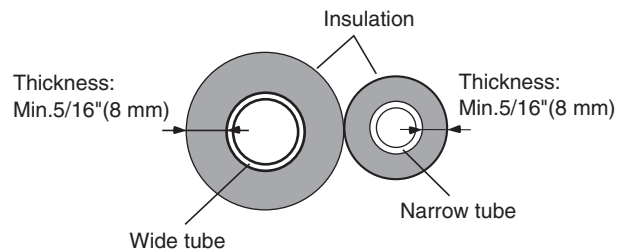

**CAUTION**


**After a tube has been insulated, never try to bend it into a narrow curve because it can cause the tube to break or crack.**

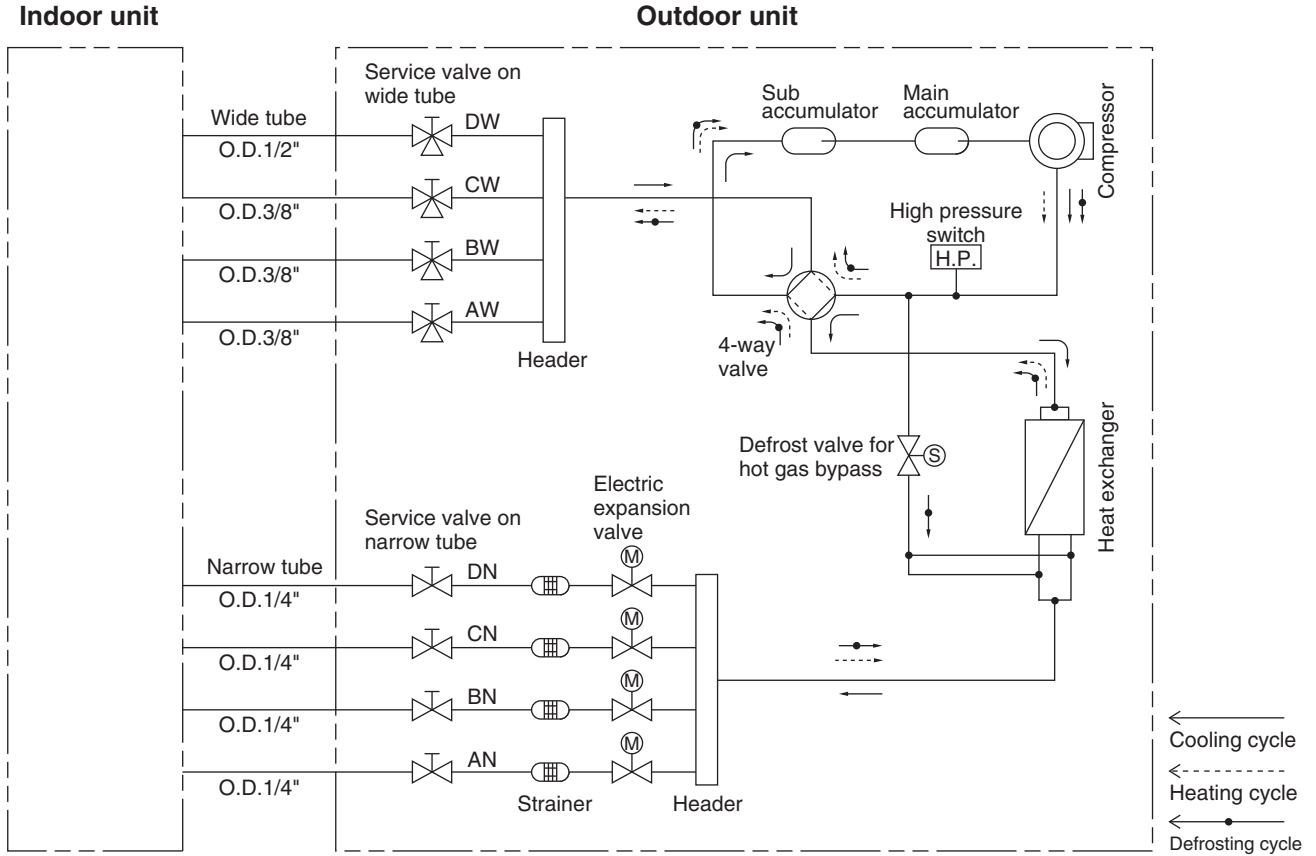

## Insulation of Refrigerant Tubing

### IMPORTANT


Because capillary tubing is used in the outdoor unit, both the wide and narrow tubes of this air conditioner become cold. To prevent heat loss and wet floors due to dripping of condensation, **both tubes must be well insulated** with a proper insulation material. The thickness of the insulation should be a min.5/16"(8 mm).

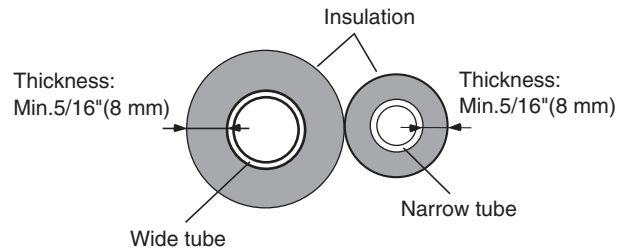

**CAUTION**

**After a tube has been insulated, never try to bend it into a narrow curve because it can cause the tube to break or crack.**


Outdoor Unit **CU-4KE31NBU**

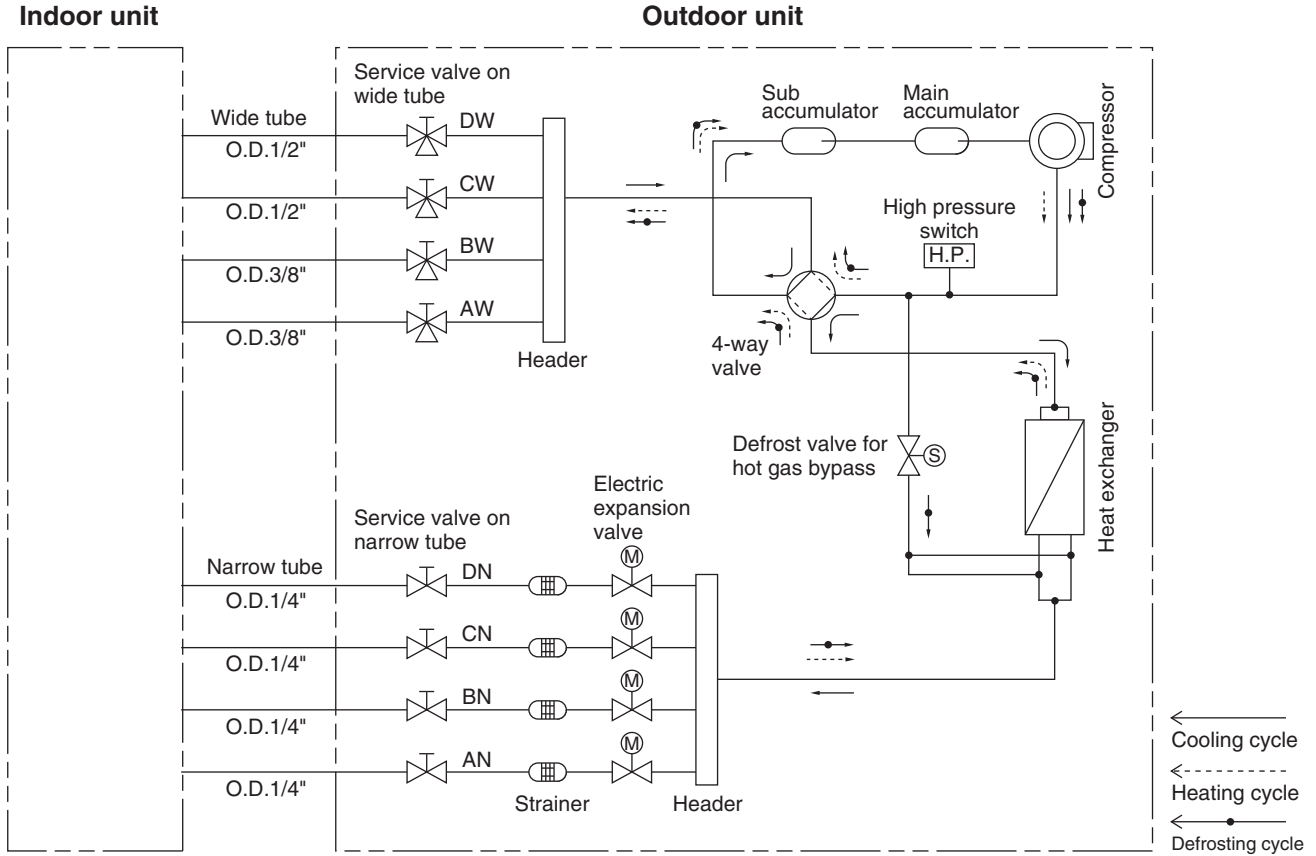

### Insulation of Refrigerant Tubing

**IMPORTANT**

Because capillary tubing is used in the outdoor unit, both the wide and narrow tubes of this air conditioner become cold. To prevent heat loss and wet floors due to dripping of condensation, **both tubes must be well insulated** with a proper insulation material. The thickness of the insulation should be a min.5/16"(8 mm).

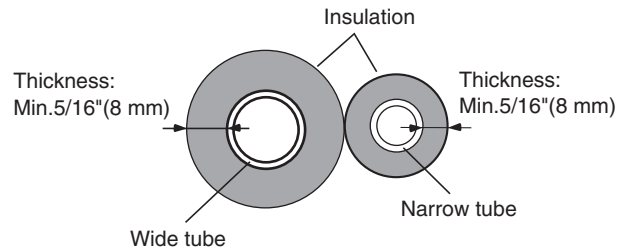

**CAUTION**

**After a tube has been insulated, never try to bend it into a narrow curve because it can cause the tube to break or crack.**

# 5. PERFORMANCE DATA

## 5-1. Temperature Charts


### 5-1-1. Temperature Charts (CU-3KE19NBU)

Outdoor Unit **CU-3KE19NBU** Indoor Unit **CS-MKE7NKU × 1**


#### ■ Cooling Characteristics

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

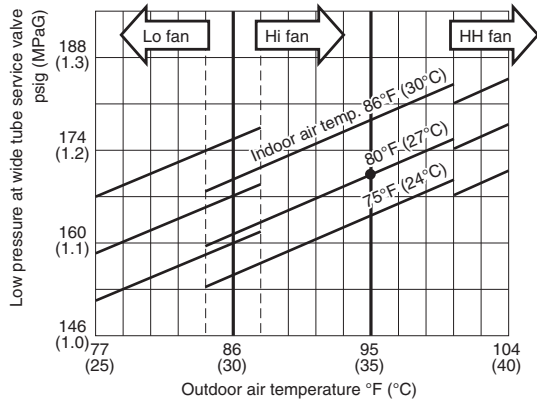

(2) Operating current performance chart

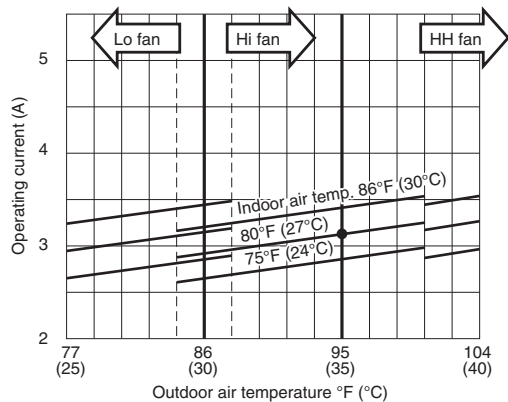


(3) Indoor discharge air performance chart

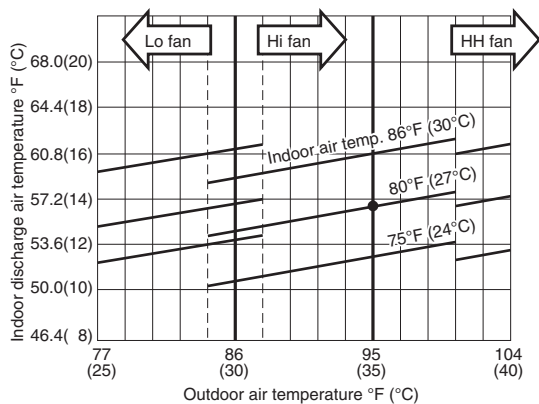


#### ■ Heating Characteristics

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

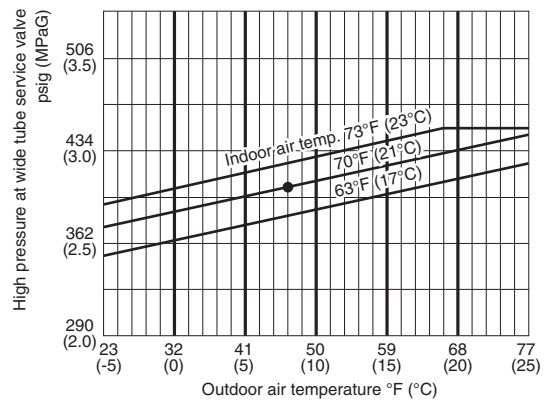

(2) Operating current performance chart

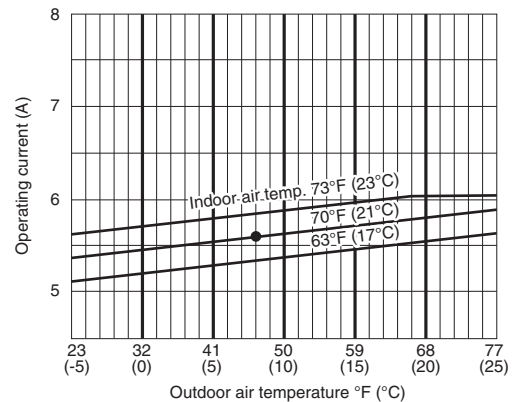

(3) Indoor discharge air performance chart

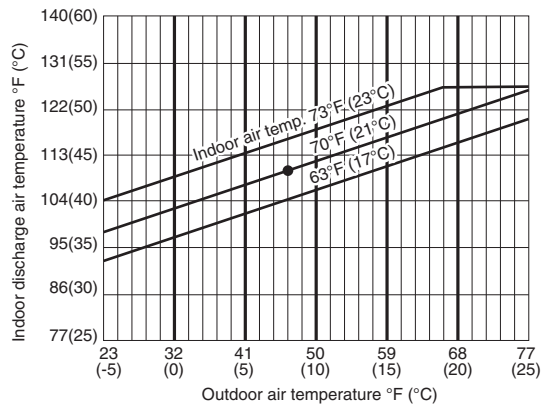

#### NOTE


- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6t (7.5m). If the tubing length is different, the performance chart will vary.

Outdoor Unit **CU-3KE19NBU** Indoor Unit **CS-MKE9NKU × 1**


■ Cooling Characteristics

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

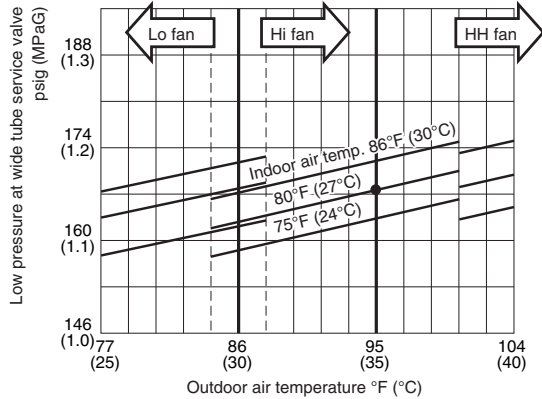

(2) Operating current performance chart

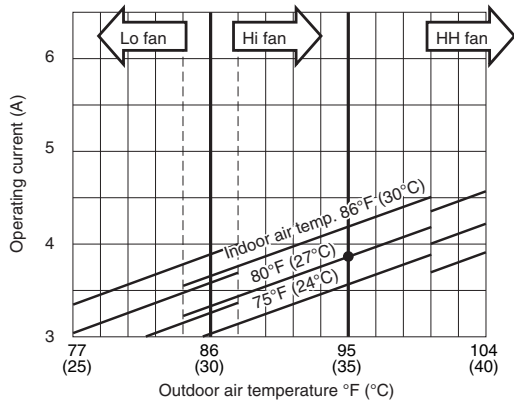


(3) Indoor discharge air performance chart

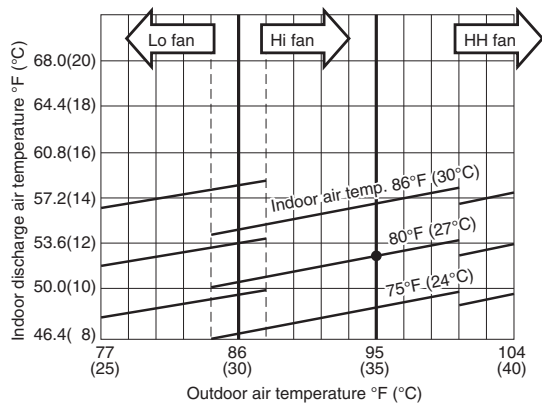


■ Heating Characteristics

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

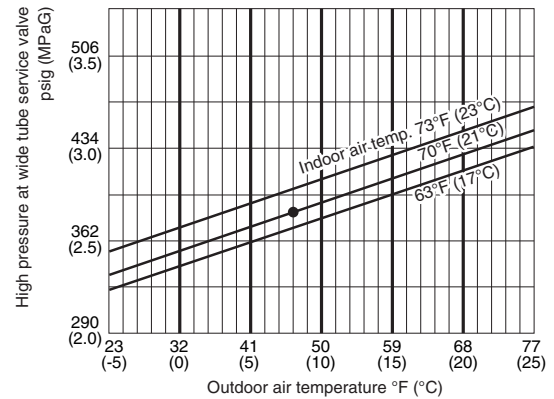

(2) Operating current performance chart

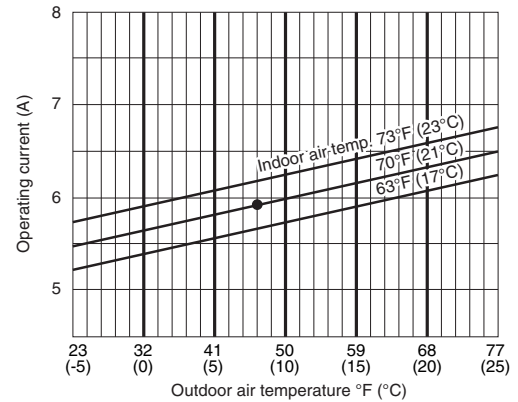

(3) Indoor discharge air performance chart

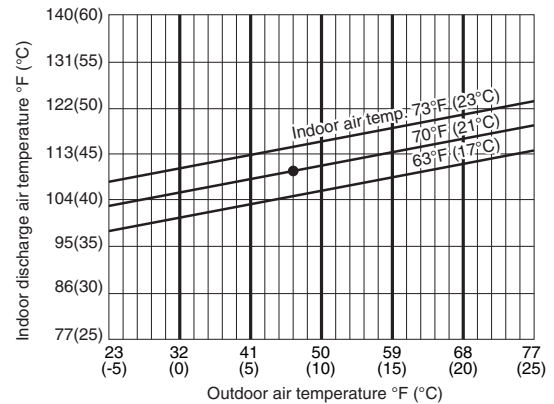

**NOTE**


- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.

Outdoor Unit **CU-3KE19NBU** Indoor Unit **CS-MKE12NKU × 1**


■ Cooling Characteristics

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

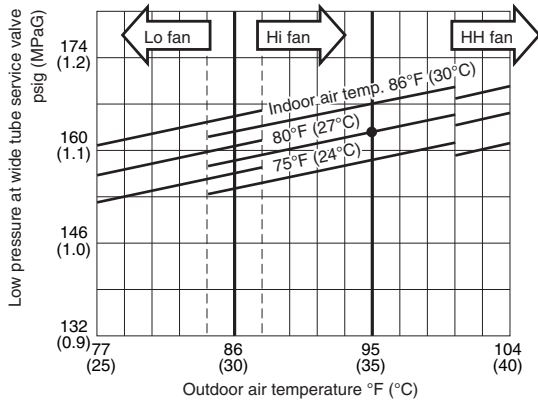

(2) Operating current performance chart

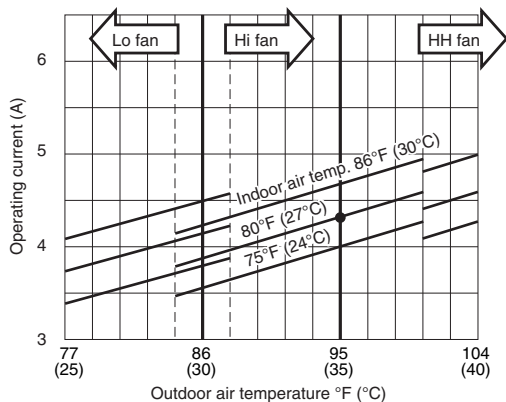


(3) Indoor discharge air performance chart

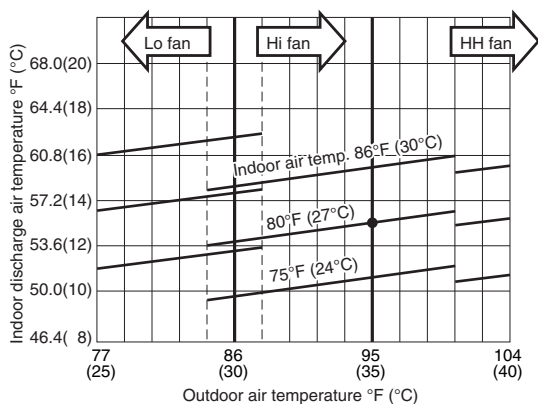


■ Heating Characteristics

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

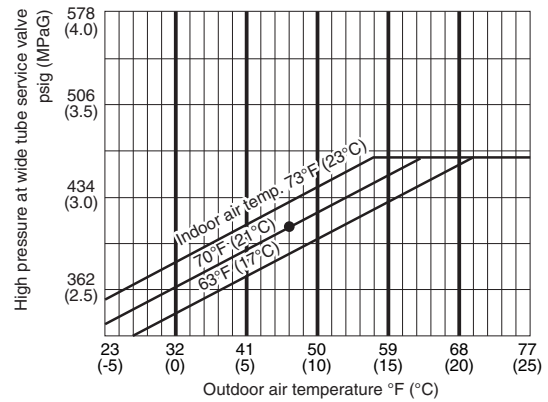

(2) Operating current performance chart

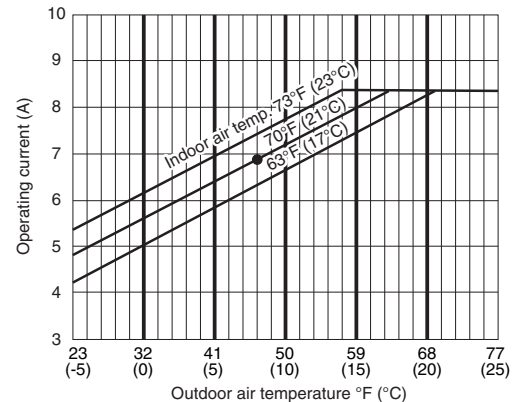

(3) Indoor discharge air performance chart

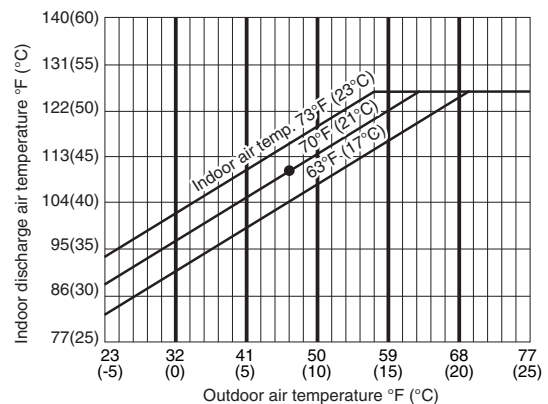

**NOTE**


- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.

Outdoor Unit **CU-3KE19NBU** Indoor Unit **CS-MKE18NKU × 1**


■ Cooling Characteristics

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

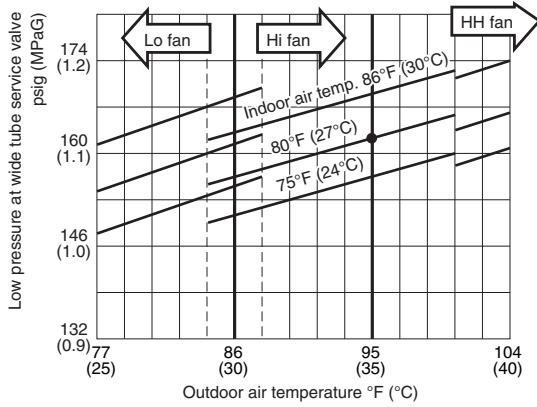

(2) Operating current performance chart

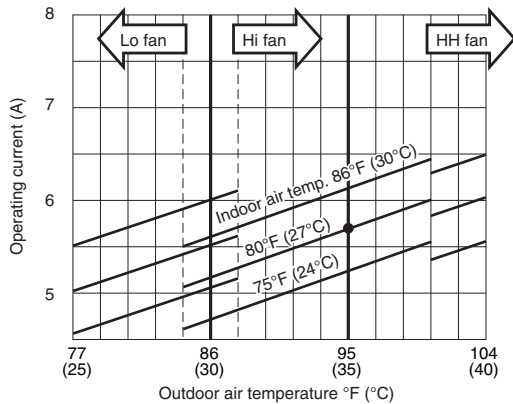

(3) Indoor discharge air performance chart

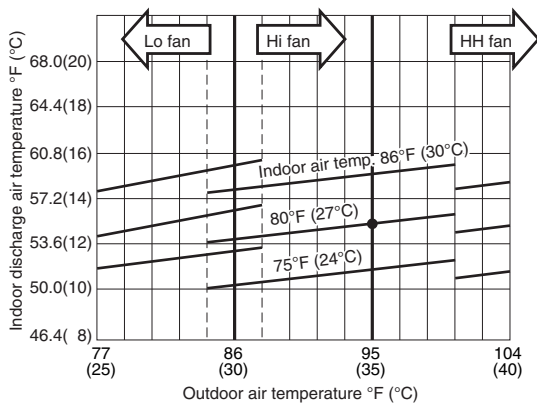


**NOTE**

- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.


■ Heating Characteristics

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

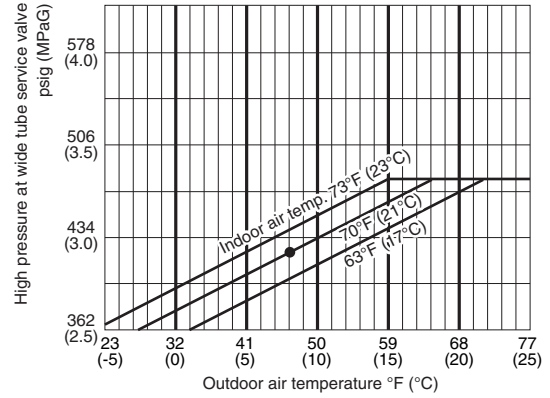

(2) Operating current performance chart

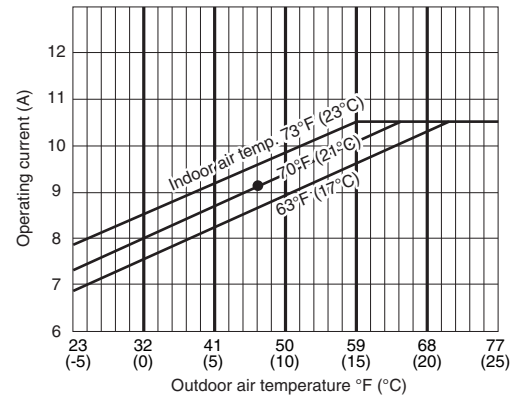

(3) Indoor discharge air performance chart

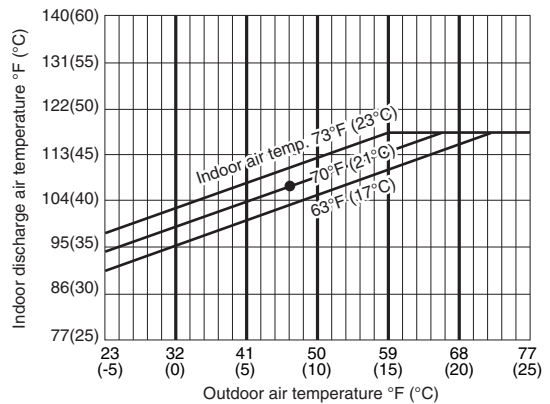


Outdoor Unit **CU-3KE19NBU** Indoor Unit **CS-MKE9NB4U × 1**


■ **Cooling Characteristics**

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

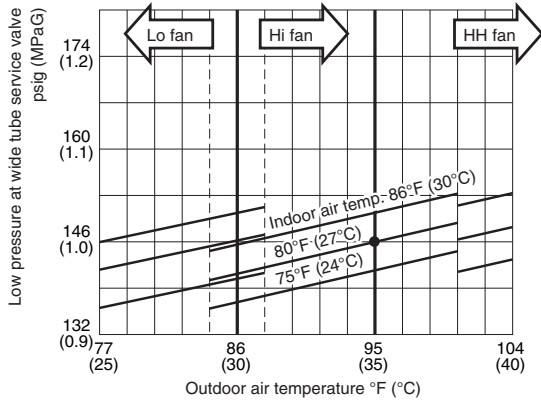

(2) Operating current performance chart

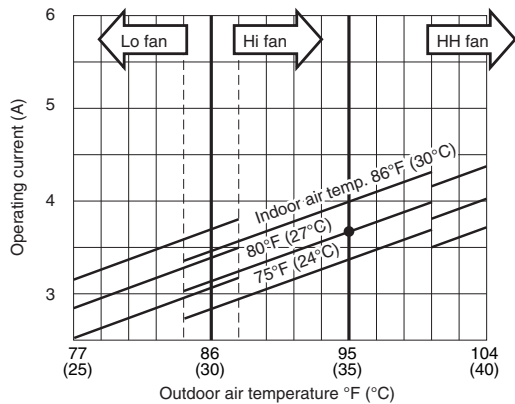


(3) Indoor discharge air performance chart

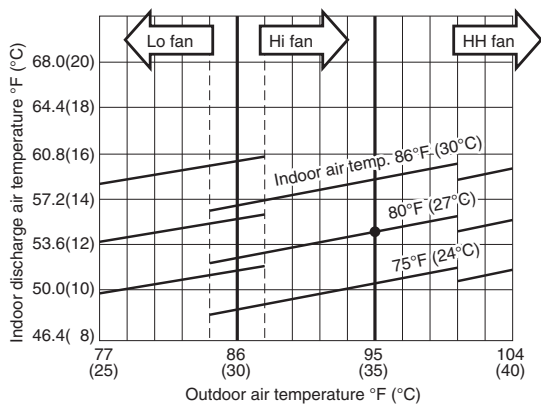


■ **Heating Characteristics**

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

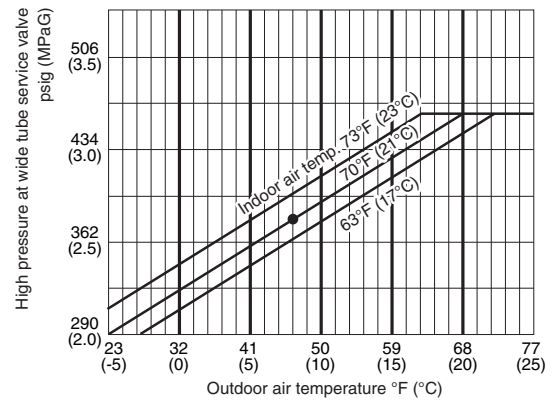

(2) Operating current performance chart

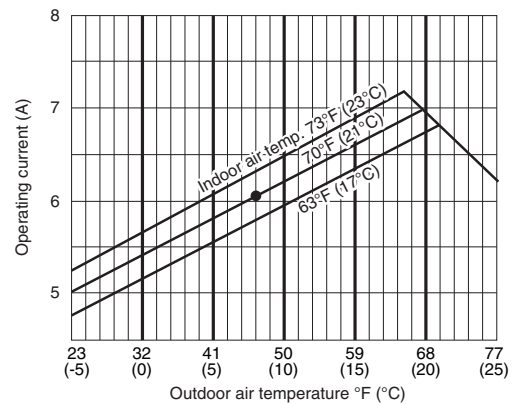

(3) Indoor discharge air performance chart

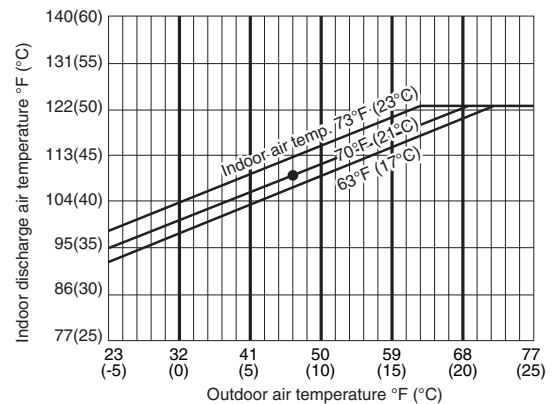

**NOTE**


- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.

Outdoor Unit **CU-3KE19NBU** Indoor Unit **CS-MKE12NB4U × 1**


■ **Cooling Characteristics**

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

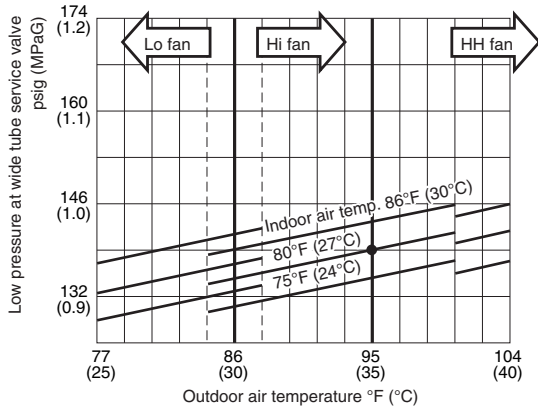

(2) Operating current performance chart

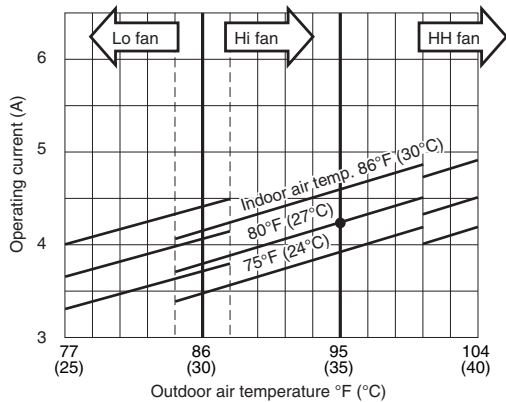


(3) Indoor discharge air performance chart

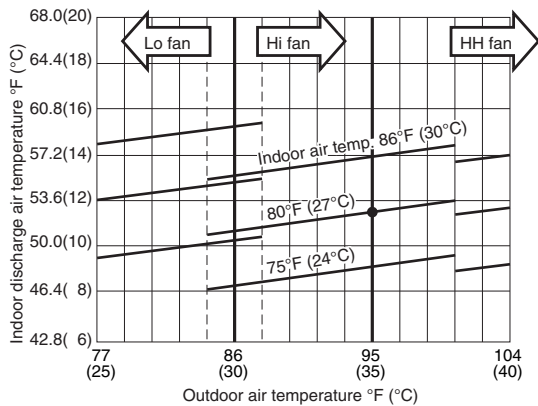


■ **Heating Characteristics**

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

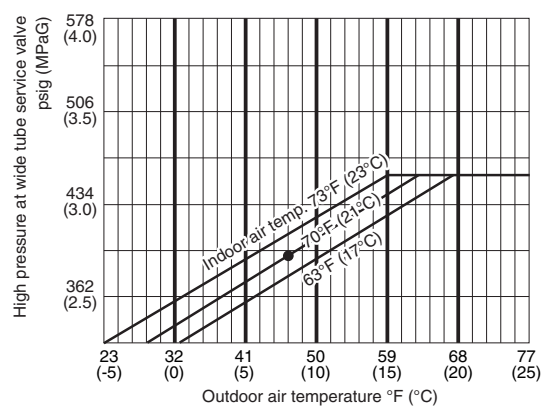

(2) Operating current performance chart

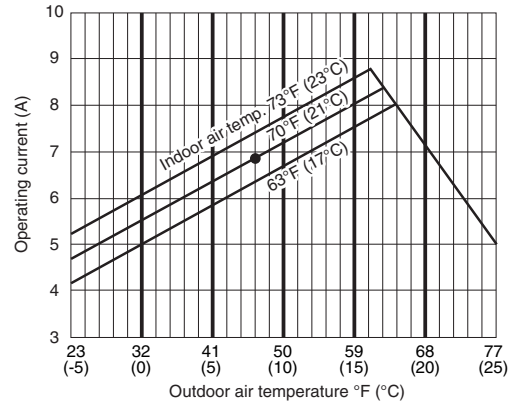

(3) Indoor discharge air performance chart

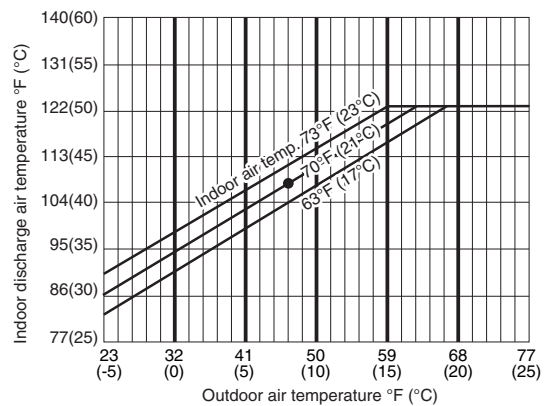

**NOTE**


- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.

Outdoor Unit **CU-3KE19NBU** Indoor Unit **CS-KE12NB4UW × 1**


■ **Cooling Characteristics**

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

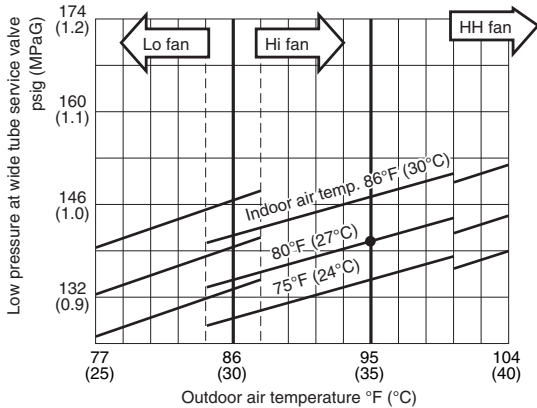

(2) Operating current performance chart

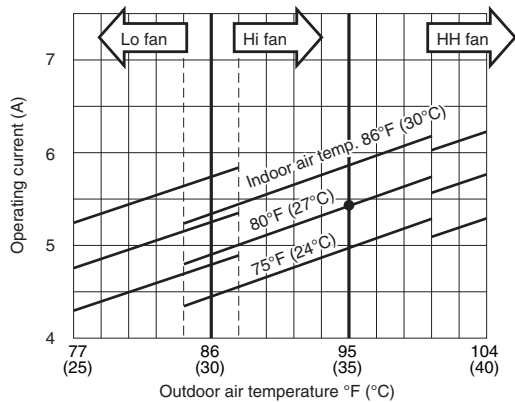


(3) Indoor discharge air performance chart

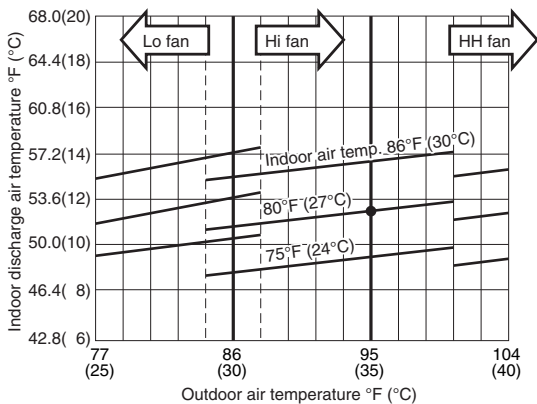


■ **Heating Characteristics**

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

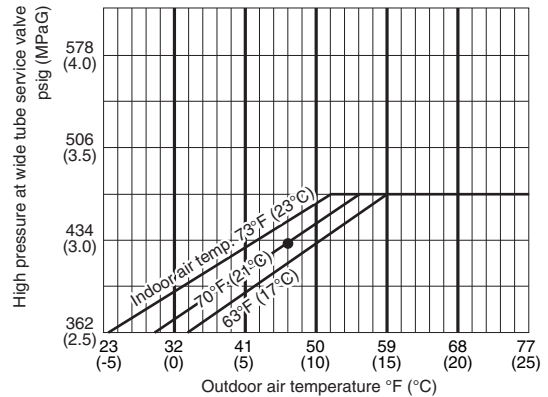

(2) Operating current performance chart

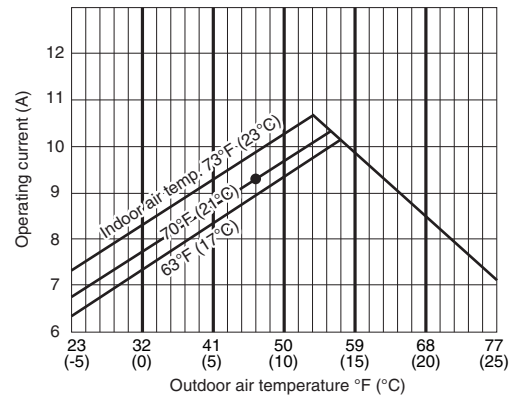

(3) Indoor discharge air performance chart

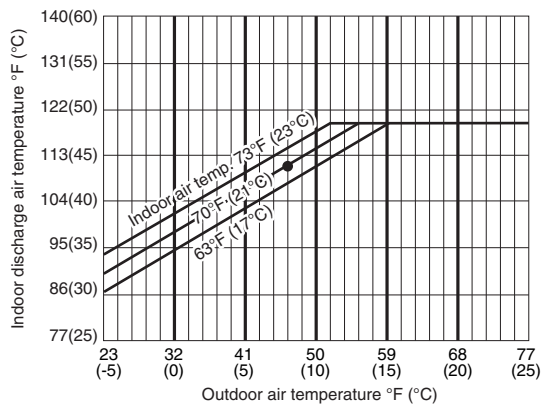

**NOTE**

- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.


## 5-1-2. Temperature Charts (CU-4KE24NBU)

Outdoor Unit **CU-4KE24NBU** Indoor Unit **CS-MKE7NKU × 1**


### ■ Cooling Characteristics

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

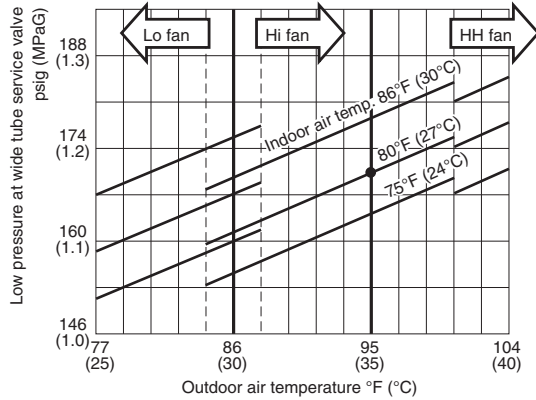

(2) Operating current performance chart

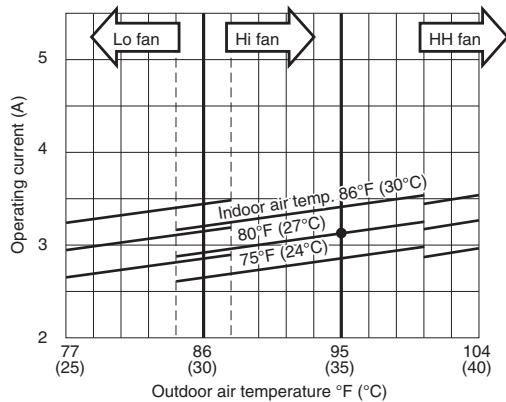


(3) Indoor discharge air performance chart

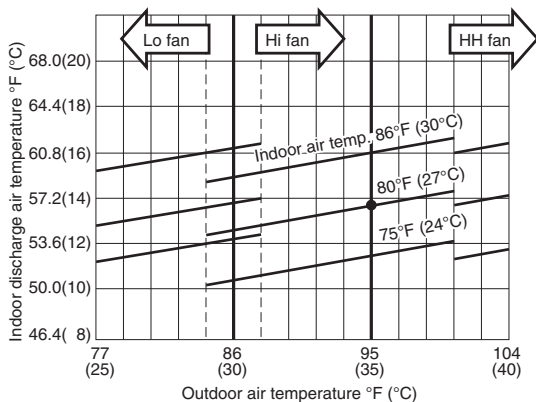


### ■ Heating Characteristics

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

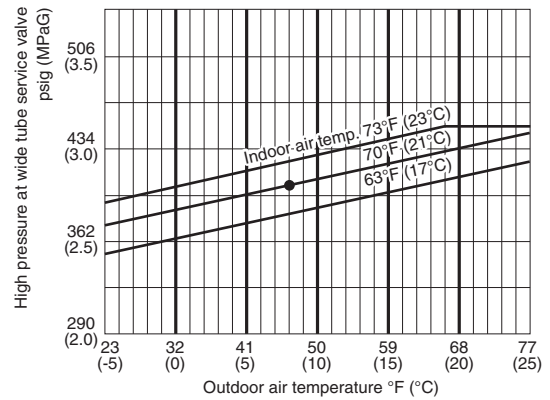

(2) Operating current performance chart

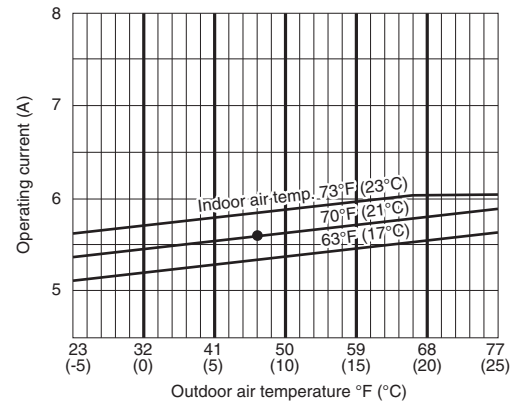

(3) Indoor discharge air performance chart

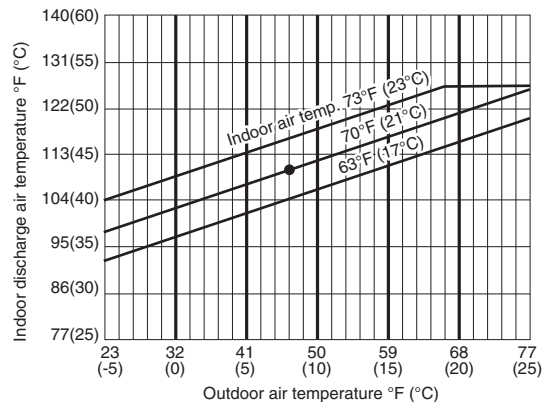

### NOTE


- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6t (7.5m). If the tubing length is different, the performance chart will vary.

Outdoor Unit **CU-4KE24NBU** Indoor Unit **CS-MKE9NKU × 1**


■ Cooling Characteristics

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

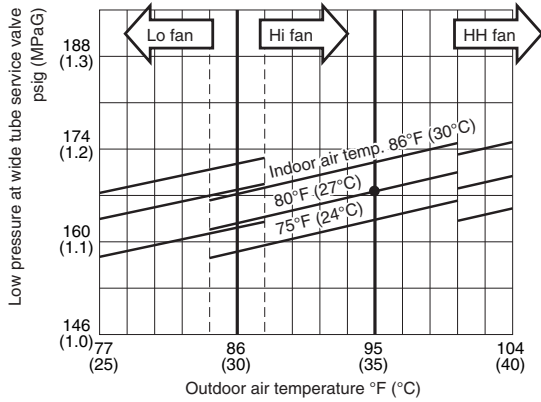

(2) Operating current performance chart

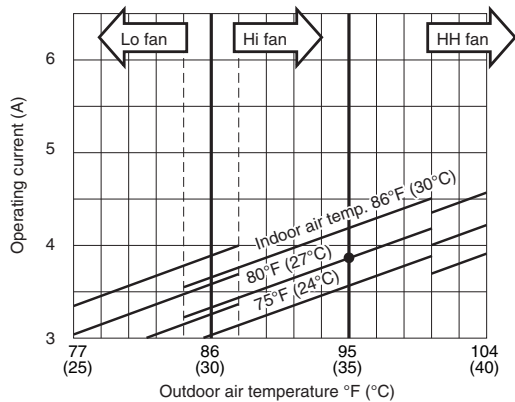


(3) Indoor discharge air performance chart

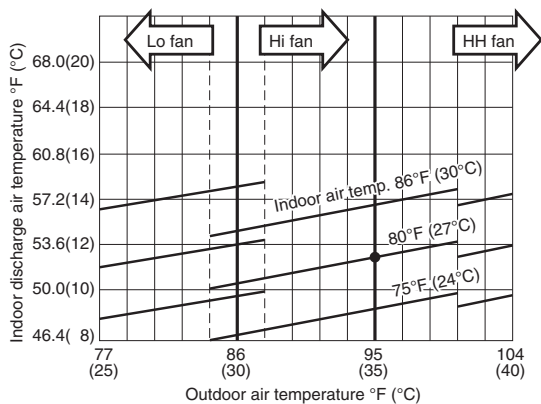


■ Heating Characteristics

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

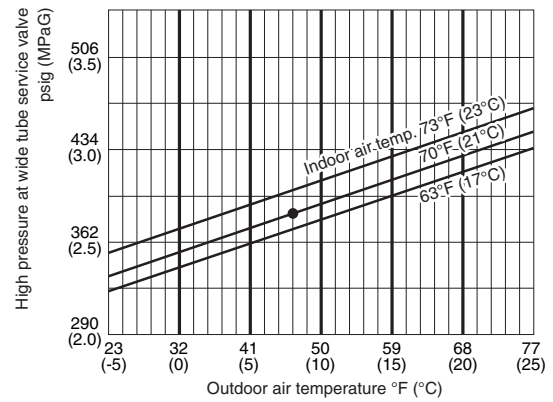

(2) Operating current performance chart

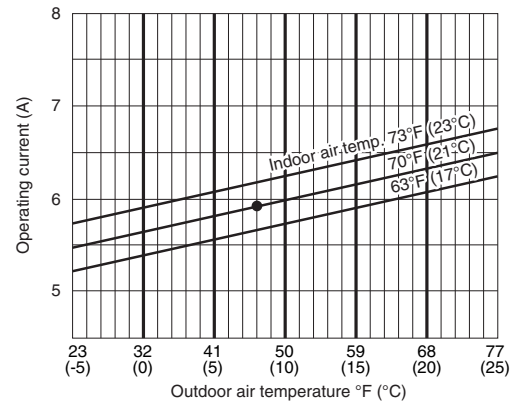

(3) Indoor discharge air performance chart

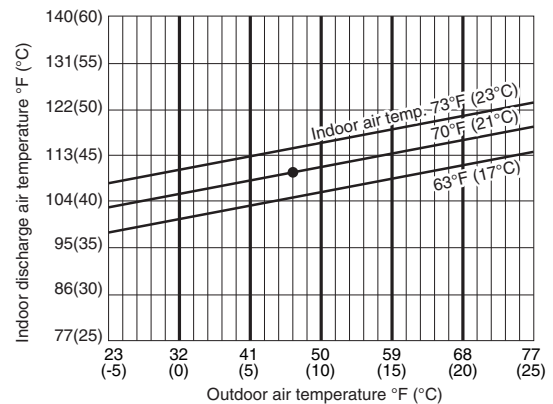

**NOTE**


- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.

Outdoor Unit **CU-4KE24NBU** Indoor Unit **CS-MKE12NKU × 1**


■ Cooling Characteristics

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

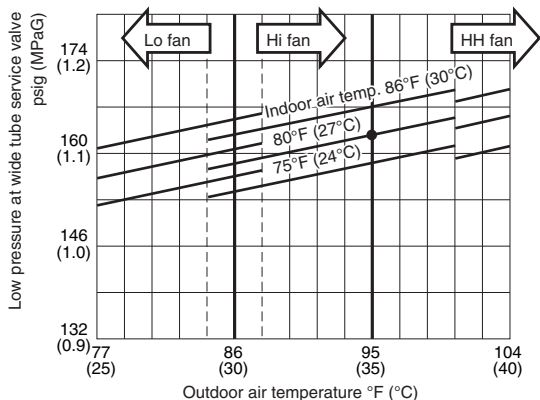

(2) Operating current performance chart

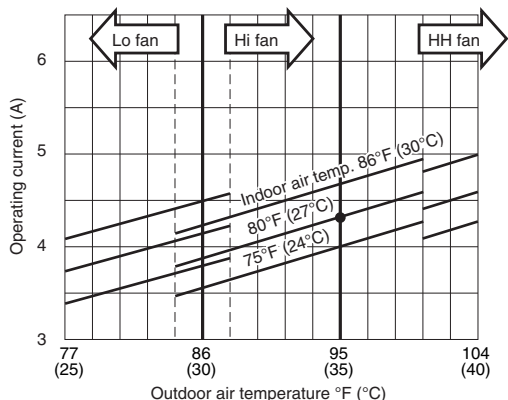


(3) Indoor discharge air performance chart

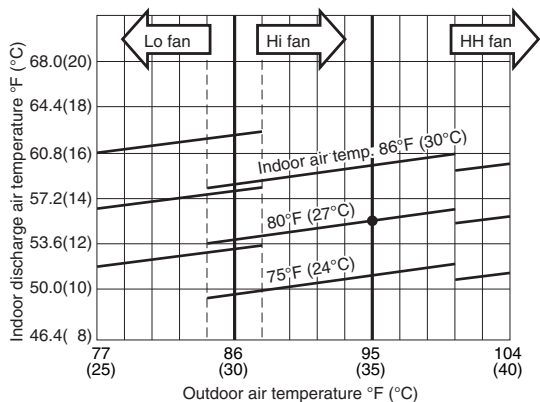


■ Heating Characteristics

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

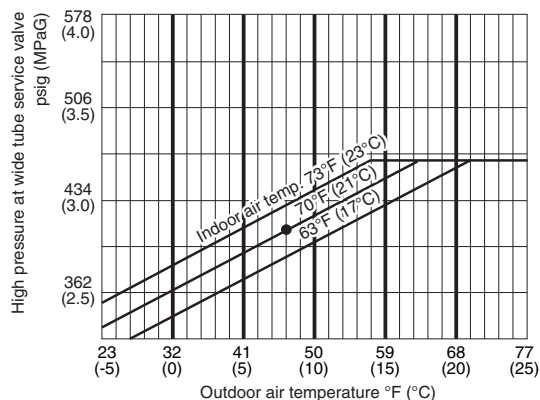

(2) Operating current performance chart

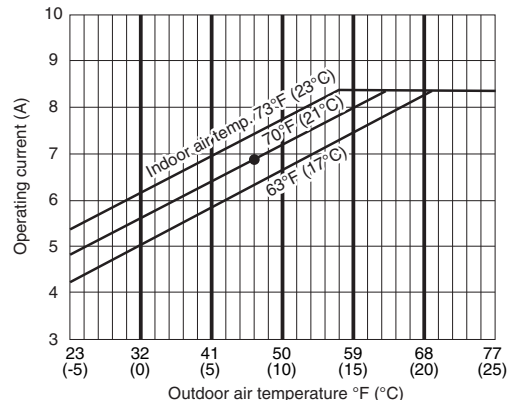

(3) Indoor discharge air performance chart

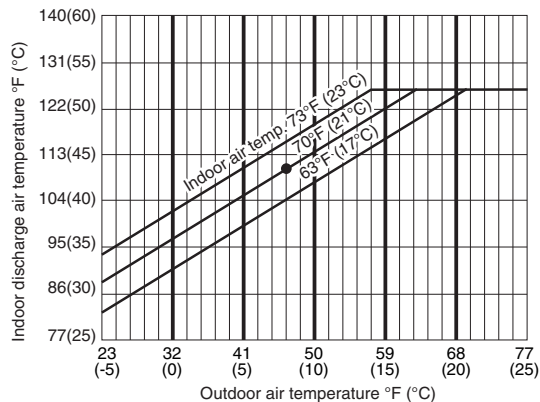

**NOTE**


- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.

Outdoor Unit **CU-4KE24NBU** Indoor Unit **CS-MKE18NKU × 1**


■ **Cooling Characteristics**

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

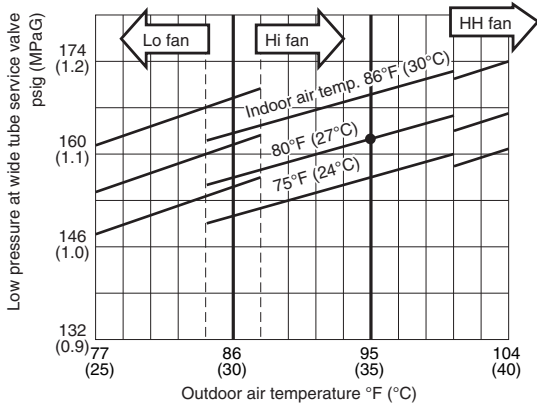

(2) Operating current performance chart

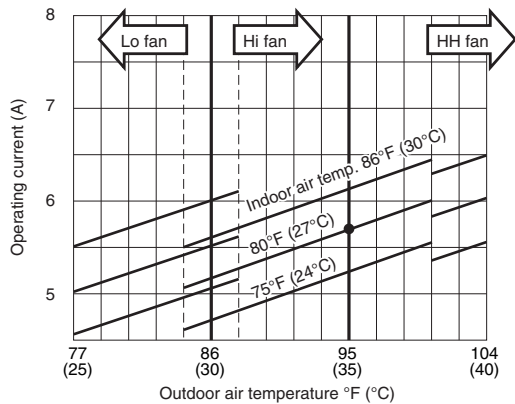

(3) Indoor discharge air performance chart

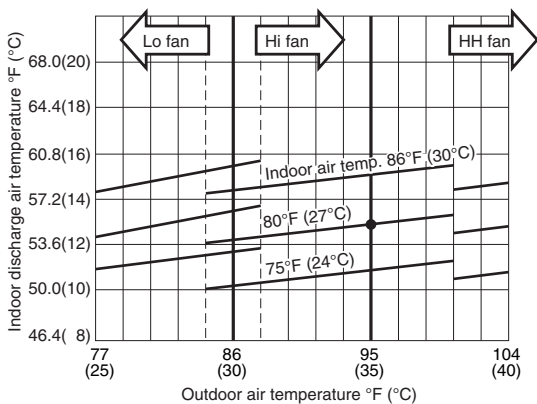


**NOTE**

- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.


■ **Heating Characteristics**

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

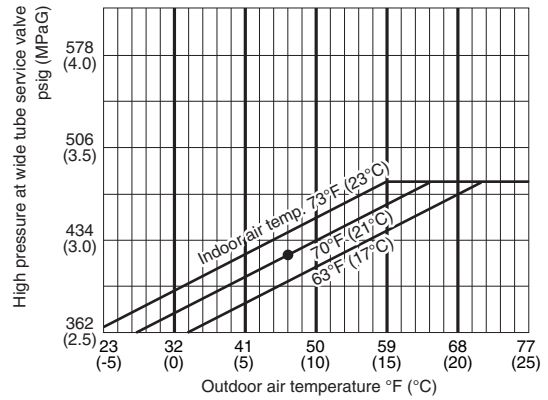

(2) Operating current performance chart

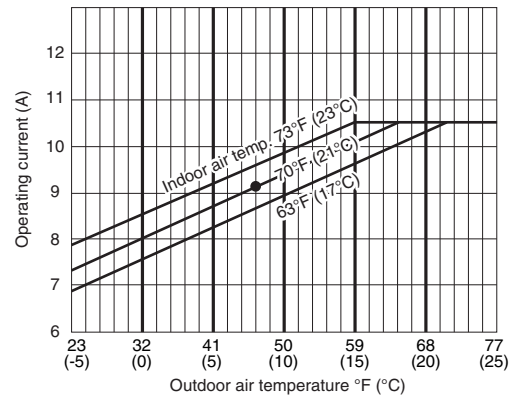

(3) Indoor discharge air performance chart

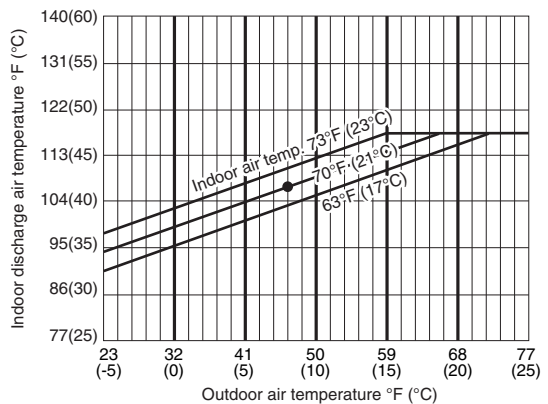


Outdoor Unit **CU-4KE24NBU** Indoor Unit **CS-MKE24NKU × 1**


■ Cooling Characteristics

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

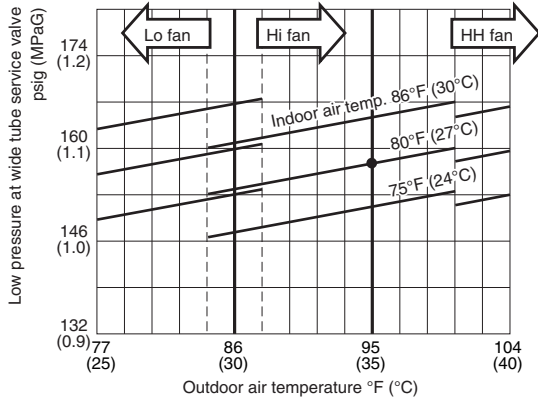

(2) Operating current performance chart

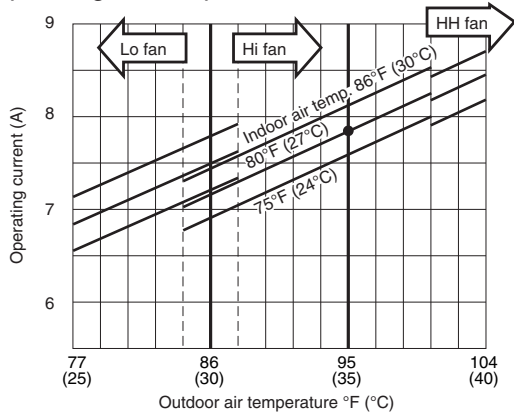


(3) Indoor discharge air performance chart

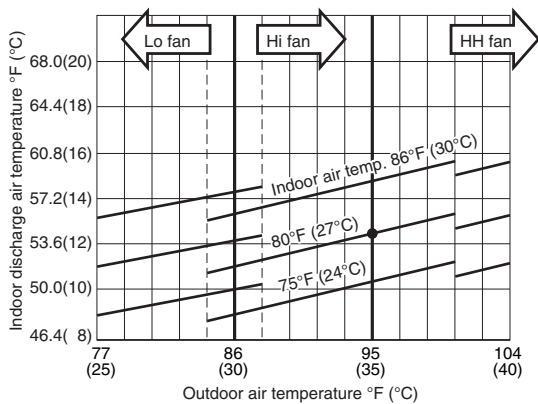


■ Heating Characteristics

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

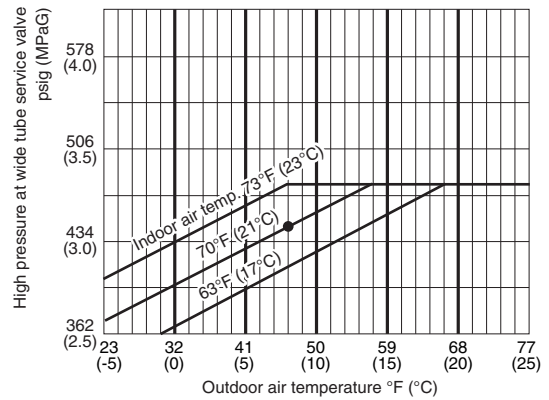

(2) Operating current performance chart

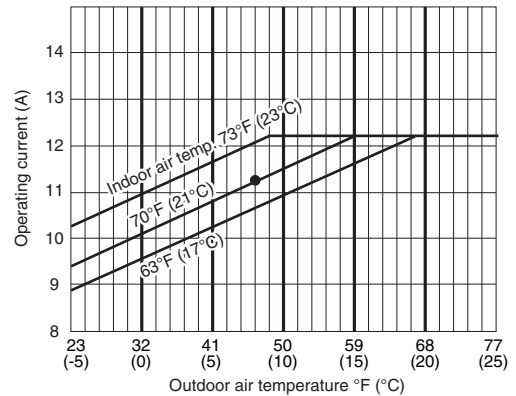

(3) Indoor discharge air performance chart

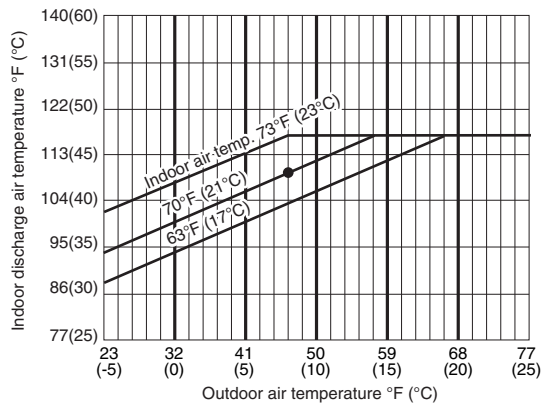

**NOTE**


- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.

Outdoor Unit **CU-4KE24NBU** Indoor Unit **CS-MKE9NB4U x 1**


■ **Cooling Characteristics**

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

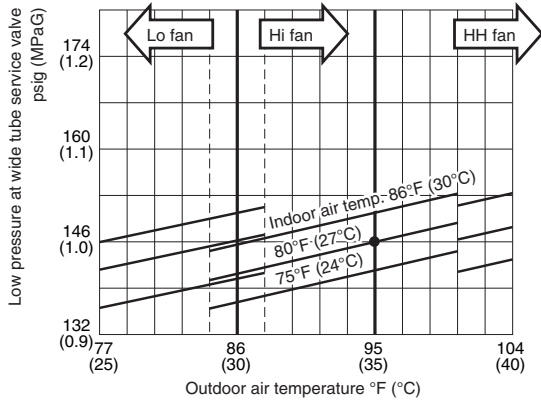

(2) Operating current performance chart

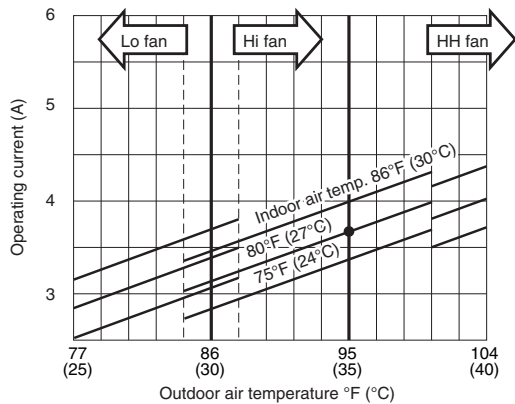


(3) Indoor discharge air performance chart

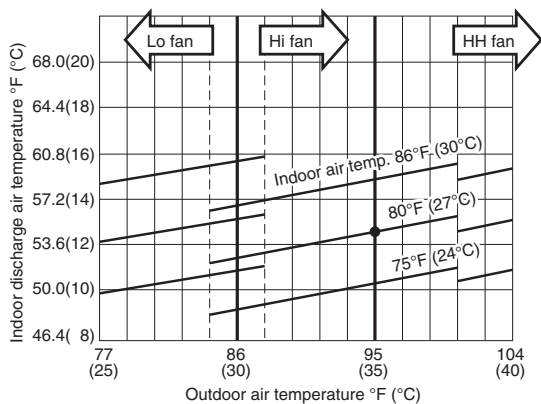


■ **Heating Characteristics**

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

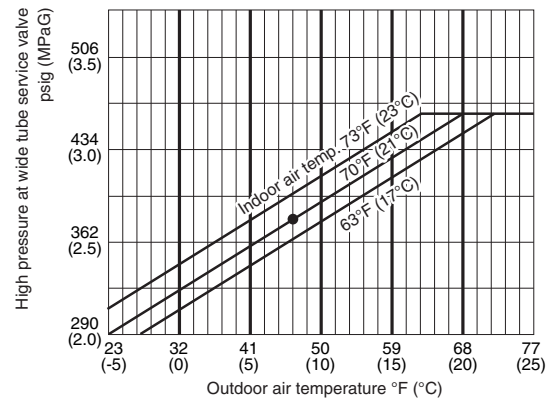

(2) Operating current performance chart

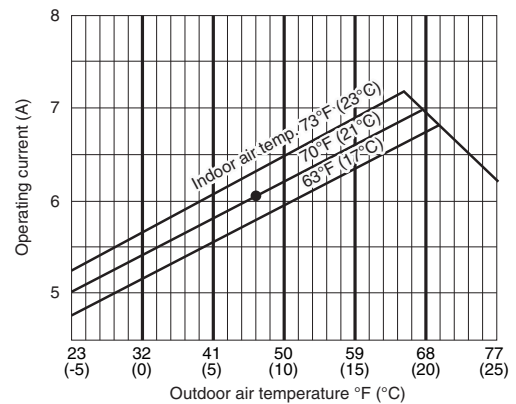

(3) Indoor discharge air performance chart

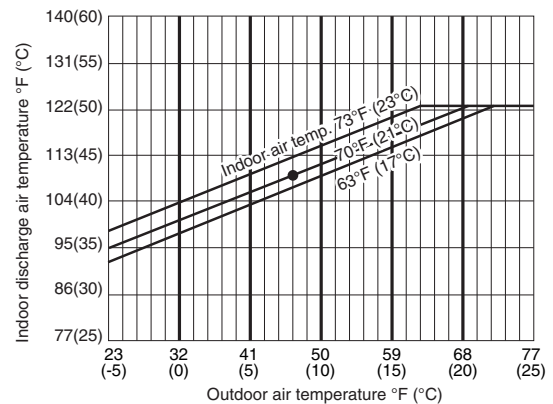

**NOTE**


- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.

Outdoor Unit **CU-4KE24NBU** Indoor Unit **CS-MKE12NB4U × 1**


■ **Cooling Characteristics**

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

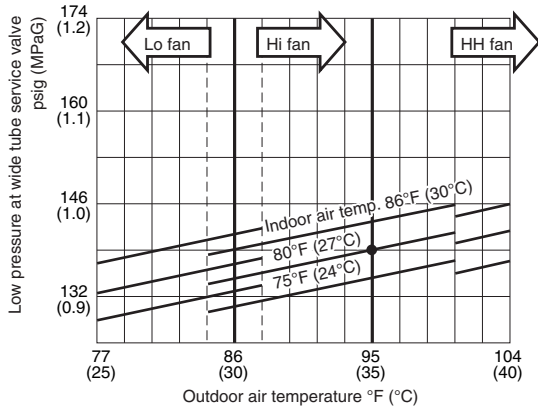

(2) Operating current performance chart

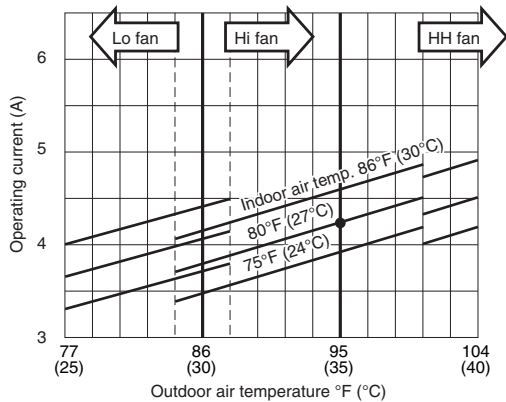


(3) Indoor discharge air performance chart

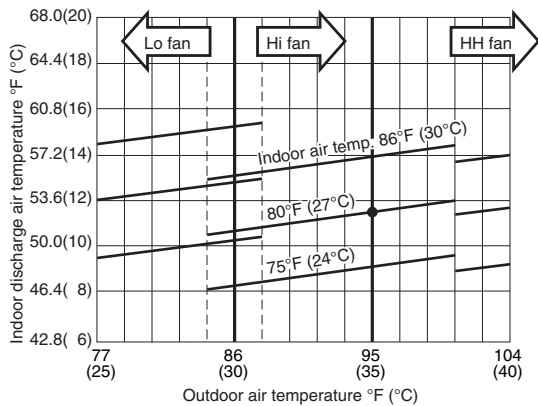


■ **Heating Characteristics**

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

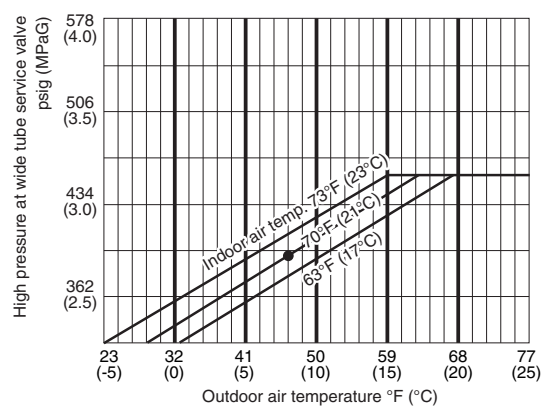

(2) Operating current performance chart

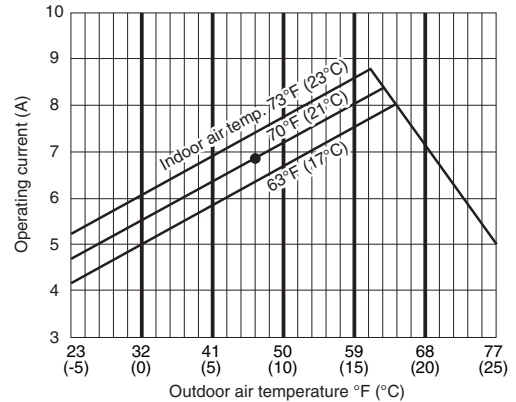

(3) Indoor discharge air performance chart

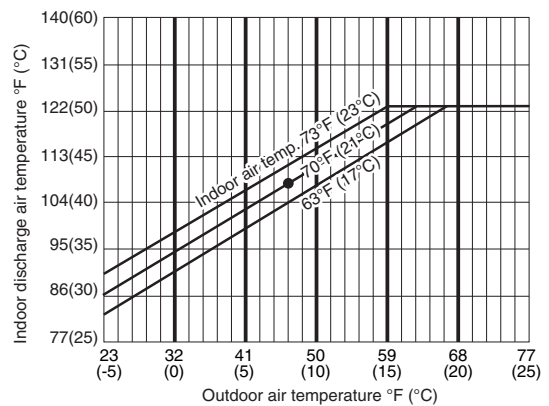

**NOTE**


- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.

Outdoor Unit **CU-4KE24NBU** Indoor Unit **CS-KE12NB4UW × 1**


■ **Cooling Characteristics**

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

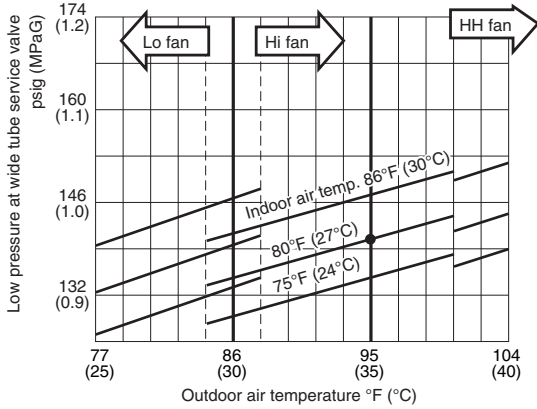

(2) Operating current performance chart

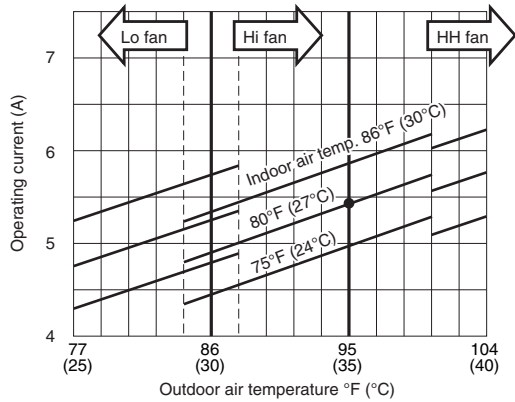


(3) Indoor discharge air performance chart

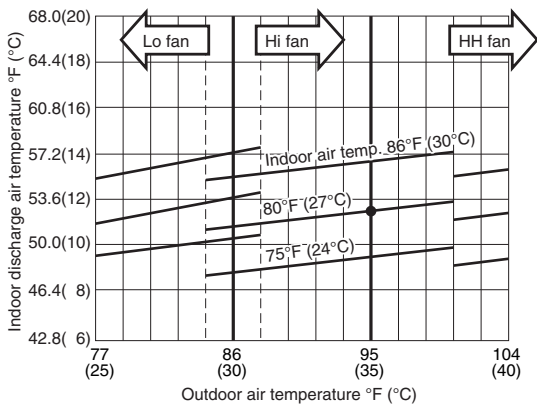


■ **Heating Characteristics**

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

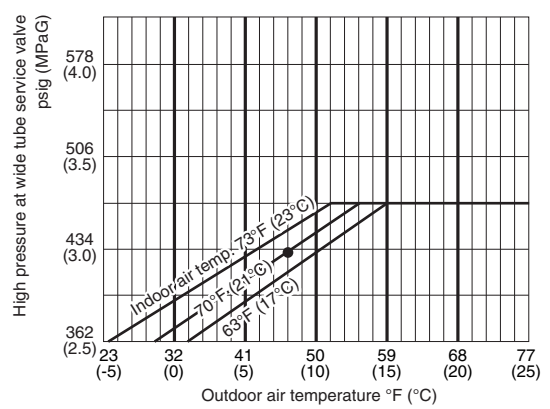

(2) Operating current performance chart

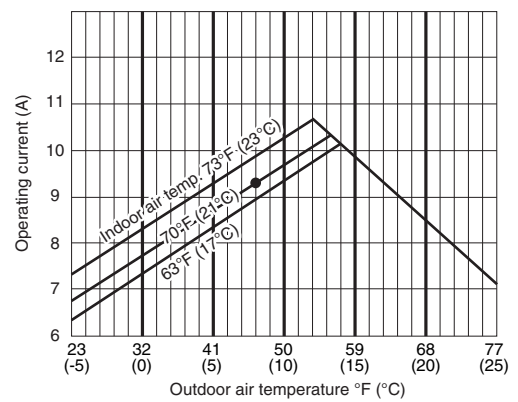

(3) Indoor discharge air performance chart

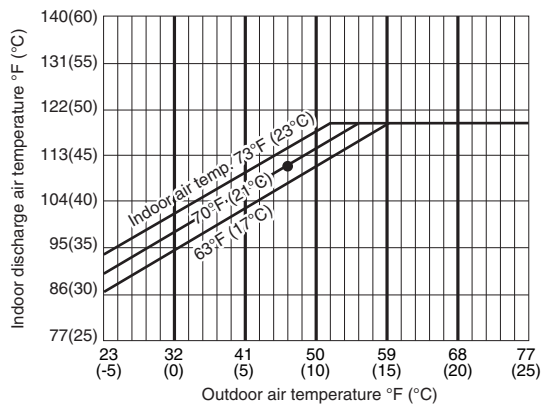

**NOTE**

- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.


### 5-1-3. Temperature Charts (CU-4KE31NBU)

Outdoor Unit **CU-4KE31NBU** Indoor Unit **CS-MKE7NKU × 1**


#### ■ Cooling Characteristics

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

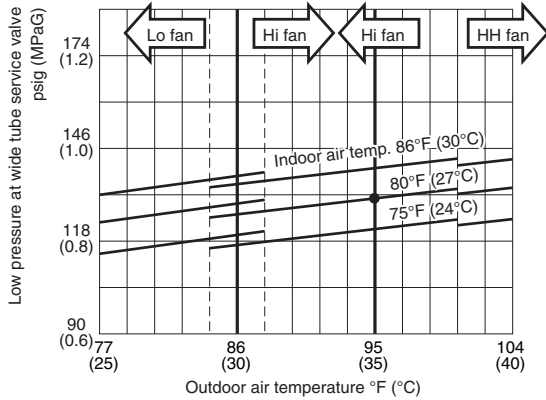

(2) Operating current performance chart

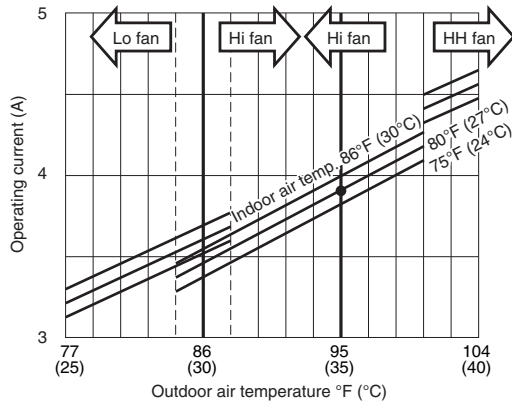


(3) Indoor discharge air performance chart

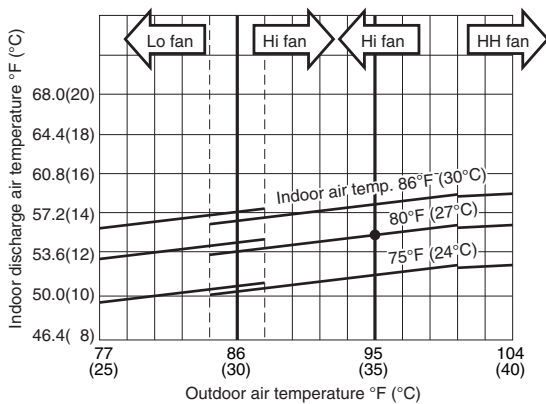


#### ■ Heating Characteristics

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

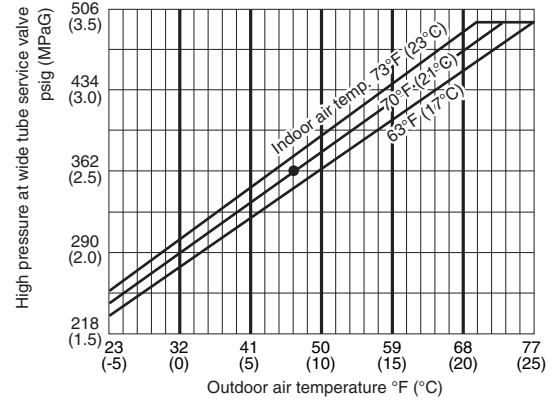

(2) Operating current performance chart

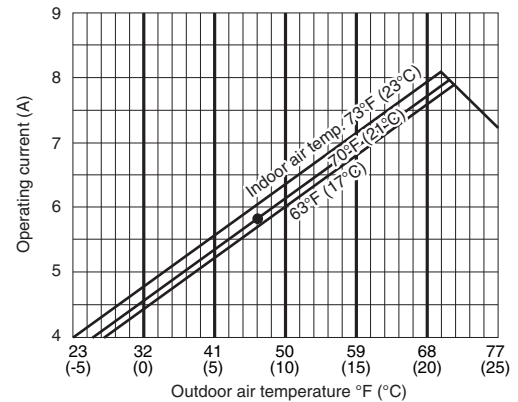

(3) Indoor discharge air performance chart

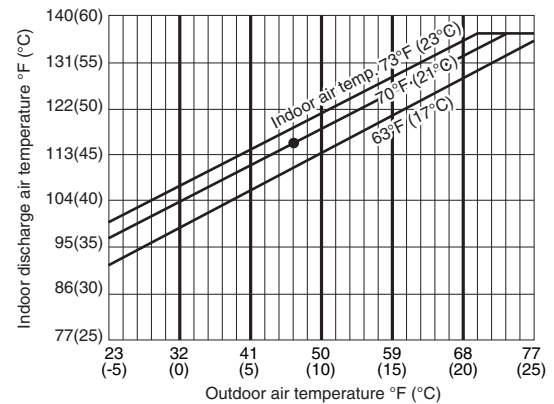

#### NOTE


- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.

Outdoor Unit **CU-4KE31NBU** Indoor Unit **CS-MKE9NKU × 1**


■ Cooling Characteristics

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

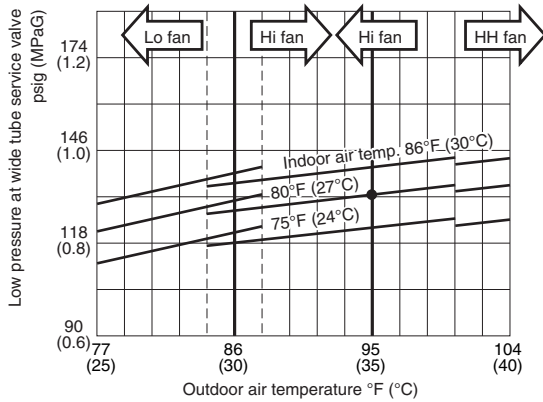

(2) Operating current performance chart

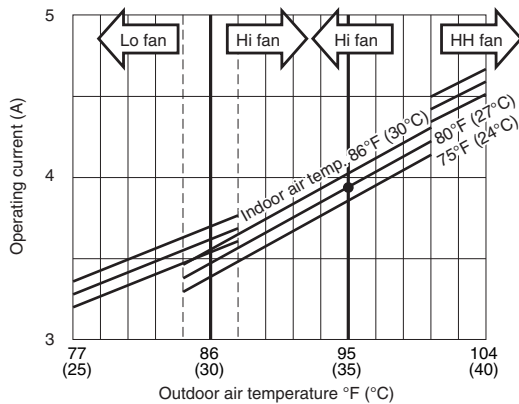


(3) Indoor discharge air performance chart

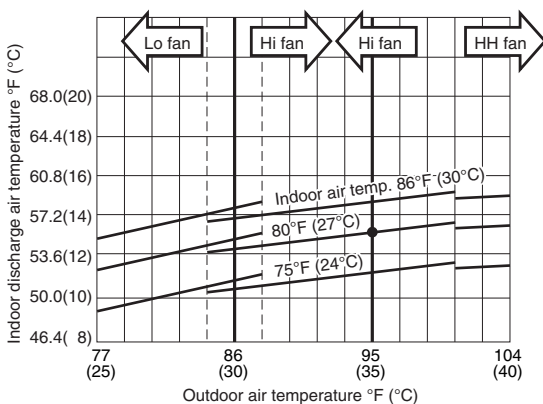


■ Heating Characteristics

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

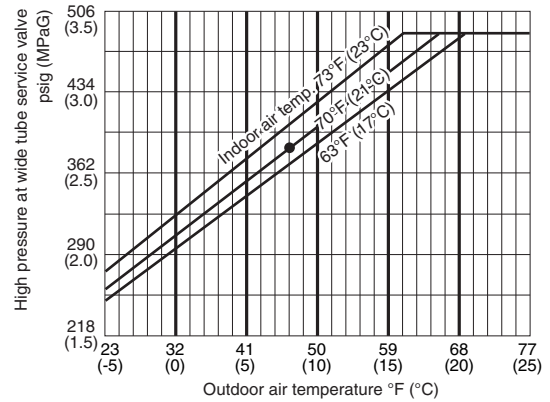

(2) Operating current performance chart

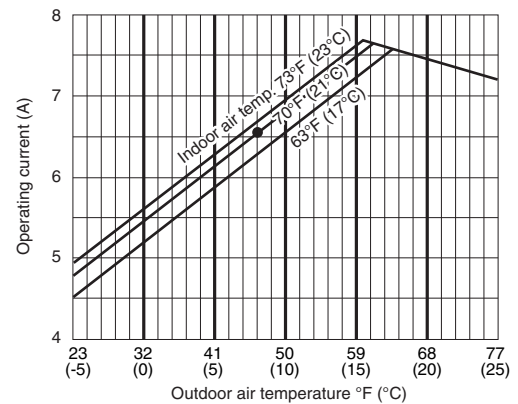

(3) Indoor discharge air performance chart

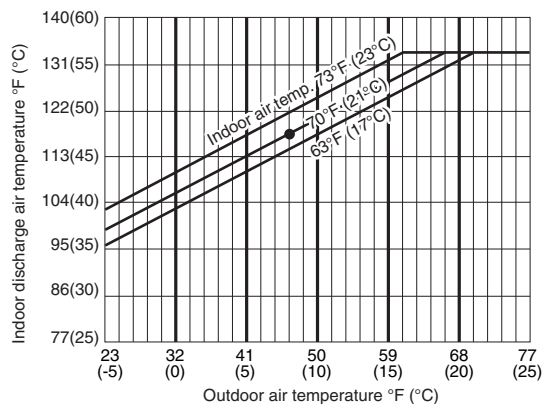

**NOTE**


- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.

Outdoor Unit **CU-4KE31NBU** Indoor Unit **CS-MKE12NKU × 1**


■ Cooling Characteristics

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

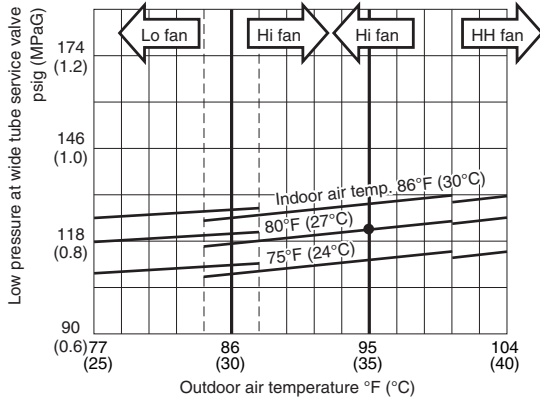

(2) Operating current performance chart

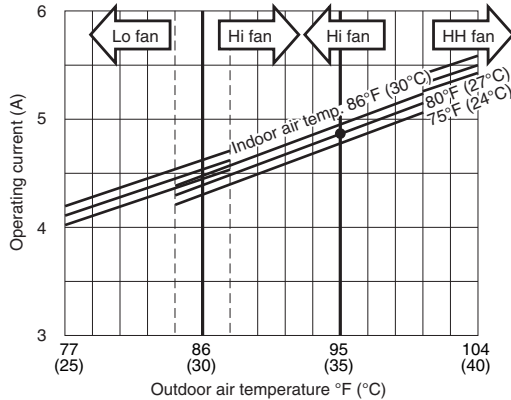


(3) Indoor discharge air performance chart

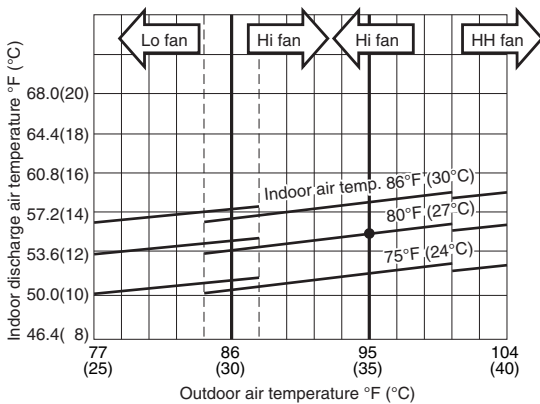


■ Heating Characteristics

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

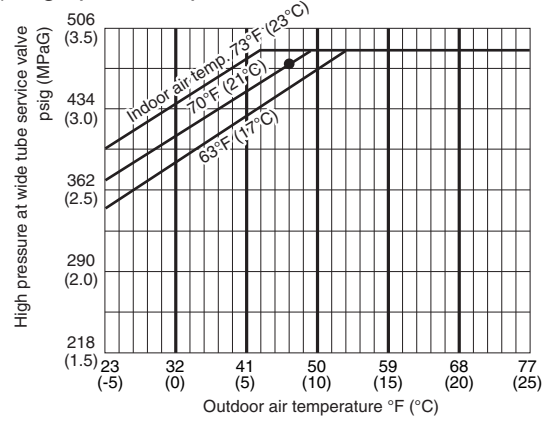

(2) Operating current performance chart

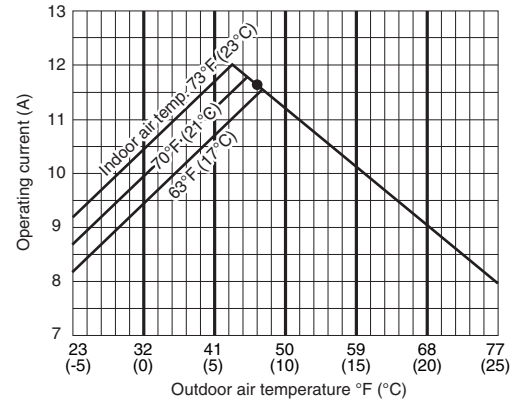

(3) Indoor discharge air performance chart

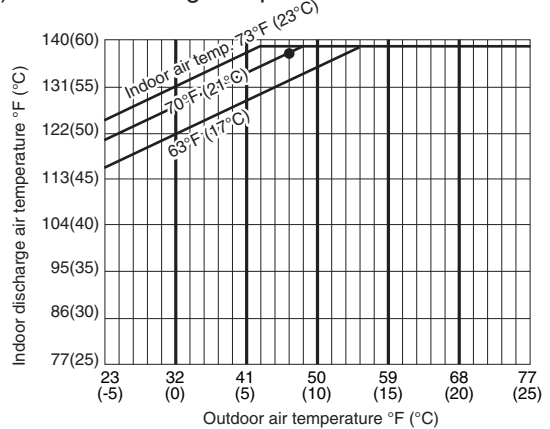

**NOTE**


- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.

Outdoor Unit **CU-4KE31NBU** Indoor Unit **CS-MKE18NKU × 1**


■ Cooling Characteristics

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

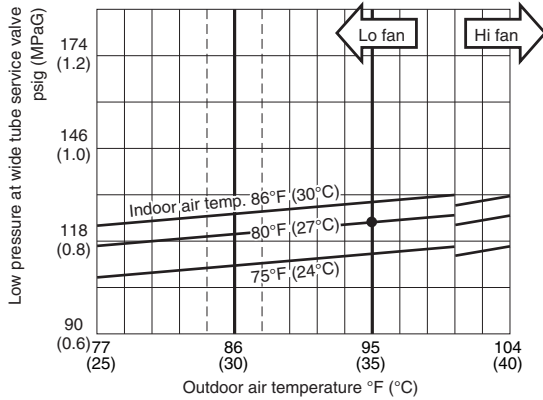

(2) Operating current performance chart

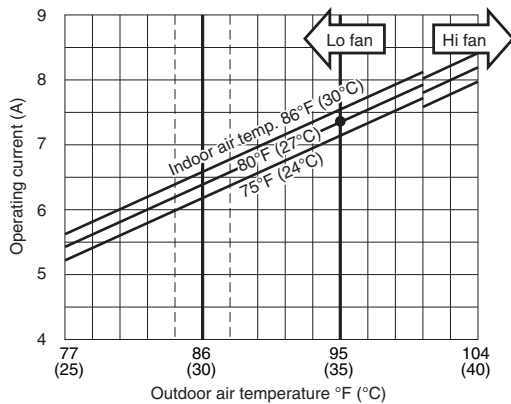


(3) Indoor discharge air performance chart

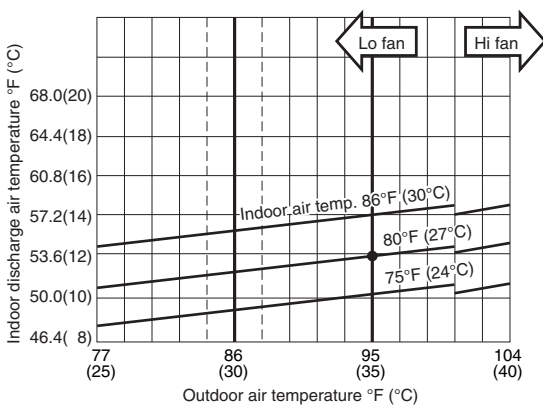


■ Heating Characteristics

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

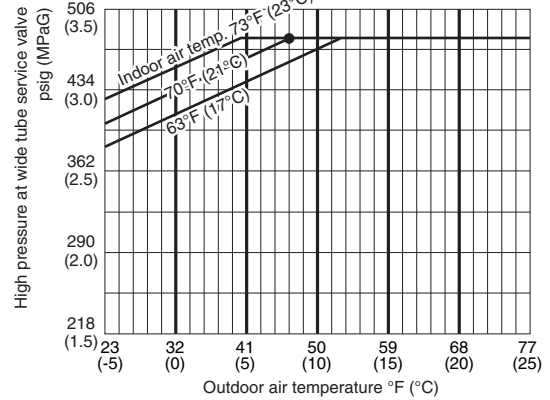

(2) Operating current performance chart

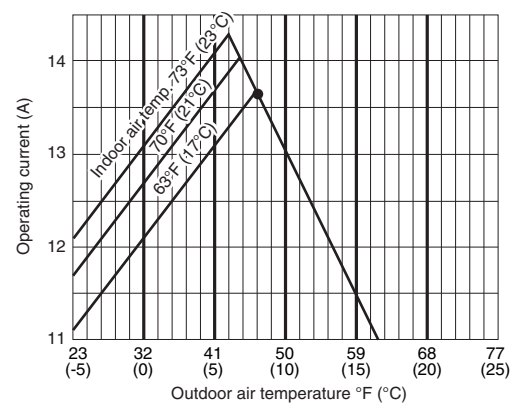

(3) Indoor discharge air performance chart

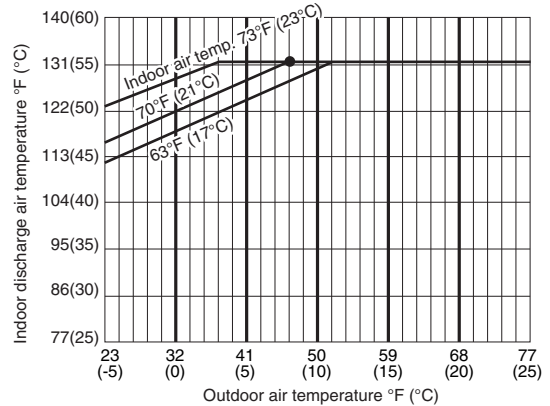

**NOTE**


- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.

Outdoor Unit **CU-4KE31NBU** Indoor Unit **CS-MKE24NKU × 1**


■ Cooling Characteristics

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

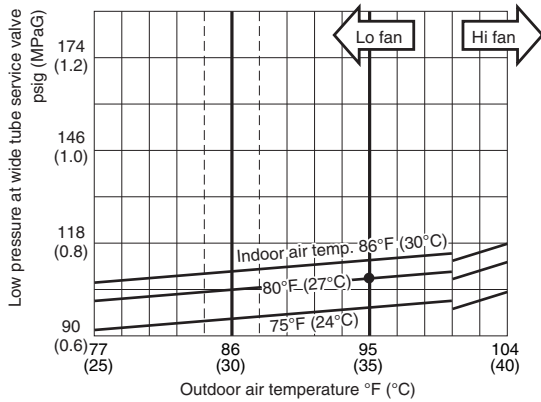

(2) Operating current performance chart

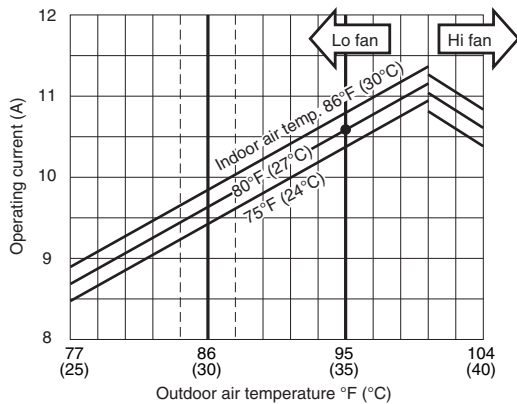


(3) Indoor discharge air performance chart

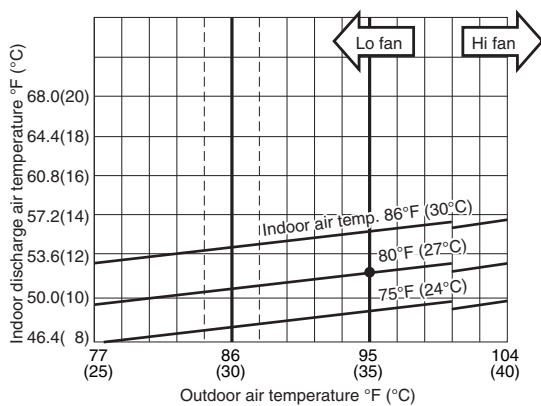


■ Heating Characteristics

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

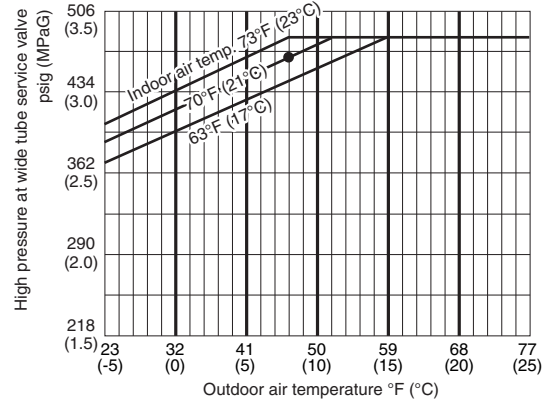

(2) Operating current performance chart

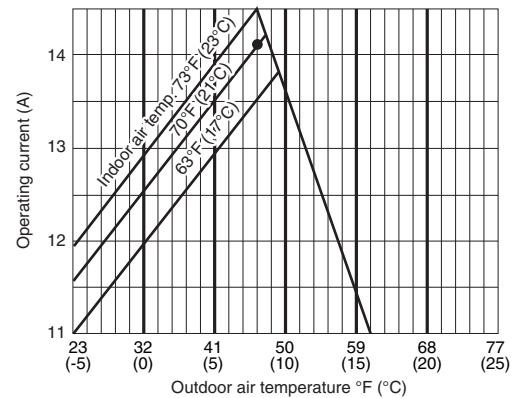

(3) Indoor discharge air performance chart

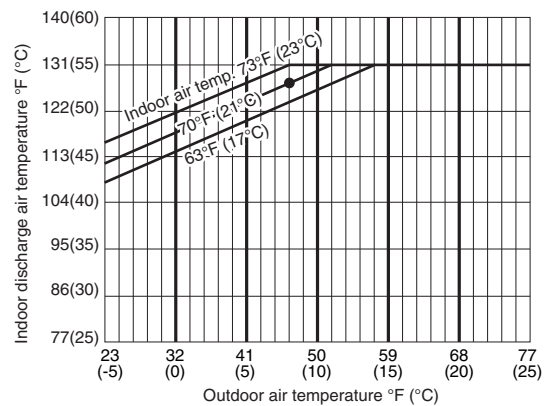

**NOTE**


- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.

Outdoor Unit **CU-4KE31NBU** Indoor Unit **CS-MKE9NB4U × 1**


■ Cooling Characteristics

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

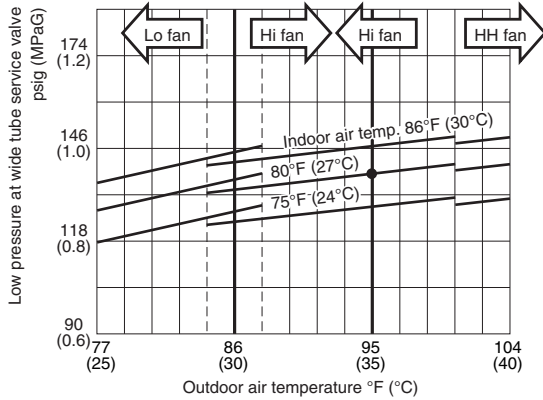

(2) Operating current performance chart

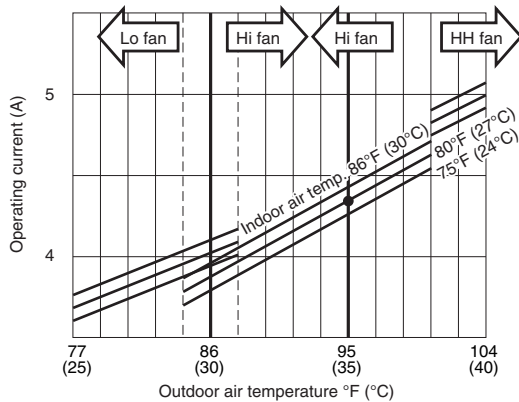


(3) Indoor discharge air performance chart

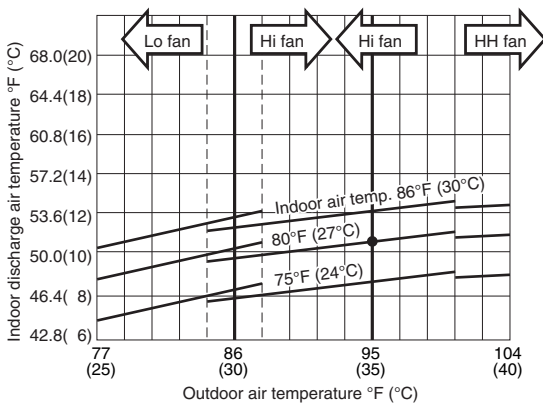


■ Heating Characteristics

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

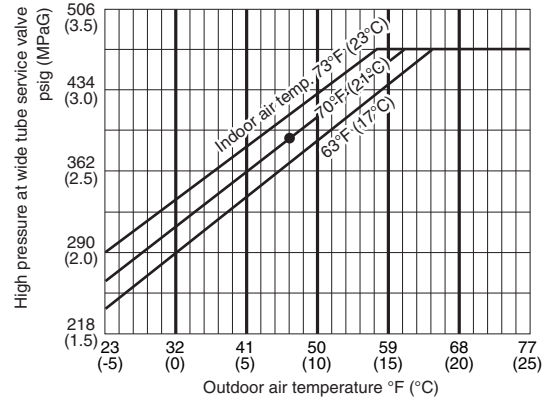

(2) Operating current performance chart

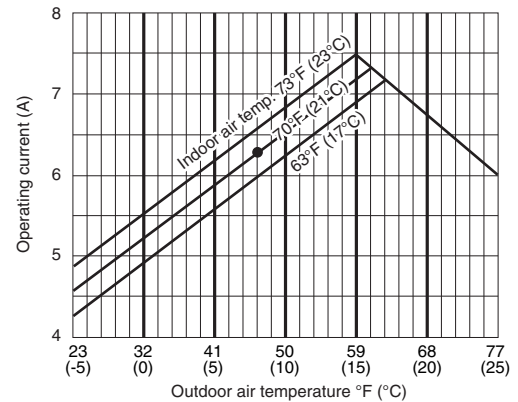

(3) Indoor discharge air performance chart

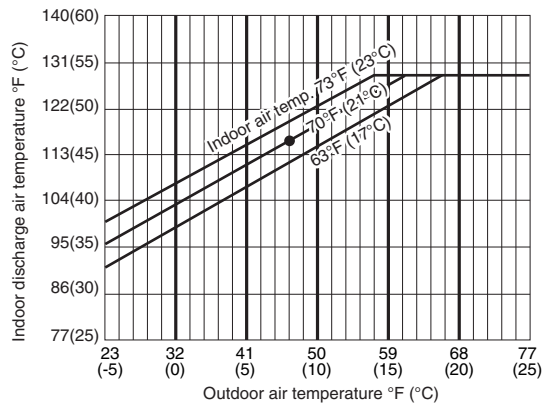

**NOTE**


- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.

Outdoor Unit **CU-4KE31NBU** Indoor Unit **CS-MKE12NB4U × 1**


■ Cooling Characteristics

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

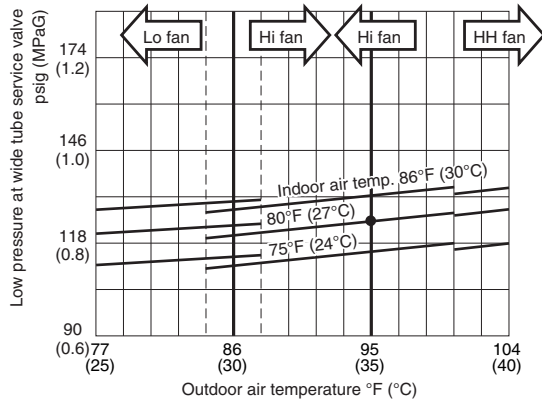

(2) Operating current performance chart

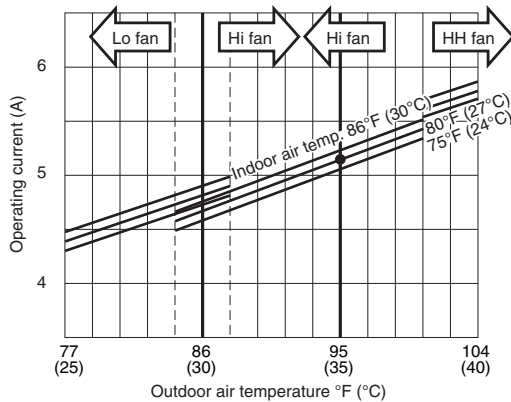

(3) Indoor discharge air performance chart

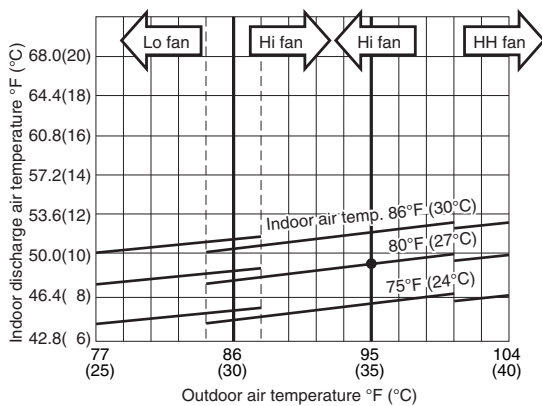


**NOTE**

- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.


■ Heating Characteristics

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

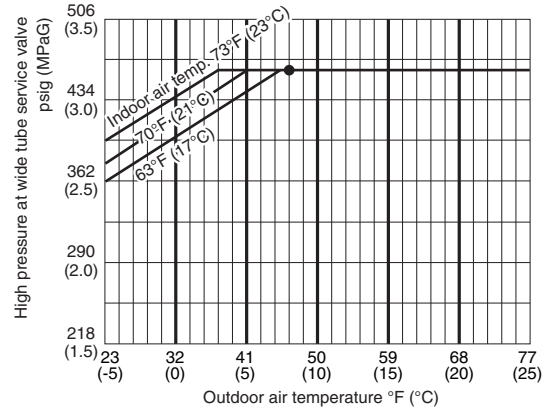

(2) Operating current performance chart

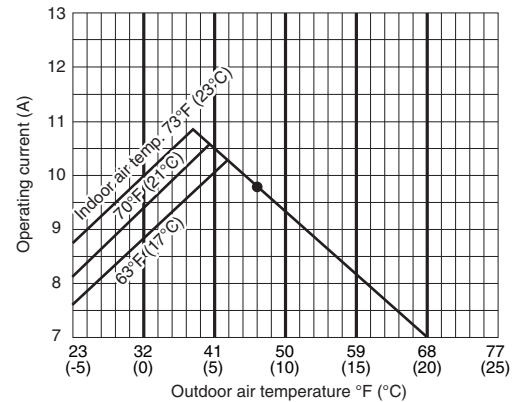

(3) Indoor discharge air performance chart

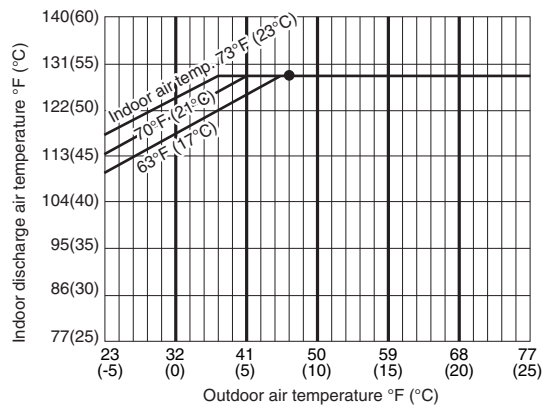


Outdoor Unit **CU-4KE31NBU** Indoor Unit **CS-KE12NB4UW x 1**


■ Cooling Characteristics

(RH : 46%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) Low pressure performance chart

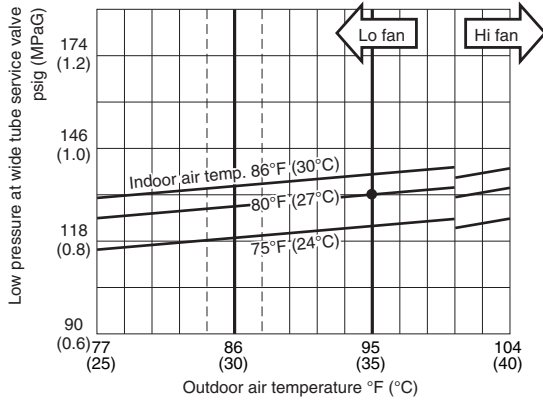

(2) Operating current performance chart

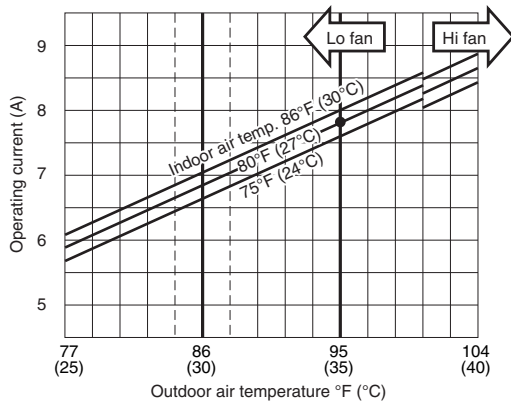


(3) Indoor discharge air performance chart

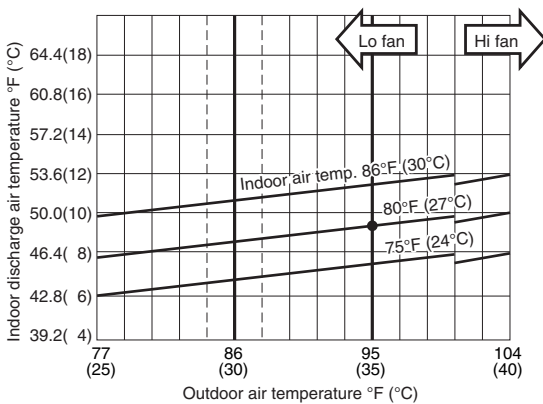


■ Heating Characteristics

(RH : 85%, Indoor fan speed : High fan)  
(230V, 60Hz)


(1) High pressure performance chart

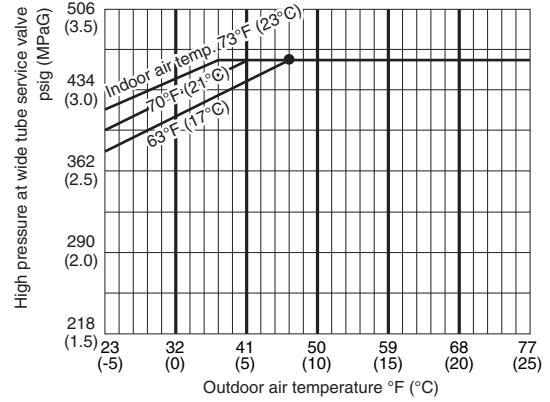

(2) Operating current performance chart

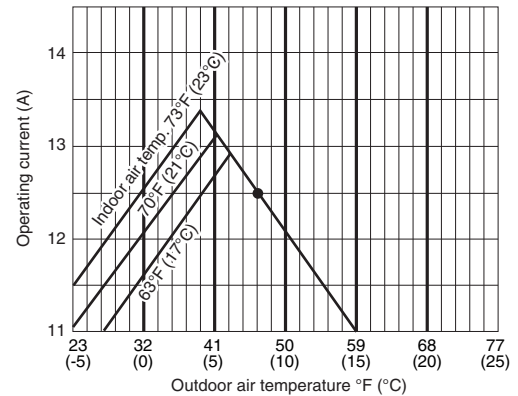

(3) Indoor discharge air performance chart

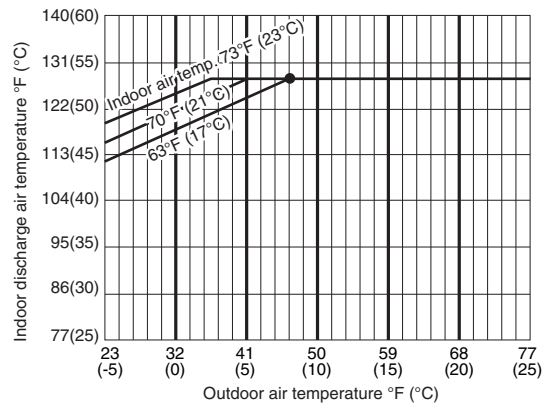

**NOTE**

- This performance chart shows operation of a single wall-mounted indoor unit. The performance chart will vary depending on the indoor unit type.
- Check each performance value in test-run mode. Electrical performance values represent a combined indoor/outdoor value. (In this case, be sure to stop all the indoor units where performance is not being checked.)
- The performance is for a tubing length of 24.6ft (7.5m). If the tubing length is different, the performance chart will vary.

## 5-2. Cooling Capacity

Outdoor Unit : **CU-3KE19NBU**

Indoor Unit : **CS-MKE9NKU × 3**

Power Supply : 230V Single Phase 60Hz

< Cooling Capacity >

RATING CAPACITY:		18,600 BTU/h		AIR FLOW RATE:		777 CFM		
INDOOR		OUTDOOR						
ENT. TEMP. °F (°C)		AMBIENT TEMP. °F (°C)						
WB	DB		65 (18.3)	75 (23.9)	85 (29.4)	95 (35.0)	105 (40.6)	115 (46.1)
59 (15.0)		TC	18,680	18,040	17,350	16,800	15,990	15,120
	72 (22.2)	SHC	16,090	15,780	15,480	15,180	14,880	14,580
	76 (24.4)	SHC	18,680	18,040	17,350	16,800	15,990	15,120
	80 (26.7)	SHC	18,680	18,040	17,350	16,800	15,990	15,120
	84 (28.9)	SHC	18,680	18,040	17,350	16,800	15,990	15,120
	88 (31.1)	SHC	18,680	18,040	17,350	16,800	15,990	15,120
63 (17.2)		TC	19,590	18,930	18,220	17,690	16,850	15,940
	72 (22.2)	SHC	13,070	12,920	12,620	12,310	12,010	11,710
	76 (24.4)	SHC	15,780	15,480	15,180	15,030	14,730	14,280
	80 (26.7)	SHC	18,650	18,350	18,050	17,690	16,850	15,940
	84 (28.9)	SHC	19,590	18,930	18,220	17,690	16,850	15,940
	88 (31.1)	SHC	19,590	18,930	18,220	17,690	16,850	15,940
67 (19.4)		TC	20,510	19,840	19,110	# 18,600	17,730	16,790
	72 (22.2)	SHC	10,200	9,900	9,600	9,450	9,150	8,690
	76 (24.4)	SHC	12,770	12,620	12,310	12,160	11,710	11,410
	80 (26.7)	SHC	15,630	15,330	15,030	14,880	14,580	14,280
	84 (28.9)	SHC	18,350	18,050	17,750	17,600	17,290	16,790
	88 (31.1)	SHC	20,510	19,840	19,110	18,600	17,730	16,790
71 (21.7)		TC	21,440	20,750	20,010	19,530	18,630	17,660
	72 (22.2)	SHC	7,030	6,730	6,430	6,280	5,980	5,680
	76 (24.4)	SHC	9,600	9,450	9,150	9,000	8,690	8,390
	80 (26.7)	SHC	12,470	12,160	12,010	11,860	11,560	11,110
	84 (28.9)	SHC	15,180	14,880	14,580	14,430	14,130	13,820
	88 (31.1)	SHC	17,750	17,600	17,290	17,140	16,840	16,540
75 (23.9)		TC	22,250	21,560	20,810	20,360	19,450	18,450
	76 (24.4)	SHC	6,580	6,430	6,130	5,980	5,680	5,370
	80 (26.7)	SHC	9,450	9,150	9,000	8,840	8,540	8,240
	84 (28.9)	SHC	12,010	11,860	11,560	11,410	11,260	10,960
	88 (31.1)	SHC	14,730	14,580	14,280	14,130	13,820	13,520

TC : Total Cooling Capacity (BTU/h) SHC : Sensible Heat Capacity (BTU/h)

### NOTE

- Rating conditions (#) : Indoor Unit Entering Air Temp. 80 °F (26.7 °C) DB / 67 °F (19.4 °C) WB  
: Outdoor Ambient Temp. 95 °F (35 °C) DB
- Above data does not take Freeze Prevention Protection during cooling operation into account.  
For this reason, the value may vary from the actual cooling characteristics.
- Above data represents the value when the operation frequency of a compressor is fixed.

Outdoor Unit : **CU-3KE19NBU**  
 Indoor Unit : **CS-MKE12NB4U × 3**  
 Power Supply : 230V Single Phase 60Hz

< Cooling Capacity >

RATING CAPACITY:		17,400 BTU/h		AIR FLOW RATE:		706 CFM		
INDOOR		OUTDOOR						
ENT. TEMP. °F (°C)		AMBIENT TEMP. °F (°C)						
WB	DB		65 (18.3)	75 (23.9)	85 (29.4)	95 (35.0)	105 (40.6)	115 (46.1)
59 (15.0)		TC	17,460	16,880	16,260	15,760	15,020	14,220
	72 (22.2)	SHC	15,450	15,180	14,900	14,630	14,350	13,940
	76 (24.4)	SHC	17,460	16,880	16,260	15,760	15,020	14,220
	80 (26.7)	SHC	17,460	16,880	16,260	15,760	15,020	14,220
	84 (28.9)	SHC	17,460	16,880	16,260	15,760	15,020	14,220
	88 (31.1)	SHC	17,460	16,880	16,260	15,760	15,020	14,220
63 (17.2)		TC	18,290	17,700	17,060	16,570	15,810	14,980
	72 (22.2)	SHC	12,570	12,300	12,020	11,890	11,610	11,200
	76 (24.4)	SHC	15,180	14,900	14,630	14,490	14,080	13,810
	80 (26.7)	SHC	17,920	17,650	17,060	16,570	15,810	14,980
	84 (28.9)	SHC	18,290	17,700	17,060	16,570	15,810	14,980
	88 (31.1)	SHC	18,290	17,700	17,060	16,570	15,810	14,980
67 (19.4)		TC	19,120	18,520	17,870	# 17,400	16,620	15,760
	72 (22.2)	SHC	9,690	9,420	9,140	9,000	8,730	8,460
	76 (24.4)	SHC	12,300	12,020	11,750	11,610	11,340	11,060
	80 (26.7)	SHC	15,040	14,770	14,490	14,350	14,080	13,670
	84 (28.9)	SHC	17,650	17,370	17,100	16,960	16,620	15,760
	88 (31.1)	SHC	19,120	18,520	17,870	17,400	16,620	15,760
71 (21.7)		TC	19,950	19,350	18,690	18,240	17,440	16,560
	72 (22.2)	SHC	6,540	6,400	6,120	5,990	5,710	5,440
	76 (24.4)	SHC	9,140	9,000	8,730	8,590	8,320	8,040
	80 (26.7)	SHC	11,890	11,750	11,470	11,340	11,060	10,790
	84 (28.9)	SHC	14,490	14,350	14,080	13,940	13,670	13,390
	88 (31.1)	SHC	17,100	16,960	16,690	16,550	16,270	16,000
75 (23.9)		TC	20,670	20,070	19,400	18,990	18,180	17,290
	76 (24.4)	SHC	6,260	5,990	5,850	5,710	5,440	5,160
	80 (26.7)	SHC	9,000	8,730	8,590	8,460	8,180	7,910
	84 (28.9)	SHC	11,610	11,340	11,200	11,060	10,790	10,510
	88 (31.1)	SHC	14,220	13,940	13,810	13,670	13,390	13,120

TC : Total Cooling Capacity (BTU/h) SHC : Sensible Heat Capacity (BTU/h)

**NOTE**

- Rating conditions (#) : Indoor Unit Entering Air Temp. 80 °F (26.7 °C) DB / 67 °F (19.4 °C) WB  
 : Outdoor Ambient Temp. 95 °F (35 °C) DB
- Above data does not take Freeze Prevention Protection during cooling operation into account.  
 For this reason, the value may vary from the actual cooling characteristics.
- Above data represents the value when the operation frequency of a compressor is fixed.

Outdoor Unit : **CU-4KE24NBU**  
 Indoor Unit : **CS-MKE9NKU × 3**  
 Power Supply : 230V Single Phase 60Hz

< Cooling Capacity >

RATING CAPACITY:		23,200 BTU/h		AIR FLOW RATE:		777 CFM		
INDOOR		OUTDOOR						
ENT. TEMP. °F (°C)		AMBIENT TEMP. °F (°C)						
WB	DB		65 (18.3)	75 (23.9)	85 (29.4)	95 (35.0)	105 (40.6)	115 (46.1)
59 (15.0)		TC	23,420	22,640	21,790	21,190	20,170	15,430
	72 (22.2)	SHC	18,350	17,900	17,600	17,290	16,840	14,580
	76 (24.4)	SHC	21,070	20,610	20,160	19,860	19,410	15,430
	80 (26.7)	SHC	23,420	22,640	21,790	21,190	20,170	15,430
	84 (28.9)	SHC	23,420	22,640	21,790	21,190	20,170	15,430
	88 (31.1)	SHC	23,420	22,640	21,790	21,190	20,170	15,430
63 (17.2)		TC	24,430	23,630	22,760	22,190	21,150	15,820
	72 (22.2)	SHC	15,180	14,880	14,430	14,280	13,820	11,560
	76 (24.4)	SHC	17,900	17,600	17,140	16,840	16,540	14,280
	80 (26.7)	SHC	20,760	20,310	20,010	19,710	19,250	15,820
	84 (28.9)	SHC	23,330	23,030	22,570	22,190	21,150	15,820
	88 (31.1)	SHC	24,430	23,630	22,760	22,190	21,150	15,820
67 (19.4)		TC	25,430	24,620	23,730	# 23,200	21,680	16,170
	72 (22.2)	SHC	12,010	11,710	11,410	11,260	10,660	8,540
	76 (24.4)	SHC	14,730	14,430	14,130	13,820	13,220	11,260
	80 (26.7)	SHC	17,600	17,290	16,840	16,690	16,090	13,970
	84 (28.9)	SHC	20,160	19,860	19,560	19,410	18,800	16,170
	88 (31.1)	SHC	22,880	22,570	22,270	21,970	21,370	16,170
71 (21.7)		TC	26,390	25,570	24,670	24,200	22,130	16,480
	72 (22.2)	SHC	8,690	8,390	8,090	7,940	7,190	5,370
	76 (24.4)	SHC	11,410	11,110	10,810	10,660	9,900	7,940
	80 (26.7)	SHC	14,280	13,970	13,520	13,370	12,620	10,810
	84 (28.9)	SHC	16,840	16,540	16,240	16,090	15,330	13,520
	88 (31.1)	SHC	19,560	19,250	18,950	18,800	18,050	16,090
75 (23.9)		TC	27,200	26,380	25,470	25,070	22,460	16,700
	76 (24.4)	SHC	8,240	7,940	7,640	7,490	6,580	4,920
	80 (26.7)	SHC	10,960	10,660	10,350	10,350	9,450	7,640
	84 (28.9)	SHC	13,670	13,370	13,070	12,920	12,160	10,350
	88 (31.1)	SHC	16,390	16,090	15,780	15,630	14,880	13,070

TC : Total Cooling Capacity (BTU/h) SHC : Sensible Heat Capacity (BTU/h)

**NOTE**

1. Rating conditions (#) : Indoor Unit Entering Air Temp. 80 °F (26.7 °C) DB / 67 °F (19.4 °C) WB  
 : Outdoor Ambient Temp. 95 °F (35 °C) DB
2. Above data does not take Freeze Prevention Protection during cooling operation into account.  
 For this reason, the value may vary from the actual cooling characteristics.
3. Above data represents the value when the operation frequency of a compressor is fixed.

Outdoor Unit : **CU-4KE24NBU**

Indoor Unit : **CS-KE18NB4UW + CS-MKE12NB4U + CS-MKE12NB4U**

Power Supply : 230V Single Phase 60Hz

< Cooling Capacity >

RATING CAPACITY:		22,000 BTU/h		AIR FLOW RATE:		812 CFM		
INDOOR		OUTDOOR						
ENT. TEMP. °F (°C)		AMBIENT TEMP. °F (°C)						
WB	DB		65 (18.3)	75 (23.9)	85 (29.4)	95 (35.0)	105 (40.6)	115 (46.1)
59 (15.0)		TC	22,200	21,450	20,630	20,050	19,080	14,380
	72 (22.2)	SHC	18,570	18,260	17,780	17,630	17,150	14,380
	76 (24.4)	SHC	21,570	21,100	20,630	20,050	19,080	14,380
	80 (26.7)	SHC	22,200	21,450	20,630	20,050	19,080	14,380
	84 (28.9)	SHC	22,200	21,450	20,630	20,050	19,080	14,380
	88 (31.1)	SHC	22,200	21,450	20,630	20,050	19,080	14,380
63 (17.2)		TC	23,180	22,410	21,580	21,020	19,870	14,760
	72 (22.2)	SHC	15,260	14,940	14,630	14,310	13,840	11,790
	76 (24.4)	SHC	18,260	17,780	17,470	17,310	16,840	14,760
	80 (26.7)	SHC	21,250	20,940	20,620	20,310	19,830	14,760
	84 (28.9)	SHC	23,180	22,410	21,580	21,020	19,870	14,760
	88 (31.1)	SHC	23,180	22,410	21,580	21,020	19,870	14,760
67 (19.4)		TC	24,160	23,380	22,520	# 22,000	20,400	15,130
	72 (22.2)	SHC	11,950	11,630	11,320	11,000	10,530	8,480
	76 (24.4)	SHC	14,790	14,470	14,160	14,000	13,370	11,470
	80 (26.7)	SHC	17,940	17,630	17,310	17,150	16,520	14,630
	84 (28.9)	SHC	20,780	20,620	20,150	19,990	19,360	15,130
	88 (31.1)	SHC	23,780	23,380	22,520	22,000	20,400	15,130
71 (21.7)		TC	25,110	24,320	23,450	22,980	20,880	15,450
	72 (22.2)	SHC	8,320	8,000	7,690	7,530	6,900	5,160
	76 (24.4)	SHC	11,320	11,000	10,690	10,530	9,900	8,000
	80 (26.7)	SHC	14,310	14,160	13,840	13,680	12,890	11,160
	84 (28.9)	SHC	17,310	16,990	16,680	16,520	15,890	14,000
	88 (31.1)	SHC	20,310	19,990	19,680	19,520	18,730	15,450
75 (23.9)		TC	25,920	25,120	24,250	23,840	21,230	15,690
	76 (24.4)	SHC	7,850	7,530	7,370	7,220	6,430	4,690
	80 (26.7)	SHC	10,840	10,690	10,370	10,210	9,420	7,850
	84 (28.9)	SHC	13,840	13,520	13,370	13,210	12,420	10,690
	88 (31.1)	SHC	16,840	16,520	16,210	16,210	15,420	13,680

TC : Total Cooling Capacity (BTU/h) SHC : Sensible Heat Capacity (BTU/h)

**NOTE**

1. Rating conditions (#) : Indoor Unit Entering Air Temp. 80 °F (26.7 °C) DB / 67 °F (19.4 °C) WB  
: Outdoor Ambient Temp. 95 °F (35 °C) DB
2. Above data does not take Freeze Prevention Protection during cooling operation into account.  
For this reason, the value may vary from the actual cooling characteristics.
3. Above data represents the value when the operation frequency of a compressor is fixed.

Outdoor Unit : **CU-4KE31NBU**  
 Indoor Unit : **CS-MKE9NKU x 4**  
 Power Supply : 230V Single Phase 60Hz

< Cooling Capacity >

RATING CAPACITY:		30,600 BTU/h		AIR FLOW RATE:		1,036 CFM		
INDOOR		OUTDOOR						
ENT. TEMP. °F (°C)		AMBIENT TEMP. °F (°C)						
WB	DB		65 (18.3)	75 (23.9)	85 (29.4)	95 (35.0)	105 (40.6)	115 (46.1)
59 (15.0)		TC	30,850	29,770	28,590	27,980	22,750	16,560
	72 (22.2)	SHC	24,260	23,660	23,260	22,860	20,440	16,560
	76 (24.4)	SHC	27,890	27,280	26,680	26,480	22,750	16,560
	80 (26.7)	SHC	30,850	29,770	28,590	27,980	22,750	16,560
	84 (28.9)	SHC	30,850	29,770	28,590	27,980	22,750	16,560
	88 (31.1)	SHC	30,850	29,770	28,590	27,980	22,750	16,560
63 (17.2)		TC	32,150	31,030	29,820	29,290	23,300	16,930
	72 (22.2)	SHC	20,040	19,640	19,030	18,830	16,420	13,800
	76 (24.4)	SHC	23,660	23,260	22,660	22,450	19,840	16,930
	80 (26.7)	SHC	27,480	26,880	26,480	26,080	23,300	16,930
	84 (28.9)	SHC	30,900	30,500	29,820	29,290	23,300	16,930
	88 (31.1)	SHC	32,150	31,030	29,820	29,290	23,300	16,930
67 (19.4)		TC	33,410	32,280	31,030	# 30,600	23,790	17,260
	72 (22.2)	SHC	15,820	15,410	15,010	14,810	12,200	9,780
	76 (24.4)	SHC	19,440	19,030	18,430	18,430	15,820	13,400
	80 (26.7)	SHC	23,260	22,660	22,250	22,050	19,440	17,020
	84 (28.9)	SHC	26,680	26,280	25,870	25,670	23,060	17,260
	88 (31.1)	SHC	30,300	29,900	29,290	29,290	23,790	17,260
71 (21.7)		TC	34,630	33,470	32,190	31,890	24,200	17,520
	72 (22.2)	SHC	11,390	10,990	10,590	10,380	7,770	5,560
	76 (24.4)	SHC	15,010	14,610	14,210	14,010	11,390	9,180
	80 (26.7)	SHC	18,830	18,230	17,830	17,830	15,010	13,000
	84 (28.9)	SHC	22,250	21,850	21,450	21,250	18,630	16,420
	88 (31.1)	SHC	25,870	25,470	25,070	24,870	22,250	17,520
75 (23.9)		TC	35,630	34,460	33,160	33,010	24,460	17,680
	76 (24.4)	SHC	10,790	10,380	9,980	9,780	7,170	5,150
	80 (26.7)	SHC	14,410	14,010	13,600	13,600	10,990	8,980
	84 (28.9)	SHC	18,030	17,630	17,220	17,220	14,410	12,400
	88 (31.1)	SHC	21,650	21,250	20,840	20,640	18,030	16,020

TC : Total Cooling Capacity (BTU/h) SHC : Sensible Heat Capacity (BTU/h)

**NOTE**

1. Rating conditions (#) : Indoor Unit Entering Air Temp. 80 °F (26.7 °C) DB / 67 °F (19.4 °C) WB  
 : Outdoor Ambient Temp. 95 °F (35 °C) DB
2. Above data does not take Freeze Prevention Protection during cooling operation into account.  
 For this reason, the value may vary from the actual cooling characteristics.
3. Above data represents the value when the operation frequency of a compressor is fixed.

Outdoor Unit : **CU-4KE31NBU**  
 Indoor Unit : **CS-MKE9NB4U x 4**  
 Power Supply : 230V Single Phase 60Hz

< Cooling Capacity >

RATING CAPACITY:		28,600 BTU/h		AIR FLOW RATE:		883 CFM		
INDOOR		OUTDOOR						
ENT. TEMP. °F (°C)		AMBIENT TEMP. °F (°C)						
WB	DB		65 (18.3)	75 (23.9)	85 (29.4)	95 (35.0)	105 (40.6)	115 (46.1)
59 (15.0)		TC	28,830	27,880	26,840	26,270	21,300	15,500
	72 (22.2)	SHC	22,560	22,210	21,700	21,360	19,130	15,500
	76 (24.4)	SHC	25,810	25,470	24,960	24,610	21,300	15,500
	80 (26.7)	SHC	28,830	27,880	26,840	26,270	21,300	15,500
	84 (28.9)	SHC	28,830	27,880	26,840	26,270	21,300	15,500
	88 (31.1)	SHC	28,830	27,880	26,840	26,270	21,300	15,500
63 (17.2)		TC	29,960	29,000	27,940	27,440	21,790	15,830
	72 (22.2)	SHC	18,780	18,270	17,930	17,580	15,360	12,960
	76 (24.4)	SHC	22,040	21,700	21,180	21,010	18,610	15,830
	80 (26.7)	SHC	25,470	25,130	24,610	24,440	21,790	15,830
	84 (28.9)	SHC	28,730	28,390	27,870	27,440	21,790	15,830
	88 (31.1)	SHC	29,960	29,000	27,940	27,440	21,790	15,830
67 (19.4)		TC	31,060	30,090	29,010	# 28,600	22,220	16,110
	72 (22.2)	SHC	14,840	14,500	13,980	13,810	11,410	9,180
	76 (24.4)	SHC	18,100	17,760	17,410	17,240	14,670	12,440
	80 (26.7)	SHC	21,530	21,180	20,840	20,670	18,100	15,870
	84 (28.9)	SHC	24,780	24,440	24,100	23,930	21,360	16,110
	88 (31.1)	SHC	28,210	27,700	27,360	27,180	22,220	16,110
71 (21.7)		TC	32,080	31,110	30,020	29,730	22,560	16,340
	72 (22.2)	SHC	10,730	10,380	10,040	9,870	7,470	5,410
	76 (24.4)	SHC	13,980	13,640	13,300	13,130	10,730	8,670
	80 (26.7)	SHC	17,410	17,070	16,730	16,560	14,160	12,100
	84 (28.9)	SHC	20,670	20,330	19,980	19,810	17,410	15,360
	88 (31.1)	SHC	23,930	23,580	23,240	23,240	20,670	16,340
75 (23.9)		TC	32,920	31,940	30,850	30,690	22,770	16,470
	76 (24.4)	SHC	10,040	9,700	9,360	9,360	6,780	4,900
	80 (26.7)	SHC	13,470	13,130	12,780	12,780	10,210	8,330
	84 (28.9)	SHC	16,730	16,380	16,040	16,040	13,470	11,760
	88 (31.1)	SHC	19,980	19,640	19,300	19,300	16,730	15,010

TC : Total Cooling Capacity (BTU/h) SHC : Sensible Heat Capacity (BTU/h)

**NOTE**

- Rating conditions (#) : Indoor Unit Entering Air Temp. 80 °F (26.7 °C) DB / 67 °F (19.4 °C) WB  
 : Outdoor Ambient Temp. 95 °F (35 °C) DB
- Above data does not take Freeze Prevention Protection during cooling operation into account.  
 For this reason, the value may vary from the actual cooling characteristics.
- Above data represents the value when the operation frequency of a compressor is fixed.

### 5-3. Cooling Capacity (Low Ambient)

Outdoor Unit : **CU-3KE19NBU**

Indoor Unit : **CS-MKE9NKU × 3**

Power Supply : 230V Single Phase 60Hz

< Cooling Capacity (Low Ambient) >

RATING CAPACITY:		18,600 BTU/h		AIR FLOW RATE:		777 CFM			
INDOOR		OUTDOOR							
ENT. TEMP. °F (°C)		AMBIENT TEMP. °F (°C)							
WB	DB			15 (-9.4)	25 (-3.9)	35 (1.7)	45 (7.2)	55 (12.8)	
59 (15.0)		TC		19,030	18,900	18,890	18,960	18,810	
	72 (22.2)	SHC		16,240	18,900	16,240	16,240	16,090	
	76 (24.4)	SHC		18,950	18,900	18,800	18,950	18,800	
	80 (26.7)	SHC		19,030	18,900	18,890	18,960	18,810	
	84 (28.9)	SHC		19,030	18,900	18,890	18,960	18,810	
	88 (31.1)	SHC		19,030	18,900	18,890	18,960	18,810	
63 (17.2)		TC		19,430	19,350	19,410	19,580	19,480	
	72 (22.2)	SHC		13,070	19,350	13,070	13,070	13,070	
	76 (24.4)	SHC		15,780	19,350	15,780	15,780	15,780	
	80 (26.7)	SHC		18,500	19,350	18,500	18,650	18,500	
	84 (28.9)	SHC		19,430	19,350	19,410	19,580	19,480	
	88 (31.1)	SHC		19,430	19,350	19,410	19,580	19,480	
67 (19.4)		TC		19,740	19,710	19,870	20,150	20,120	
	72 (22.2)	SHC		9,900	19,710	9,900	10,050	10,050	
	76 (24.4)	SHC		12,470	19,710	12,620	12,620	12,620	
	80 (26.7)	SHC		15,330	19,710	15,330	15,480	15,480	
	84 (28.9)	SHC		18,050	19,710	18,050	18,200	18,200	
	88 (31.1)	SHC		19,740	19,710	19,870	20,150	20,120	
71 (21.7)		TC		19,900	19,950	20,220	20,640	20,700	
	72 (22.2)	SHC		6,430	19,950	6,580	6,730	6,730	
	76 (24.4)	SHC		9,150	19,950	9,300	9,450	9,450	
	80 (26.7)	SHC		11,860	19,950	12,010	12,160	12,160	
	84 (28.9)	SHC		14,580	19,950	14,730	14,880	14,880	
	88 (31.1)	SHC		17,290	19,950	17,440	17,600	17,600	
75 (23.9)		TC		19,890	20,020	20,430	21,000	21,140	
	76 (24.4)	SHC		5,830	20,020	5,980	6,130	6,280	
	80 (26.7)	SHC		8,690	20,020	8,840	9,000	9,000	
	84 (28.9)	SHC		11,260	20,020	11,560	11,710	11,710	
	88 (31.1)	SHC		13,970	20,020	14,130	14,280	14,430	

TC : Total Cooling Capacity (BTU/h) SHC : Sensible Heat Capacity (BTU/h)

#### NOTE

1. Above data does not take Freeze Prevention Protection during cooling operation into account.  
For this reason, the value may vary from the actual cooling characteristics.
2. Above data represents the value when the operation frequency of a compressor is fixed.

Outdoor Unit : **CU-3KE19NBU**  
 Indoor Unit : **CS-MKE12NB4U × 3**  
 Power Supply : 230V Single Phase 60Hz

< Cooling Capacity (Low Ambient) >

RATING CAPACITY:		17,400 BTU/h		AIR FLOW RATE:		706 CFM			
INDOOR		OUTDOOR							
ENT. TEMP. °F (°C)		AMBIENT TEMP. °F (°C)							
WB	DB			15 (-9.4)	25 (-3.9)	35 (1.7)	45 (7.2)	55 (12.8)	
59 (15.0)		TC		17,850	17,720	17,690	17,750	17,600	
	72 (22.2)	SHC		15,590	17,720	15,590	15,590	15,450	
	76 (24.4)	SHC		17,850	17,720	17,690	17,750	17,600	
	80 (26.7)	SHC		17,850	17,720	17,690	17,750	17,600	
	84 (28.9)	SHC		17,850	17,720	17,690	17,750	17,600	
	88 (31.1)	SHC		17,850	17,720	17,690	17,750	17,600	
63 (17.2)		TC		18,250	18,160	18,210	18,350	18,240	
	72 (22.2)	SHC		12,570	18,160	12,570	12,570	12,570	
	76 (24.4)	SHC		15,180	18,160	15,180	15,180	15,180	
	80 (26.7)	SHC		17,920	18,160	17,780	17,920	17,920	
	84 (28.9)	SHC		18,250	18,160	18,210	18,350	18,240	
	88 (31.1)	SHC		18,250	18,160	18,210	18,350	18,240	
67 (19.4)		TC		18,560	18,530	18,660	18,900	18,860	
	72 (22.2)	SHC		9,420	18,530	9,420	9,550	9,550	
	76 (24.4)	SHC		12,020	18,530	12,020	12,160	12,160	
	80 (26.7)	SHC		14,770	18,530	14,770	14,900	14,900	
	84 (28.9)	SHC		17,370	18,530	17,370	17,510	17,510	
	88 (31.1)	SHC		18,560	18,530	18,660	18,900	18,860	
71 (21.7)		TC		18,760	18,790	19,020	19,390	19,420	
	72 (22.2)	SHC		6,120	18,790	6,260	6,400	6,400	
	76 (24.4)	SHC		8,730	18,790	8,870	9,000	9,000	
	80 (26.7)	SHC		11,470	18,790	11,610	11,750	11,750	
	84 (28.9)	SHC		14,080	18,790	14,220	14,350	14,350	
	88 (31.1)	SHC		16,690	18,790	16,820	16,960	16,960	
75 (23.9)		TC		18,790	18,890	19,250	19,750	19,860	
	76 (24.4)	SHC		5,580	18,890	5,850	5,990	5,990	
	80 (26.7)	SHC		8,320	18,890	8,460	8,590	8,730	
	84 (28.9)	SHC		10,930	18,890	11,060	11,200	11,340	
	88 (31.1)	SHC		13,530	18,890	13,670	13,810	13,940	

TC : Total Cooling Capacity (BTU/h) SHC : Sensible Heat Capacity (BTU/h)

**NOTE**

- Above data does not take Freeze Prevention Protection during cooling operation into account. For this reason, the value may vary from the actual cooling characteristics.
- Above data represents the value when the operation frequency of a compressor is fixed.

Outdoor Unit : **CU-4KE24NBU**  
 Indoor Unit : **CS-MKE9NKU × 3**  
 Power Supply : 230V Single Phase 60Hz

< Cooling Capacity (Low Ambient) >

RATING CAPACITY:		23,200 BTU/h		AIR FLOW RATE:		777 CFM			
INDOOR		OUTDOOR							
ENT. TEMP. °F (°C)		AMBIENT TEMP. °F (°C)							
WB	DB			15 (-9.4)	25 (-3.9)	35 (1.7)	45 (7.2)	55 (12.8)	
59 (15.0)		TC		23,390	23,310	23,350	23,510	23,420	
	72 (22.2)	SHC		18,350	23,310	18,350	18,350	18,350	
	76 (24.4)	SHC		20,910	23,310	20,910	21,070	21,070	
	80 (26.7)	SHC		23,390	23,310	23,350	23,510	23,420	
	84 (28.9)	SHC		23,390	23,310	23,350	23,510	23,420	
	88 (31.1)	SHC		23,390	23,310	23,350	23,510	23,420	
63 (17.2)		TC		23,620	23,610	23,770	24,080	24,070	
	72 (22.2)	SHC		14,880	23,610	14,880	15,030	15,030	
	76 (24.4)	SHC		17,600	23,610	17,600	17,750	17,750	
	80 (26.7)	SHC		20,310	23,610	20,460	20,610	20,460	
	84 (28.9)	SHC		23,030	23,610	23,030	23,180	23,180	
	88 (31.1)	SHC		23,620	23,610	23,770	24,080	24,070	
67 (19.4)		TC		23,660	23,750	24,060	24,550	24,640	
	72 (22.2)	SHC		11,410	23,750	11,560	11,710	11,710	
	76 (24.4)	SHC		13,970	23,750	14,280	14,430	14,430	
	80 (26.7)	SHC		16,840	23,750	16,990	17,140	17,290	
	84 (28.9)	SHC		19,560	23,750	19,710	19,860	19,860	
	88 (31.1)	SHC		22,270	23,750	22,420	22,570	22,570	
71 (21.7)		TC		23,470	23,680	24,180	24,870	25,100	
	72 (22.2)	SHC		7,640	23,680	7,940	8,240	8,240	
	76 (24.4)	SHC		10,350	23,680	10,660	10,810	10,960	
	80 (26.7)	SHC		13,220	23,680	13,370	13,670	13,670	
	84 (28.9)	SHC		15,780	23,680	16,090	16,390	16,390	
	88 (31.1)	SHC		18,500	23,680	18,800	18,950	19,100	
75 (23.9)		TC		23,050	23,390	24,090	25,020	25,390	
	76 (24.4)	SHC		6,880	23,390	7,190	7,490	7,640	
	80 (26.7)	SHC		9,600	23,390	9,900	10,200	10,350	
	84 (28.9)	SHC		12,310	23,390	12,620	12,920	13,070	
	88 (31.1)	SHC		15,030	23,390	15,330	15,630	15,780	

TC : Total Cooling Capacity (BTU/h) SHC : Sensible Heat Capacity (BTU/h)

**NOTE**

- Above data does not take Freeze Prevention Protection during cooling operation into account. For this reason, the value may vary from the actual cooling characteristics.
- Above data represents the value when the operation frequency of a compressor is fixed.

Outdoor Unit : **CU-4KE24NBU**

Indoor Unit : **CS-KE18NB4UW + CS-MKE12NB4U + CS-MKE12NB4U**

Power Supply : 230V Single Phase 60Hz

< Cooling Capacity (Low Ambient) >

RATING CAPACITY: 22,000 BTU/h			AIR FLOW RATE: 812 CFM						
INDOOR		OUTDOOR							
ENT. TEMP. °F (°C)		AMBIENT TEMP. °F (°C)							
WB	DB			15 (-9.4)	25 (-3.9)	35 (1.7)	45 (7.2)	55 (12.8)	
59 (15.0)		TC		22,260	22,160	22,190	22,350	22,240	
	72 (22.2)	SHC		18,570	22,160	18,570	18,570	18,570	
	76 (24.4)	SHC		21,570	22,160	21,570	21,570	21,570	
	80 (26.7)	SHC		22,260	22,160	22,190	22,350	22,240	
	84 (28.9)	SHC		22,260	22,160	22,190	22,350	22,240	
	88 (31.1)	SHC		22,260	22,160	22,190	22,350	22,240	
63 (17.2)		TC		22,580	22,550	22,690	22,980	22,940	
	72 (22.2)	SHC		14,940	22,550	15,100	15,100	15,100	
	76 (24.4)	SHC		17,940	22,550	17,940	18,100	18,100	
	80 (26.7)	SHC		20,940	22,550	21,100	21,250	21,100	
	84 (28.9)	SHC		22,580	22,550	22,690	22,980	22,940	
	88 (31.1)	SHC		22,580	22,550	22,690	22,980	22,940	
67 (19.4)		TC		22,740	22,790	23,070	23,530	23,590	
	72 (22.2)	SHC		11,320	22,790	11,470	11,630	11,630	
	76 (24.4)	SHC		14,310	22,790	14,470	14,630	14,630	
	80 (26.7)	SHC		17,310	22,790	17,470	17,630	17,630	
	84 (28.9)	SHC		20,310	22,790	20,460	20,620	20,620	
	88 (31.1)	SHC		22,740	22,790	23,070	23,530	23,590	
71 (21.7)		TC		22,700	22,850	23,310	23,960	24,140	
	72 (22.2)	SHC		7,530	22,850	7,690	8,000	8,000	
	76 (24.4)	SHC		10,370	22,850	10,690	10,840	11,000	
	80 (26.7)	SHC		13,520	22,850	13,680	14,000	14,000	
	84 (28.9)	SHC		16,520	22,850	16,680	16,840	16,990	
	88 (31.1)	SHC		19,360	22,850	19,680	19,830	19,830	
75 (23.9)		TC		22,430	22,710	23,350	24,230	24,540	
	76 (24.4)	SHC		6,740	22,710	7,060	7,370	7,370	
	80 (26.7)	SHC		9,900	22,710	10,050	10,370	10,530	
	84 (28.9)	SHC		12,740	22,710	13,050	13,370	13,370	
	88 (31.1)	SHC		15,730	22,710	16,050	16,210	16,360	

TC : Total Cooling Capacity (BTU/h) SHC : Sensible Heat Capacity (BTU/h)

**NOTE**

1. Above data does not take Freeze Prevention Protection during cooling operation into account. For this reason, the value may vary from the actual cooling characteristics.
2. Above data represents the value when the operation frequency of a compressor is fixed.

Outdoor Unit : **CU-4KE31NBU**  
 Indoor Unit : **CS-MKE9NKU × 4**  
 Power Supply : 230V Single Phase 60Hz

< Cooling Capacity (Low Ambient) >

RATING CAPACITY:		30,600 BTU/h		AIR FLOW RATE:		1,036 CFM			
INDOOR		OUTDOOR							
ENT. TEMP. °F (°C)		AMBIENT TEMP. °F (°C)							
WB	DB			15 (-9.4)	25 (-3.9)	35 (1.7)	45 (7.2)	55 (12.8)	
59 (15.0)		TC		30,870	30,760	30,800	31,010	30,890	
	72 (22.2)	SHC		24,260	30,760	24,260	24,260	24,260	
	76 (24.4)	SHC		27,890	30,760	27,890	27,890	27,890	
	80 (26.7)	SHC		30,870	30,760	30,800	31,010	30,890	
	84 (28.9)	SHC		30,870	30,760	30,800	31,010	30,890	
	88 (31.1)	SHC		30,870	30,760	30,800	31,010	30,890	
63 (17.2)		TC		31,140	31,130	31,320	31,720	31,730	
	72 (22.2)	SHC		19,640	31,130	19,840	19,840	19,840	
	76 (24.4)	SHC		23,260	31,130	23,260	23,460	23,460	
	80 (26.7)	SHC		26,880	31,130	27,080	27,280	27,280	
	84 (28.9)	SHC		30,500	31,130	30,700	30,700	30,700	
	88 (31.1)	SHC		31,140	31,130	31,320	31,720	31,730	
67 (19.4)		TC		31,150	31,270	31,660	32,300	32,450	
	72 (22.2)	SHC		15,010	31,270	15,210	15,410	15,610	
	76 (24.4)	SHC		18,630	31,270	18,830	19,030	19,030	
	80 (26.7)	SHC		22,250	31,270	22,450	22,860	22,860	
	84 (28.9)	SHC		25,870	31,270	26,080	26,280	26,480	
	88 (31.1)	SHC		29,490	31,270	29,700	29,900	29,900	
71 (21.7)		TC		30,850	31,120	31,750	32,680	33,020	
	72 (22.2)	SHC		10,180	31,120	10,380	10,790	10,790	
	76 (24.4)	SHC		13,600	31,120	14,010	14,410	14,410	
	80 (26.7)	SHC		17,430	31,120	17,630	18,030	18,230	
	84 (28.9)	SHC		21,050	31,120	21,250	21,650	21,650	
	88 (31.1)	SHC		24,470	31,120	24,870	25,270	25,270	
75 (23.9)		TC		30,230	30,670	31,570	32,820	33,340	
	76 (24.4)	SHC		8,980	30,670	9,380	9,780	9,980	
	80 (26.7)	SHC		12,600	30,670	13,200	13,600	13,600	
	84 (28.9)	SHC		16,220	30,670	16,620	17,020	17,220	
	88 (31.1)	SHC		19,840	30,670	20,240	20,640	20,840	

TC : Total Cooling Capacity (BTU/h) SHC : Sensible Heat Capacity (BTU/h)

**NOTE**

- Above data does not take Freeze Prevention Protection during cooling operation into account. For this reason, the value may vary from the actual cooling characteristics.
- Above data represents the value when the operation frequency of a compressor is fixed.

Outdoor Unit : **CU-4KE31NBU**  
 Indoor Unit : **CS-MKE9NB4U x 4**  
 Power Supply : 230V Single Phase 60Hz

< Cooling Capacity (Low Ambient) >

RATING CAPACITY:		28,600 BTU/h		AIR FLOW RATE:		883 CFM			
INDOOR		OUTDOOR							
ENT. TEMP. °F (°C)		AMBIENT TEMP. °F (°C)							
WB	DB			15 (-9.4)	25 (-3.9)	35 (1.7)	45 (7.2)	55 (12.8)	
59 (15.0)		TC		28,890	28,790	28,810	28,990	28,870	
	72 (22.2)	SHC		22,560	28,790	22,560	22,730	22,560	
	76 (24.4)	SHC		25,980	28,790	25,810	25,980	25,980	
	80 (26.7)	SHC		28,890	28,790	28,810	28,990	28,870	
	84 (28.9)	SHC		28,890	28,790	28,810	28,990	28,870	
	88 (31.1)	SHC		28,890	28,790	28,810	28,990	28,870	
63 (17.2)		TC		29,170	29,150	29,320	29,660	29,650	
	72 (22.2)	SHC		18,440	29,150	18,440	18,610	18,610	
	76 (24.4)	SHC		21,700	29,150	21,700	21,870	21,870	
	80 (26.7)	SHC		25,130	29,150	25,130	25,300	25,300	
	84 (28.9)	SHC		28,390	29,150	28,390	28,560	28,560	
	88 (31.1)	SHC		29,170	29,150	29,320	29,660	29,650	
67 (19.4)		TC		29,210	29,310	29,650	30,210	30,330	
	72 (22.2)	SHC		14,160	29,310	14,330	14,500	14,500	
	76 (24.4)	SHC		17,410	29,310	17,580	17,760	17,930	
	80 (26.7)	SHC		20,840	29,310	21,010	21,180	21,360	
	84 (28.9)	SHC		24,100	29,310	24,270	24,440	24,610	
	88 (31.1)	SHC		27,360	29,310	27,530	27,870	27,870	
71 (21.7)		TC		28,970	29,200	29,760	30,580	30,860	
	72 (22.2)	SHC		9,700	29,200	9,870	10,210	10,210	
	76 (24.4)	SHC		12,960	29,200	13,130	13,470	13,640	
	80 (26.7)	SHC		16,380	29,200	16,560	16,900	17,070	
	84 (28.9)	SHC		19,640	29,200	19,810	20,160	20,330	
	88 (31.1)	SHC		22,900	29,200	23,240	23,410	23,580	
75 (23.9)		TC		28,440	28,820	29,620	30,720	31,170	
	76 (24.4)	SHC		8,500	28,820	9,010	9,360	9,530	
	80 (26.7)	SHC		11,930	28,820	12,440	12,780	12,960	
	84 (28.9)	SHC		15,360	28,820	15,700	16,040	16,210	
	88 (31.1)	SHC		18,610	28,820	18,960	19,300	19,470	

TC : Total Cooling Capacity (BTU/h) SHC : Sensible Heat Capacity (BTU/h)

**NOTE**

- Above data does not take Freeze Prevention Protection during cooling operation into account. For this reason, the value may vary from the actual cooling characteristics.
- Above data represents the value when the operation frequency of a compressor is fixed.

## 5-4. Heating Capacity

Outdoor Unit : **CU-3KE19NBU**

Indoor Unit : **CS-MKE9NKU × 3**

Power Supply : 230V Single Phase 60Hz

< Heating Capacity >

RATING CAPACITY:		24,800 BTU/h		AIR FLOW RATE:		847 CFM	
OUTDOOR		INDOOR					
ENT. TEMP. °F (°C)		AMBIENT TEMP. °F (°C)					
WB		60 (15.6)	65 (18.3)	70 (21.1)	75 (23.9)	80 (26.7)	
0 (-17.8)	TH	13,820	13,790	13,750	13,710	13,660	
3 (-16.1)	TH	14,280	14,250	14,220	14,170	14,120	
8 (-13.3)	TH	15,390	15,360	15,320	15,280	15,220	
13 (-10.6)	TH	16,540	16,510	16,470	16,420	16,360	
18 (-7.8)	TH	17,810	17,780	17,740	17,680	17,620	
23 (-5.0)	TH	19,150	19,110	19,070	19,010	18,930	
28 (-2.2)	TH	20,540	20,500	20,450	20,380	20,310	
33 (0.6)	TH	21,980	21,940	21,880	21,810	21,730	
38 (3.3)	TH	23,400	23,360	23,300	23,220	23,130	
43 (6.1)	TH	24,920	24,870	# 24,800	24,720	24,620	
48 (8.9)	TH	26,450	26,400	26,330	26,240	26,130	
53 (11.7)	TH	28,000	27,940	27,870	27,770	27,660	
58 (14.4)	TH	29,500	29,440	29,360	29,250	29,130	
63 (17.2)	TH	31,050	30,980	30,890	30,780	30,660	
65 (18.3)	TH	31,650	31,580	31,490	31,380	31,250	

TH : Total Heating Capacity (BTU/h)

### NOTE

- Rating conditions (#) : Indoor Unit Entering Air Temp. 70 °F (21.1 °C) DB  
: Outdoor Ambient Temp. 47 °F (8.3 °C) DB / 43 °F (6.1 °C) WB
- Above data does not take Defrost Operation, Overload Prevention Protection, and/or Cold Air Prevention Protection during heating operation into account. For this reason, the value may vary from the actual heating characteristics.
- Above data represents the value when the operation frequency of a compressor is fixed.

Outdoor Unit : **CU-3KE19NBU**  
 Indoor Unit : **CS-MKE12NB4U × 3**  
 Power Supply : 230V Single Phase 60Hz

< Heating Capacity >

RATING CAPACITY: 24,000 BTU/h		AIR FLOW RATE: 803 CFM				
OUTDOOR		INDOOR				
ENT. TEMP. °F (°C)		AMBIENT TEMP. °F (°C)				
WB		60 (15.6)	65 (18.3)	70 (21.1)	75 (23.9)	80 (26.7)
0 (-17.8)	TH	13,310	13,300	13,270	13,240	13,200
3 (-16.1)	TH	13,760	13,740	13,720	13,690	13,650
8 (-13.3)	TH	14,830	14,820	14,790	14,760	14,720
13 (-10.6)	TH	15,950	15,930	15,910	15,870	15,830
18 (-7.8)	TH	17,180	17,160	17,130	17,090	17,040
23 (-5.0)	TH	18,470	18,450	18,420	18,380	18,320
28 (-2.2)	TH	19,820	19,800	19,770	19,720	19,660
33 (0.6)	TH	21,220	21,190	21,160	21,100	21,040
38 (3.3)	TH	22,610	22,580	22,540	22,480	22,410
43 (6.1)	TH	24,080	24,050	# 24,000	23,940	23,860
48 (8.9)	TH	25,580	25,540	25,490	25,420	25,340
53 (11.7)	TH	27,090	27,050	27,000	26,920	26,830
58 (14.4)	TH	28,560	28,520	28,460	28,380	28,280
63 (17.2)	TH	30,090	30,040	29,970	29,880	29,780
65 (18.3)	TH	30,680	30,630	30,560	30,470	30,360

TH : Total Heating Capacity (BTU/h)

**NOTE**

- Rating conditions (#) : Indoor Unit Entering Air Temp. 70 °F (21.1 °C) DB  
 : Outdoor Ambient Temp. 47 °F (8.3 °C) DB / 43 °F (6.1 °C) WB
- Above data does not take Defrost Operation, Overload Prevention Protection, and/or Cold Air Prevention Protection during heating operation into account. For this reason, the value may vary from the actual heating characteristics.
- Above data represents the value when the operation frequency of a compressor is fixed.

Outdoor Unit : **CU-4KE24NBU**  
 Indoor Unit : **CS-MKE9NKU × 3**  
 Power Supply : 230V Single Phase 60Hz

< Heating Capacity >

RATING CAPACITY:		29,200 BTU/h		AIR FLOW RATE:		847 CFM	
OUTDOOR		INDOOR					
ENT. TEMP. °F (°C)		AMBIENT TEMP. °F (°C)					
WB		60 (15.6)	65 (18.3)	70 (21.1)	75 (23.9)	80 (26.7)	
0 (-17.8)	TH	16,550	16,540	16,510	16,470	16,420	
3 (-16.1)	TH	17,100	17,080	17,050	17,010	16,960	
8 (-13.3)	TH	18,390	18,370	18,340	18,300	18,250	
13 (-10.6)	TH	19,730	19,710	19,680	19,640	19,580	
18 (-7.8)	TH	21,200	21,180	21,150	21,100	21,040	
23 (-5.0)	TH	22,740	22,720	22,680	22,630	22,570	
28 (-2.2)	TH	24,330	24,310	24,270	24,220	24,150	
33 (0.6)	TH	25,970	25,950	25,900	25,850	25,770	
38 (3.3)	TH	27,580	27,560	27,510	27,450	27,370	
43 (6.1)	TH	29,280	29,250	# 29,200	29,130	29,050	
48 (8.9)	TH	30,990	30,950	30,900	30,830	30,740	
53 (11.7)	TH	32,690	32,650	32,600	32,520	32,270	
58 (14.4)	TH	34,320	34,280	34,220	34,140	32,580	
63 (17.2)	TH	35,970	35,930	35,860	35,420	32,770	
65 (18.3)	TH	36,600	36,560	36,500	35,460	32,800	

TH : Total Heating Capacity (BTU/h)

**NOTE**

- Rating conditions (#) : Indoor Unit Entering Air Temp. 70 °F (21.1 °C) DB  
 : Outdoor Ambient Temp. 47 °F (8.3 °C) DB / 43 °F (6.1 °C) WB
- Above data does not take Defrost Operation, Overload Prevention Protection, and/or Cold Air Prevention Protection during heating operation into account. For this reason, the value may vary from the actual heating characteristics.
- Above data represents the value when the operation frequency of a compressor is fixed.

Outdoor Unit : **CU-4KE24NBU**

Indoor Unit : **CS-KE18NB4UW + CS-MKE12NB4U + CS-MKE12NB4U**

Power Supply : 230V Single Phase 60Hz

< Heating Capacity >

RATING CAPACITY:		28,400 BTU/h		AIR FLOW RATE:		918 CFM	
OUTDOOR		INDOOR					
ENT. TEMP. °F (°C)		AMBIENT TEMP. °F (°C)					
WB		60 (15.6)	65 (18.3)	70 (21.1)	75 (23.9)	80 (26.7)	
0 (-17.8)	TH	16,030	16,040	16,050	16,040	16,020	
3 (-16.1)	TH	16,550	16,560	16,570	16,560	16,540	
8 (-13.3)	TH	17,790	17,810	17,820	17,810	17,790	
13 (-10.6)	TH	19,080	19,100	19,110	19,100	19,090	
18 (-7.8)	TH	20,500	20,520	20,530	20,530	20,510	
23 (-5.0)	TH	21,990	22,010	22,020	22,010	22,000	
28 (-2.2)	TH	23,530	23,560	23,570	23,560	23,540	
33 (0.6)	TH	25,130	25,150	25,160	25,150	25,130	
38 (3.3)	TH	26,700	26,730	26,740	26,730	26,700	
43 (6.1)	TH	28,360	28,390	# 28,400	28,390	28,360	
48 (8.9)	TH	30,050	30,070	30,080	30,070	30,040	
53 (11.7)	TH	31,740	31,770	31,780	31,770	31,530	
58 (14.4)	TH	33,370	33,400	33,410	33,400	32,030	
63 (17.2)	TH	35,050	35,080	35,090	35,070	32,450	
65 (18.3)	TH	35,700	35,730	35,740	35,400	32,570	

TH : Total Heating Capacity (BTU/h)

**NOTE**

1. Rating conditions (#) : Indoor Unit Entering Air Temp. 70 °F (21.1 °C) DB  
: Outdoor Ambient Temp. 47 °F (8.3 °C) DB / 43 °F (6.1 °C) WB
2. Above data does not take Defrost Operation, Overload Prevention Protection, and/or Cold Air Prevention Protection during heating operation into account. For this reason, the value may vary from the actual heating characteristics.
3. Above data represents the value when the operation frequency of a compressor is fixed.

Outdoor Unit : **CU-4KE31NBU**  
 Indoor Unit : **CS-MKE9NKU × 4**  
 Power Supply : 230V Single Phase 60Hz

< Heating Capacity >

RATING CAPACITY:		32,000 BTU/h		AIR FLOW RATE:		1,130 CFM	
OUTDOOR		INDOOR					
ENT. TEMP. °F (°C)		AMBIENT TEMP. °F (°C)					
WB		60 (15.6)	65 (18.3)	70 (21.1)	75 (23.9)	80 (26.7)	
0 (-17.8)	TH	17,980	17,970	17,950	17,910	17,870	
3 (-16.1)	TH	18,570	18,560	18,540	18,510	18,460	
8 (-13.3)	TH	19,990	19,980	19,950	19,920	19,870	
13 (-10.6)	TH	21,450	21,440	21,420	21,380	21,330	
18 (-7.8)	TH	23,060	23,050	23,030	22,990	22,940	
23 (-5.0)	TH	24,760	24,750	24,720	24,680	24,620	
28 (-2.2)	TH	26,520	26,510	26,480	26,430	26,370	
33 (0.6)	TH	28,340	28,330	28,300	28,250	28,180	
38 (3.3)	TH	30,140	30,130	30,100	30,040	29,970	
43 (6.1)	TH	32,050	32,040	# 32,000	31,940	31,870	
48 (8.9)	TH	33,990	33,970	33,930	33,870	33,790	
53 (11.7)	TH	35,940	35,920	35,880	35,820	35,730	
58 (14.4)	TH	37,820	37,800	37,760	37,690	37,600	
63 (17.2)	TH	39,770	39,750	39,700	39,630	39,530	
65 (18.3)	TH	40,520	40,500	40,460	40,380	40,290	

TH : Total Heating Capacity (BTU/h)

**NOTE**

1. Rating conditions (#) : Indoor Unit Entering Air Temp. 70 °F (21.1 °C) DB  
 : Outdoor Ambient Temp. 47 °F (8.3 °C) DB / 43 °F (6.1 °C) WB
2. Above data does not take Defrost Operation, Overload Prevention Protection, and/or Cold Air Prevention Protection during heating operation into account. For this reason, the value may vary from the actual heating characteristics.
3. Above data represents the value when the operation frequency of a compressor is fixed.

Outdoor Unit : **CU-4KE31NBU**  
 Indoor Unit : **CS-MKE9NB4U x 4**  
 Power Supply : 230V Single Phase 60Hz

< Heating Capacity >

RATING CAPACITY: 32,000 BTU/h		AIR FLOW RATE: 1,000 CFM				
OUTDOOR		INDOOR				
ENT. TEMP. °F (°C)		AMBIENT TEMP. °F (°C)				
WB		60 (15.6)	65 (18.3)	70 (21.1)	75 (23.9)	80 (26.7)
0 (-17.8)	TH	17,910	17,890	17,850	17,810	17,750
3 (-16.1)	TH	18,510	18,480	18,450	18,400	18,340
8 (-13.3)	TH	19,940	19,920	19,880	19,830	19,770
13 (-10.6)	TH	21,420	21,400	21,360	21,310	21,240
18 (-7.8)	TH	23,050	23,030	22,980	22,930	22,860
23 (-5.0)	TH	24,760	24,730	24,690	24,630	24,550
28 (-2.2)	TH	26,540	26,510	26,460	26,390	26,310
33 (0.6)	TH	28,380	28,340	28,290	28,220	28,130
38 (3.3)	TH	30,190	30,150	30,090	30,020	29,920
43 (6.1)	TH	32,110	32,060	# 32,000	31,920	31,810
48 (8.9)	TH	34,050	34,000	33,930	33,840	33,720
53 (11.7)	TH	36,000	35,940	35,870	35,770	35,650
58 (14.4)	TH	37,870	37,810	37,730	37,630	37,500
63 (17.2)	TH	39,790	39,730	39,640	39,530	39,390
65 (18.3)	TH	40,540	40,480	40,390	40,270	40,130

TH : Total Heating Capacity (BTU/h)


**NOTE**

1. Rating conditions (#) : Indoor Unit Entering Air Temp. 70 °F (21.1 °C) DB  
 : Outdoor Ambient Temp. 47 °F (8.3 °C) DB / 43 °F (6.1 °C) WB
2. Above data does not take Defrost Operation, Overload Prevention Protection, and/or Cold Air Prevention Protection during heating operation into account. For this reason, the value may vary from the actual heating characteristics.
3. Above data represents the value when the operation frequency of a compressor is fixed.


# 6. ELECTRICAL DATA

## 6-1. Electric Wiring Diagrams


Outdoor Unit CU-3KE19NBU

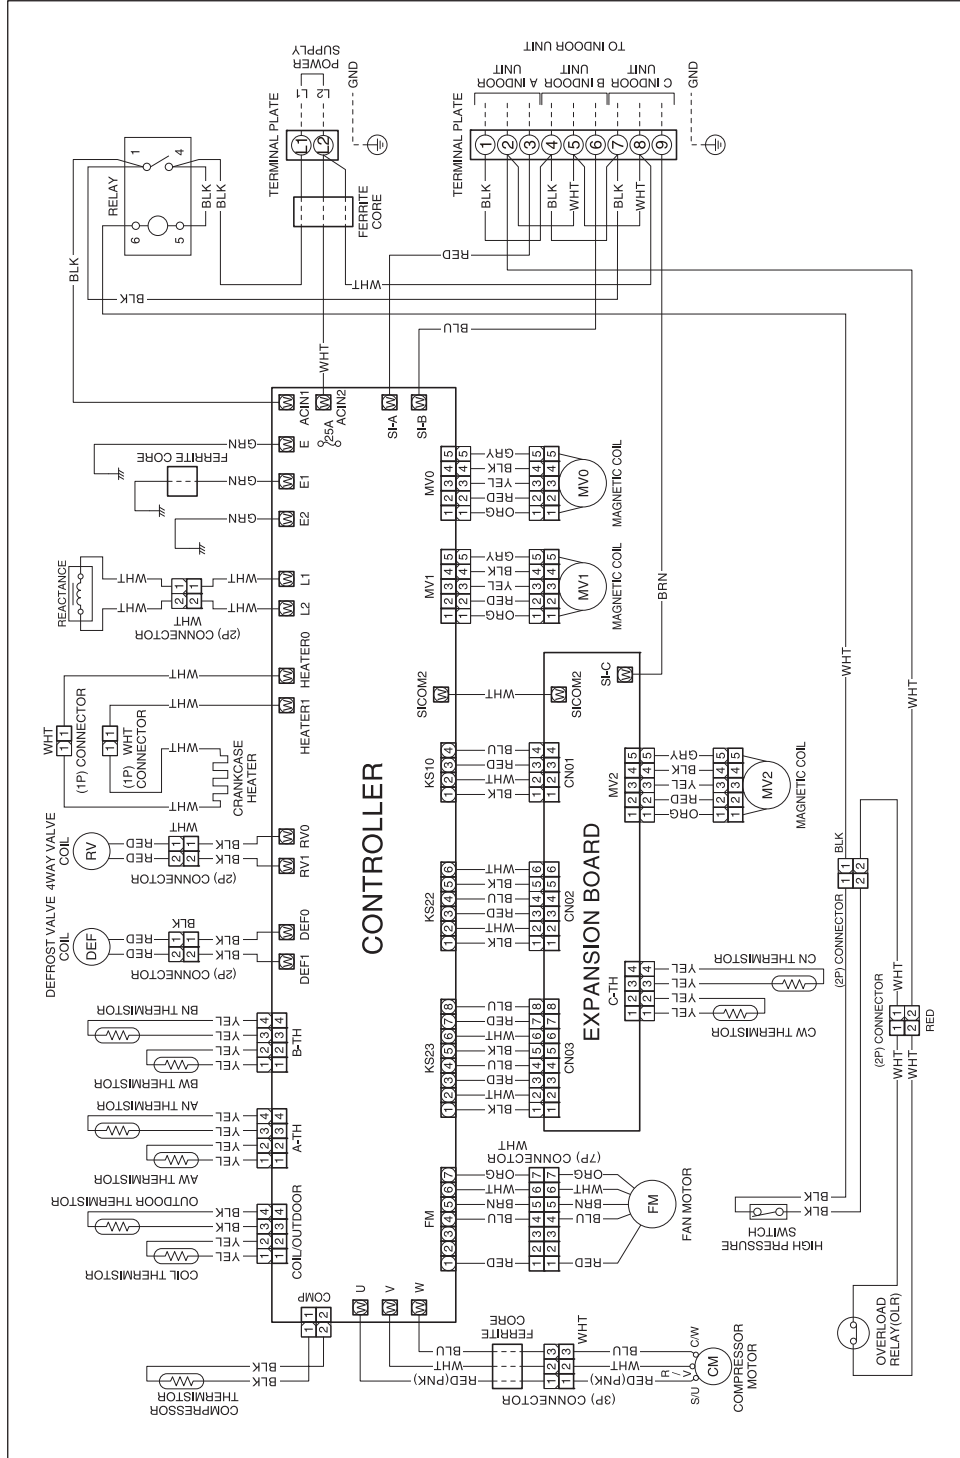

8FA2-5251-11700-1

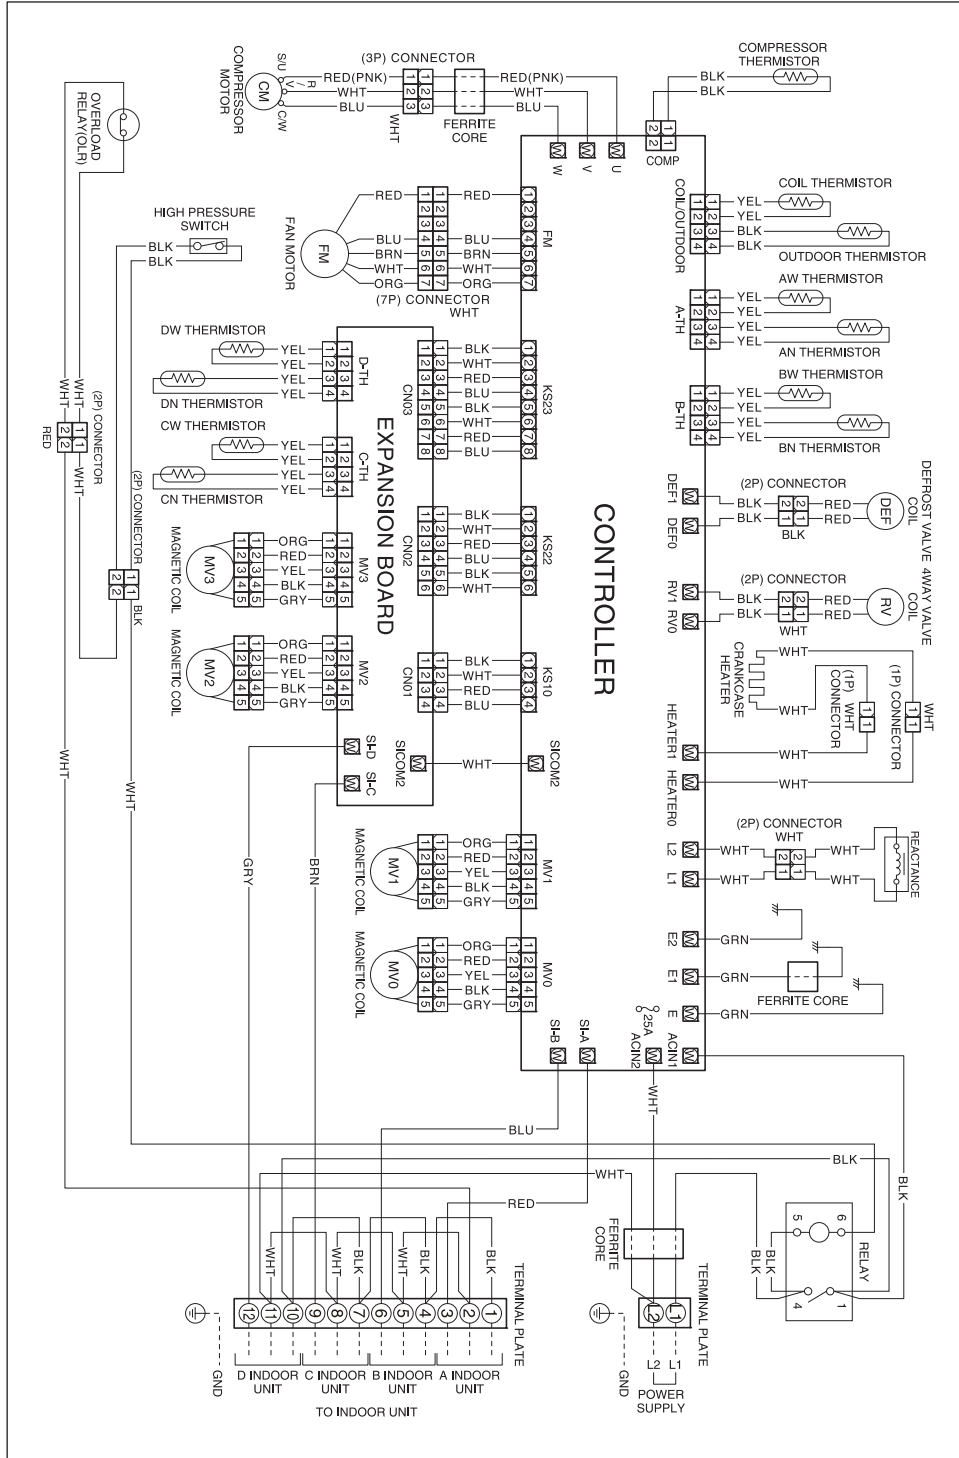

8FA2-5251-11500-1

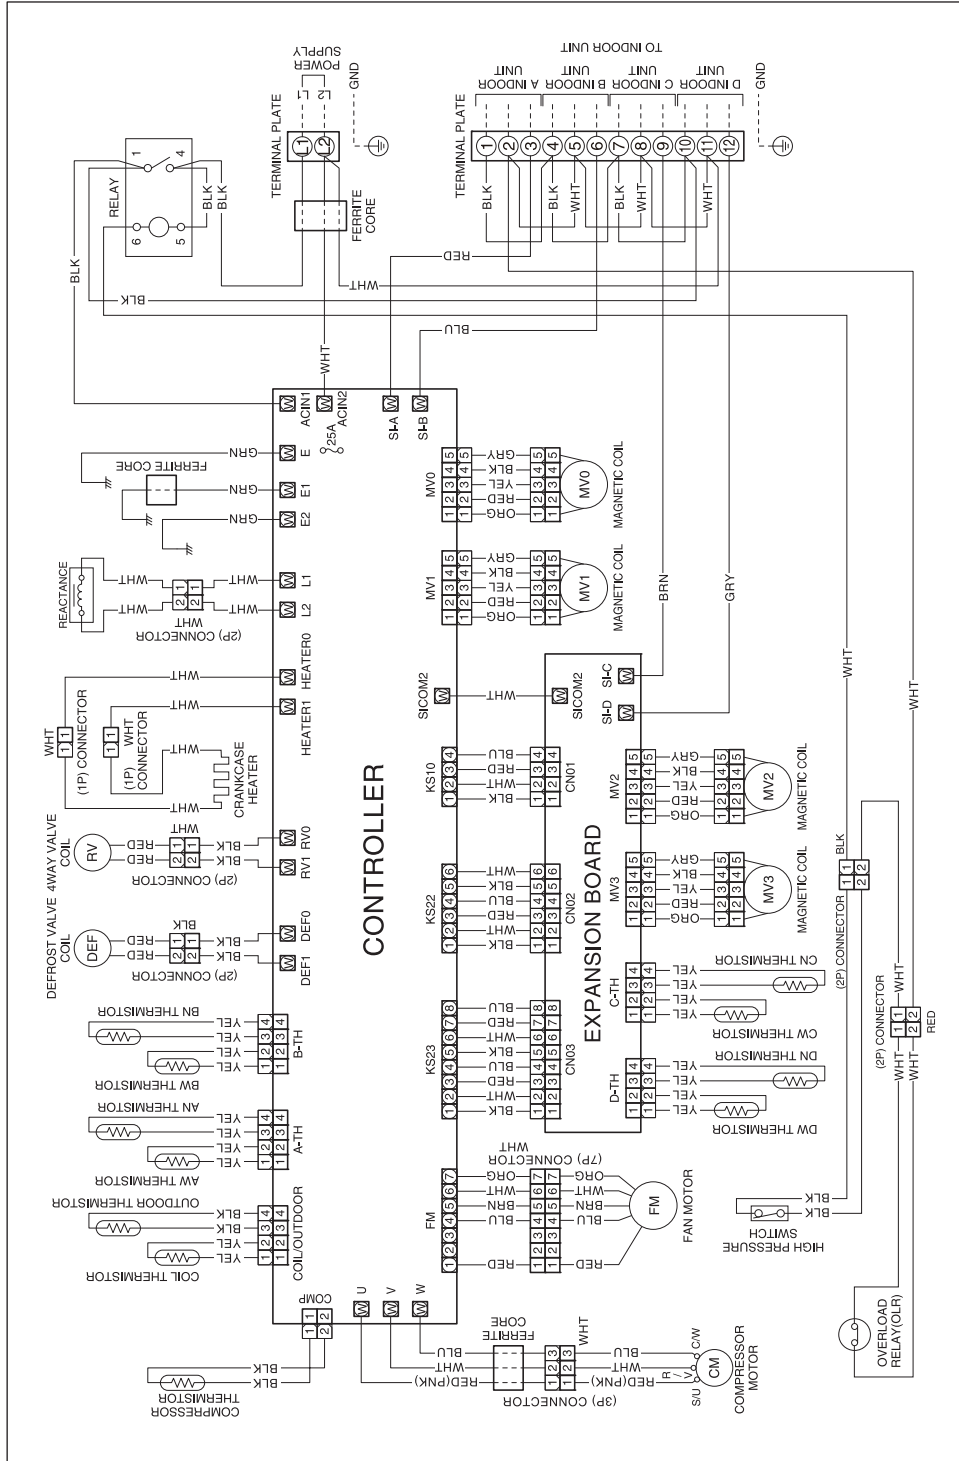



8FA2-5251-11300-1

# 7. FUNCTIONS

## 7-1. Explanation of Functions

**NOTE** The numerical values such as temperature, frequency, time and current in parentheses are an example of CU-4KE31NBU and the values are different from the other models.

	Control/conditions	Unit operation	Explanation
INITIAL	Breaker is ON.	_____	Power is supplied to the indoor and outdoor unit control circuits, however the unit remains stopped. Positioning of the outdoor unit electric expansion valve is performed.
	The ON/OFF operation button on the remote controller is pressed.	If automatic operation mode has been selected with the remote controller, operation begins in HEAT, SENSOR DRY, or COOL mode depending on the room temperature and outdoor temperature at the time operation starts.	<ul style="list-style-type: none"> <li>This applies in the case of automatic HEAT/COOL operation.</li> </ul>
	 Depending on the operational mode, refer to the HEAT, SENSOR DRY, or COOL item.		
HEAT	The ON/OFF operation button on the remote controller is pressed.	<ul style="list-style-type: none"> <li>Operation lamp illuminates.</li> <li>Indoor fan is stopped to prevent cold air from being emitted.</li> <li>Outdoor unit begins operating after forced-stop is canceled.</li> </ul>	<ul style="list-style-type: none"> <li>The unit is forced to stop for 3 minutes after the power is turned ON, or 3 minutes after the compressor stops, in order to protect the compressor.</li> </ul> The frequency is increased at the rate of 1 Hz every 0.5 seconds.
		<ul style="list-style-type: none"> <li>When the indoor coil temperature rises,               <ul style="list-style-type: none"> <li>the compressor starts,</li> <li>the outdoor fan starts,</li> <li>and the indoor fan changes from "LL" to the set fan speed.</li> </ul> </li> </ul>	<ul style="list-style-type: none"> <li>Depending on the relationship between the remote controller temperature setting and the room temperature, the compressor may stop temporarily (in other words, the thermostat may turn OFF).</li> </ul>
		When the frequency reaches $\alpha$ Hz, frequency increases are stopped for a period of $\beta$ seconds. (Refer to Table 2 "Frequency control".)	This is in order to stabilize the return of oil to the compressor.
		The frequency then increases.	If the indoor and outdoor temperatures are high, the current peak cut-off activates, stopping any increases in frequency.
	The room temperature has reached the desired temperature.	<ul style="list-style-type: none"> <li>The indoor temperature and the remote controller temperature setting are approximately equal.</li> </ul>	Operating frequency is stabilized in order to maintain a comfortable environment.
	The thermostat turns OFF.	<ul style="list-style-type: none"> <li>The indoor fan is stopped.</li> </ul>	<ul style="list-style-type: none"> <li>The outdoor unit stops. (It does not stop if the thermostat for another indoor unit is ON.)</li> <li>Approximately 30 seconds after the thermostat turns OFF, the indoor fan is stopped.</li> </ul>
	The indoor and outdoor temperatures are high.	In order to protect the compressor, the outdoor unit will not operate for 3 minutes after the thermostat turns OFF, even if the room temperature drops below the desired temperature.	<ul style="list-style-type: none"> <li>The outdoor unit starts automatically after 3 minutes.</li> <li>During these 3 minutes, a low-pressure pressure balance is achieved, allowing the compressor to start more easily.</li> </ul>
<ul style="list-style-type: none"> <li>The frequency is not increased, even if there is a difference between the room temperature and the desired temperature. In some cases, the frequency may be decreased.</li> </ul>		<ul style="list-style-type: none"> <li>The amount of heat pump exceeds the amount of heat radiation from the room. Therefore, there is no need to further increase the compressor capacity, and the frequency is stabilized or lowered.</li> </ul>	

	Control/conditions	Unit operation	Explanation	
HEAT	The thermostat turns ON.	<ul style="list-style-type: none"> <li>The indoor unit is stopped.</li> </ul>	The unit operated before, and the temperature of the indoor heat exchanger is relatively warm. Therefore, the fan speed may start at the set fan speed at the same time that the thermostat turns ON.	
	When defrost operation begins, frost has formed on the outdoor unit (when the ambient air temperature is low).	<b>Non-stop defrost</b> <ul style="list-style-type: none"> <li>Indoor fan : Stopped</li> <li>Outdoor fan : Stopped</li> <li>Compressor : 80 Hz</li> <li>Solenoid valve (for hot gas bypass): ON</li> <li>4-way valve : Remains ON</li> <li>Operation lamp : Red and orange ON alternately</li> </ul>	Defrost operation begins based on outdoor heat exchanger temperature and outdoor air temperature conditions.  <b>Non-stop defrost</b> (Refer to Fig. 1) 1. After HEAT operation begins, the temperature of the outdoor heat exchanger is at or below the L1 line for 35 minutes. (If outdoor air temperature is less than 26.6 °F, the time is 48 minutes) 2. After HEAT operation begins, the temperature of the outdoor heat exchanger is at or below the L2 line for 120 minutes.	
				The 4-way valve remains ON during defrost.
				<ul style="list-style-type: none"> <li>The outdoor fan stops and the solenoid valve turns ON, allowing the refrigerant to bypass the indoor unit.</li> </ul>
				<ul style="list-style-type: none"> <li>The operating frequency during defrost is 80 Hz. (Frequency is lowered if the current peak cut-off function is activated.)</li> </ul>
				<ul style="list-style-type: none"> <li>The maximum length of a single defrost operation is 12 minutes.</li> <li>For the outdoor heat exchanger temperature conditions for ending defrost, refer to Table 1.</li> </ul>
	Defrost release	<ul style="list-style-type: none"> <li>Indoor fan turns ON.</li> <li>After 10 seconds, the solenoid valve (for hot gas bypass) turns OFF.</li> </ul> <div style="text-align: center;">  </div> <ul style="list-style-type: none"> <li>When the cold air feel has disappeared, the indoor fan starts and gradually increases speed until it reaches the set speed.</li> </ul>	_____	
<b>STOP</b> <b>[Clean defrost]</b> Defrost is performed when the outdoor unit is stopped, and the temperature of the outdoor unit coil is at or below the L1 line. (Refer to Fig. 1.)	All indicator lamps turn OFF. The indoor and outdoor units stop.	_____		
Operation is restarted within 4 hours (only when AUTO mode is selected with the remote controller).	Starts operating in the same operating mode (HEAT) and with the same temperature settings as before operation was stopped.	Within 4 hours after operation was stopped, it is assumed that there has been no significant change in the indoor and outdoor temperatures, and the previous conditions (HEAT) are stored.		
Operation starts after 4 hours or more have passed.	New operation begins based on the temperature conditions at the time the ON/OFF button is pressed.	_____		

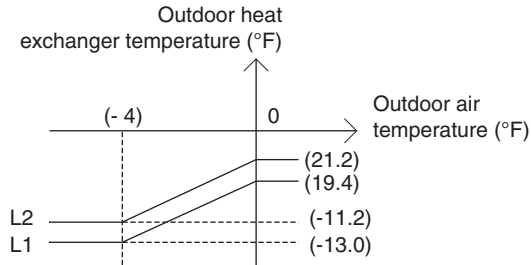


Fig. 1

Temperature of releasing

Defrost operation time	Less than 2 minutes	2 minutes or more
Heat exchanger temperature for releasing defrosting	No releasing	57.2 °F or higher (*1)

\*1 The temperature for releasing of defrosting is (68 °F) or higher when the outdoor air temperature is less than 32 °F.

Table 1

	Control/conditions	Unit operation	Explanation
COOL	The ON/OFF operation button on the remote controller is pressed.	<ul style="list-style-type: none"> <li>The operation lamp illuminates.</li> <li>The indoor fan operates at the set fan speed.</li> <li>The outdoor unit stops.</li> </ul>	The outdoor unit does not operate for 3 minutes even after the breaker is turned ON.
		The outdoor unit starts.  (Compressor and the outdoor fan start.)	<ul style="list-style-type: none"> <li>The frequency is increased at the rate of 0.5 Hz every 1 seconds.</li> </ul>
		When the frequency reaches $\alpha$ Hz, frequency increases are stopped for a period of $\beta$ seconds. (Refer to Table 2.)	This is in order to stabilize the return of oil to the compressor.
		The frequency then increases.	If the indoor and outdoor temperatures are high, the current peak cut-off activates, stopping any increases in frequency.
	The room temperature has reached the desired temperature.	The indoor temperature and the desired temperature are approximately equal.	Operating frequency is stabilized in order to maintain a comfortable environment.
	The thermostat turns OFF.	_____	The outdoor unit stops. (It does not stop if the thermostat for another indoor unit is ON.)
	The thermostat turns ON again.	After the thermostat turns ON again, the outdoor unit will not operate for 3 minutes, even if the room temperature increases above the desired temperature.	After 3 minutes, the outdoor unit begins operating automatically.  During these 3 minutes, a pressure balance is achieved, allowing the compressor to start more easily.
	Freeze prevention	<ul style="list-style-type: none"> <li>When the temperature of the indoor heat exchanger drops to approximately 35.6 °F or below, the compressor turns OFF, the outdoor fan turns OFF, and the indoor fan continues operating with no changes.</li> </ul> <p style="text-align: center;">↓</p> <ul style="list-style-type: none"> <li>Approximately 3 minutes later, if the temperature of the indoor heat exchanger is above 46.4 °F, the system returns to its original conditions.</li> </ul>	In order to protect against freezing, the compressor stops temporarily, until the temperature of the indoor heat exchanger has risen.
	Stop	All indicator lamps turn OFF. The indoor and outdoor units stop.	_____
Operation is restarted within 4 hours (only when AUTO mode is selected with the remote controller).	Starts operating in the same operating mode (COOL) and with the same temperature settings as before operation was stopped.	Within 4 hours after operation was stopped, it is assumed that there has been no significant change in the indoor and outdoor temperatures, and the previous conditions (COOL) are stored.	
Operation starts after 4 hours or more have passed.	New operating mode is determined based on the temperature conditions at the time the ON/OFF operation button is pressed.	_____	

Frequency control

$\alpha$ (Hz)	$\beta$ (seconds)	
	Outdoor air temperature is below 32 °F.	Outdoor air temperature is 32 °F or higher.
(25) Hz	(120) seconds	(60) seconds
(35) Hz	(60) seconds	(30) seconds
(45) Hz	(60) seconds	(30) seconds
(55) Hz	(180) seconds	(90) seconds

**Table 2**

**(1/f fluctuation fan)**

	<b>Control/conditions</b>	<b>Unit operation</b>	<b>Explanation</b>
<b>SENSOR DRY</b>	The ON/OFF operation button on the remote controller is pressed.	<ul style="list-style-type: none"> <li>● The operation lamp illuminates.</li> <li>● The indoor fan operates at the set fan speed.</li> <li>● The outdoor unit stops.</li> </ul>	The outdoor unit does not operate for 3 minutes even after the breaker is turned ON.
		<p>The outdoor unit starts.</p> <p>(Compressor and the outdoor fan start.)</p>	<ul style="list-style-type: none"> <li>● The frequency is increased at the rate of 0.5 Hz every 1 seconds.</li> </ul>
		<p>When the frequency reaches <math>\alpha</math> Hz, frequency increases are stopped for a period of <math>\beta</math> seconds. (Refer to Table 2.)</p>	This is in order to stabilize the return of oil to the compressor.
		<p>The frequency then increases.</p>	If the indoor and outdoor temperatures are high, the current peak cut-off activates, stopping any increases in frequency.
	<p>The room temperature reaches the desired temperature, and there is no need for further cooling.</p>	<ul style="list-style-type: none"> <li>● DRY operation starts</li> </ul> <p><b>DRY A operation</b></p> <ul style="list-style-type: none"> <li>● The indoor fan changes between "Low" and "LL" (very low) over a 6-minute cycle. This is 1/f fluctuation fan operation. (Refer to Fig. 2.)</li> </ul>	<p>Operating frequency is stabilized in order to maintain a comfortable environment.</p> <ul style="list-style-type: none"> <li>● Operates to effectively dehumidify the air while not excessively reducing the indoor temperature.</li> <li>● The indoor unit operates at 1/f fluctuation fan operation, at a fan speed that does not cause a chilly feeling.</li> </ul>
	<p>The room temperature is 59 °F or higher, and is slightly too cold.</p>	<p><b>DRY B operation</b></p> <p>(1) The indoor fan changes between "Low" and "LL" (very low) over a 6-minute cycle. This is 1/f fluctuation fan operation.</p> <p style="text-align: center;">↓</p> <p>(2) After approximately 3 minutes, the compressor turns OFF, the outdoor fan turns OFF, and the indoor fan turns OFF.</p> <p style="text-align: center;">↓</p> <p>(3) After approximately 6 minutes, the conditions return to (1).</p>	<p>The compressor operates on a 3-minutes ON, 6-minutes OFF cycle, to prevent the room temperature from dropping too much.</p>
	<p>The room temperature is below 59 °F.</p>	<ul style="list-style-type: none"> <li>● Monitoring operation begins.</li> </ul>	<p>When monitoring operation begins, the compressor stops, and the indoor fan operates at "LL" (very low) speed.</p>

● 1/f fluctuation fan


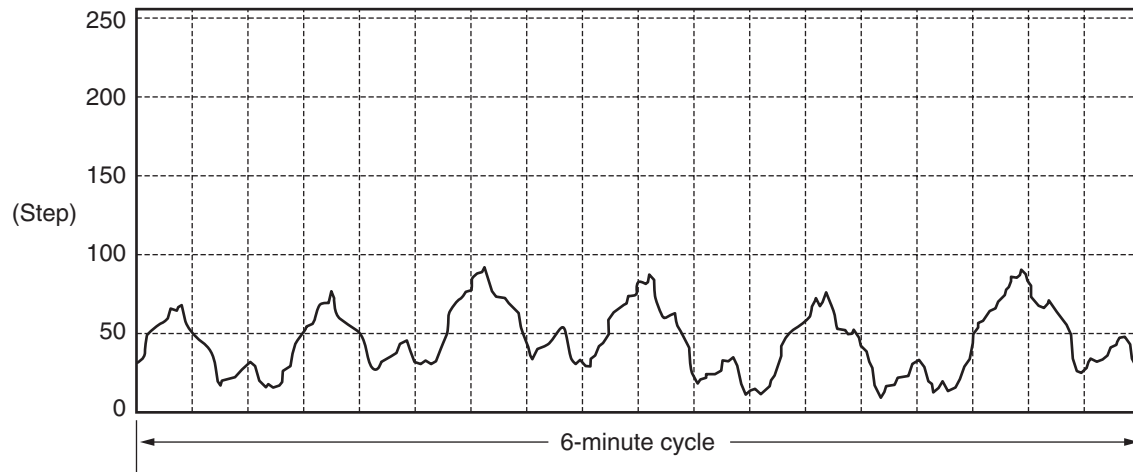



Fig. 2

## < Low Ambient Cooling Operation >

- When the outdoor air temperature reaches 57.2 °F (14 °C ) or less during the cooling operation, the operation mode is switched to low ambient cooling operation.
- When the mode is switched from cooling operation to low ambient cooling operation, the compressor is stopped for 150 seconds temporarily.
- When the mode has been switched to low ambient cooling operation, the outdoor fan speed is lowered as the outdoor air temperature falls.

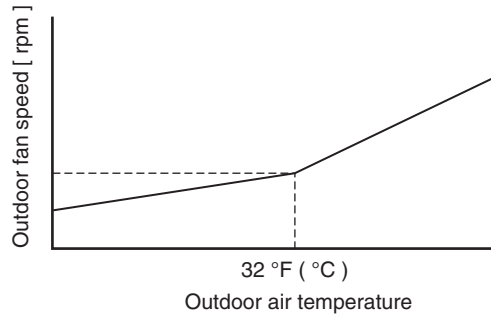

- When the outdoor air temperature reaches 62.6 °F (17 °C ) or more during the low ambient cooling operation, the operation mode is switched to cooling operation.
- The following protective actions are available to prevent the compressor from operating with abnormal loads.  
At that time, they initiate thermo-off ( stopping the outdoor unit ) of the air conditioner.

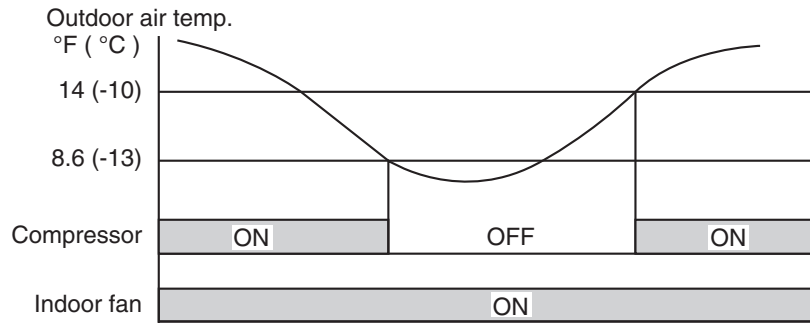


## 7-2. Protective Functions

**NOTE** The numerical values such as temperature, frequency, time and current in parentheses are an example of CU-4KE31NBU and the values are different from the other models.

### 7-2-1. Defrost Detection and Release

#### (1) Non-stop defrosting

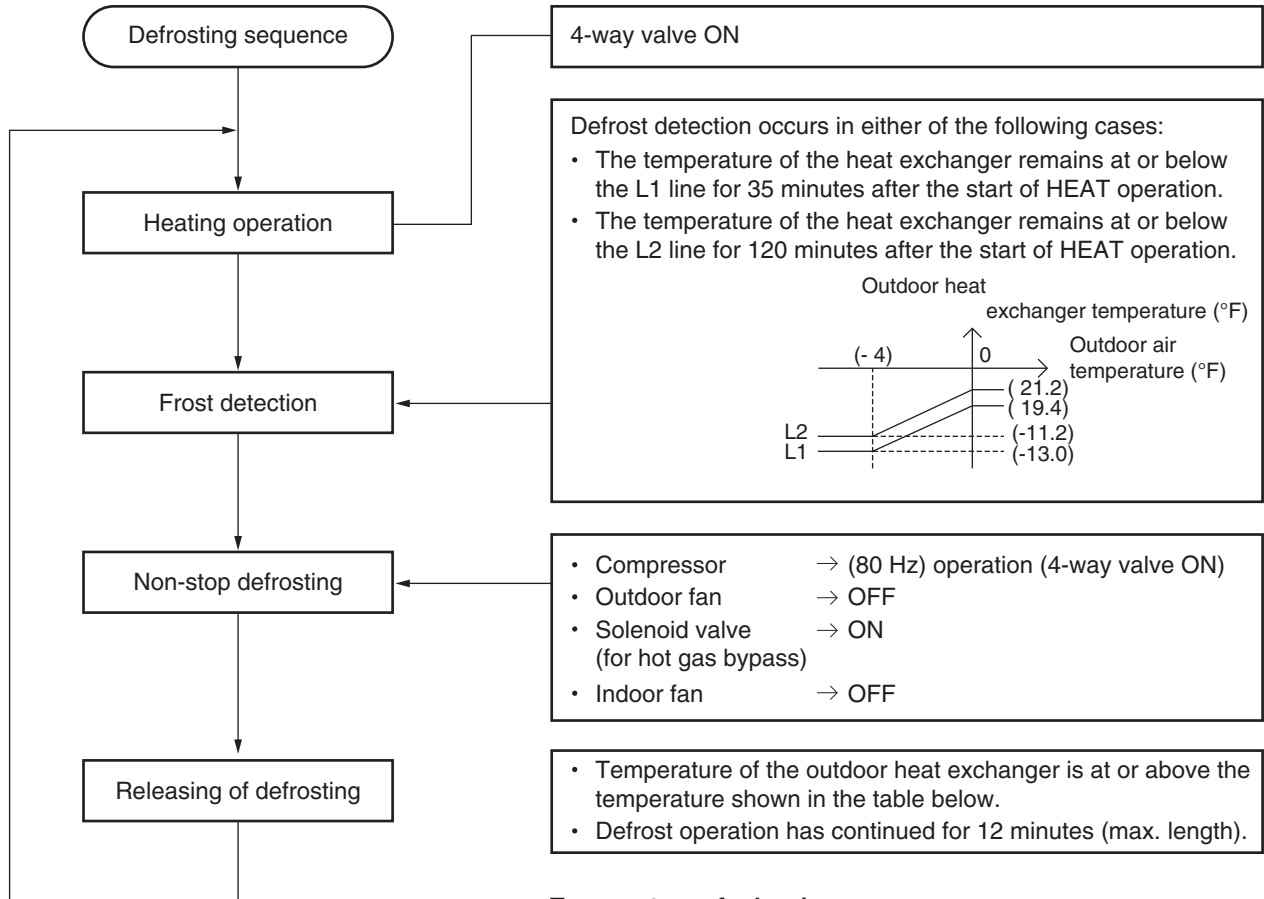

#### Temperature of releasing

Defrost operation time	Less than 2 minutes	2 minutes or more
Heat exchanger temperature for releasing defrosting	No releasing	57.2 °F or higher (*1)

\*1 The temperature for releasing of defrosting is (68 °F) or higher when the outdoor air temperature is less than 32 °F.

**NOTE** Defrost does not occur during **HIGH POWER** operation.


If other stopped indoor units are started during defrost operation, they begin operating in defrost mode.

#### (2) Clean defrost

If all indoor units are stopped during HEAT operation, and frost is detected at the L1 line, and the conditions for defrost are met, then defrost operation occurs, and the unit stops after defrost is completed.


## 7-2-2. Current Control

- The operating current may rise as a result of causes including increasing heating or cooling loads or decreases in power voltage. In these cases, the operating frequency is automatically reduced, or operation is stopped, in order to control the operating current so that it is (20 A) or less.

As a result: 

- Power breakers and fuses will not be tripped.
- Operation can continue during this period with somewhat reduced heating or cooling capacity.
- Operation at normal capacity is restored when the cause of the current rise is eliminated.

### Description of function

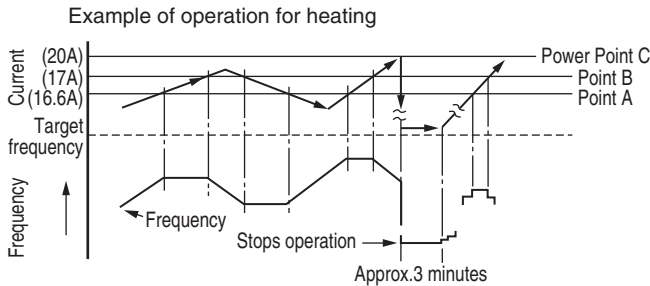

- Operates at the target frequency at Point A and below.
- Stops increases to the frequency between Points A and B.
- Reduces the frequency by 1 Hz per 0.5 seconds when Point B is exceeded.
- Stops operation, and restarts it approximately 3 minutes later, if Point C is exceeded.  
(May operate when sudden voltage fluctuations occur. → Indicates trouble.)

### (1) Automatic frequency control


The operating frequency is reduced automatically, or operation is stopped, in order to control the operating current so that it is at or below the values shown in the table below.

	(20A)	
	HEAT	COOL
Point C (peak cut trip)	(20.0)	(20.0)
Point B (Hz reduction)	(17.0)	(17.0)
Point A (Hz increase prohibit)	(16.6)	(16.6)

**NOTE** During defrost operation, the COOL current setting value is used.

### (2) Current control

The operating frequency upper limits shown in the figure below are established for frequency reduction and increase-prohibit.

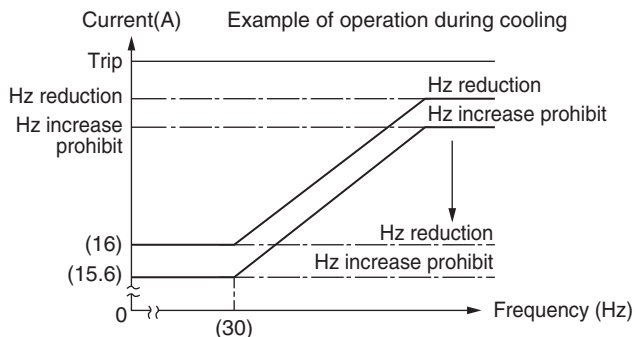


### 7-2-3. Low Start Current

Operation starts at (8 Hz), and the start current is less than the normal operating current. This prevents the flickering of fluorescent lights or television screens that occurs when ordinary A/C units start.

### 7-2-4. Compressor Temperature Control

To protect the compressor coil from overheating, the operating frequency is controlled based on the compressor discharge temperature.

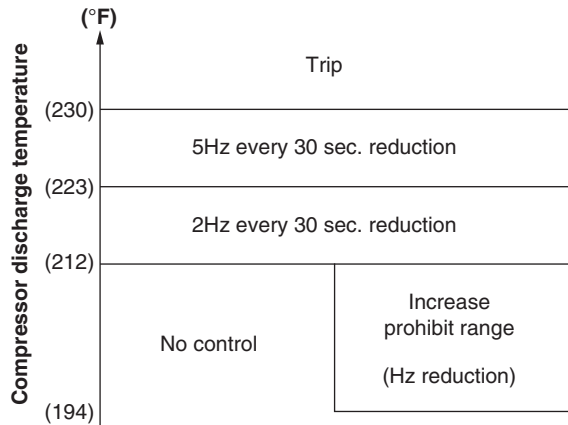

\* Within the increase-prohibit range, the range changes to the Hz reduction range (2 Hz every 30 seconds) if the compressor temperature rises by 4 °F.

### 7-2-5. Control at HEAT Start-up

If HEAT operation is started when the outdoor air temperature is 59 °F or below, the unit operates at the HEAT start-up frequency (70 Hz or above).

#### Reset conditions

- (1) The compressor frequency exceeds the start-up frequency of (70 Hz).
- (2) The compressor thermostat is OFF.
- (3) Frequency reduction for indoor high-load control has occurred.
- (4) The outdoor air temperature is above 59 °F.
- (5) The main-unit switch on one or more indoor units is set to TEST run.

## 8. TROUBLESHOOTING (BEFORE CALLING FOR SERVICE)

### 8-1. Precautions before Performing Inspection or Repair

■ **Both the indoor unit and outdoor unit include electronic control circuits.**

**Be sure to pay attention to the following before inspecting or repairing the outdoor-side electronic circuits.**

- High-capacity electrolytic capacitors are used inside the outdoor unit controller (inverter). They retain an electrical charge (charging voltage DC 311 V) even after the power is turned OFF, and some time is required for the charge to dissipate.

Be careful not to touch any electrified parts before the control circuit board Power Lamp (red) turns OFF.

If the outdoor control circuit board is normal, approximately 180 seconds will be required for the charge to dissipate. However, allow at least 30 minutes for the charge to dissipate if it is thought there might be trouble with the outdoor control circuit board.

For example, if the outdoor control circuit board fuse has blown, approximately 30 minutes will be required to discharge the high-capacity electrolytic capacitors.

## 8-2. Trouble Diagnosis by Error Monitor Lamps



### Warning


To prevent electric shock, do not inspect or repair until the Power Lamp on the P.C.Board is turned off.



### 8-2-1. Location of the Error Monitor Lamps

Remove the top plate of outdoor unit and the cover of Electrical Component Box.

The Power Lamp and Error Monitor Lamps are located on the P.C.Board of Electrical Component Box. (Fig.1)

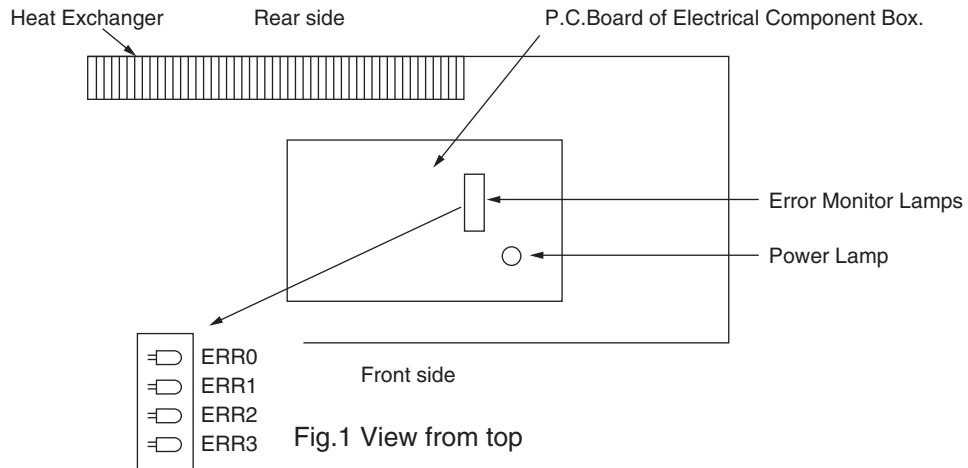

### 8-2-2. Display of the Error Monitor Lamps

If a protective device has activated or there is a sensor failure in the outdoor unit, the 4 error monitor lamps on the outdoor control circuit board will indicate the nature of the trouble.

○ : ON    × : OFF

Error Monitor Lamp				Error Contents
ERR0	ERR1	ERR2	ERR3	
○	×	×	○	Sensor for compressor discharge temp
×	○	×	○	Sensor for heat exchange temp
○	×	×	×	Sensor for branch pipe A (Narrow tube)
×	○	×	×	Sensor for branch pipe B (Narrow tube)
○	○	×	×	Sensor for branch pipe C (Narrow tube)
×	×	○	×	Sensor for branch pipe D (Narrow tube)
○	○	×	○	Outdoor temp sensor
○	×	○	×	Sensor for branch pipe A (Wide tube)
×	○	○	×	Sensor for branch pipe B (Wide tube)
○	○	○	×	Sensor for branch pipe C (Wide tube)
×	×	×	○	Sensor for branch pipe D (Wide tube)
×	×	○	○	HIC circuit trouble (current, temp)
×	○	○	○	Actuation of comp over load relay
○	×	○	○	Actuation of freeze protection function
○	○	○	○	Outdoor unit error. Detail of error message indicate on indoor LED

## 8-3. Checking the Outdoor System

### 8-3-1. Checking the outdoor unit

No.	Work procedure	Check items (unit operation)
1	<ul style="list-style-type: none"> <li>Apply 220 V AC between terminals L1 and L2 on the outdoor unit terminal plate.</li> </ul>	<ul style="list-style-type: none"> <li>The LED (red) on the control board must illuminate.</li> </ul>
2	<ul style="list-style-type: none"> <li>Short-circuit the T-RUN terminal to the COM terminal of TEST/T-RUN terminals.</li> </ul>	<ul style="list-style-type: none"> <li>The compressor, fan motor, 4-way valve, and solenoid valve (for the hot gas bypass) must turn ON. (They turn ON about (70) seconds later after the power is turned ON.)</li> </ul>

**NOTE** If the above check items are okay, but the outdoor unit does not operate, there may be a faulty connection between the indoor unit and the outdoor unit.

### 8-3-2. Checking the defrost operation

- Using forced defrost operation to check this function.

No.	Work procedure	Check items (unit operation)
1	<ul style="list-style-type: none"> <li>Connect a dummy resistor of 39 k ohm to the outdoor coil temperature sensor connector.</li> </ul>	<p>■ <b>Non-stop defrost</b></p> <p>The diagram illustrates the timing of various components during a non-stop defrost cycle. It is divided into three phases: 'Setting', 'Defrost start', and 'Release'.      - <b>Indoor fan:</b> During the 'Setting' phase, it runs for 30 seconds, then stops. At 'Release', it runs again for 30 seconds.      - <b>CM (Compressor Motor):</b> Operates at 80 Hz during the 'Setting' phase and remains ON throughout the 'Defrost start' phase.      - <b>Solenoid valve (for hot gas bypass):</b> Is OFF during 'Setting' and 'Defrost start'. It turns ON for 5 seconds at the start of 'Defrost start' and turns OFF for 10 seconds at the start of 'Release'.      - <b>Outdoor fan:</b> Is ON during 'Setting', turns OFF at the start of 'Defrost start', and turns ON again at the start of 'Release'.</p> <ul style="list-style-type: none"> <li>The maximum length of defrost operation is 12 minutes.</li> <li>Defrost can also be released based on the below conditions for the outdoor heat exchanger sensor.             <ul style="list-style-type: none"> <li>Less than 2 minutes → Not released</li> <li>2 minutes or more → 57.2 °F or higher (*1)</li> </ul> </li> <li>*1 However, the condition is (68 °F) or higher when the outdoor air temperature is below 32 °F.</li> </ul>

## 8-4. Trouble Diagnosis of Each Part

### 8-4-1. Problems of Each Part and Inspection Points

- For details about the inspection points, refer to the Inspection Points for Each Part.

Problems		Indoor unit				Outdoor unit								Others			No. of Inspection Points for Each part	
		Indoor unit does not operate.	Operation lamp blinking.	Operation lamp does not illuminate.	Indoor fan dose not turn.	Outdoor unit does not operate.	Outdoor fan dose not turn.	4-way valve does not operate.	The compressor (only) does not operate.	The compressor stops on occasion.	The compressor speed does not increase.	The outdoor air temperature is high, however defrost operation occurs.	Defrost operation does not occur.	The electric expansion valve does not operate.	Does not cool or cooling performance is inadequate.	Does not heat or heating performance is inadequate.		
Self-Diagnostics check			○		○	○	○		○									
Indoor unit	Indoor controller (control unit)	○	○	○	○	○												
	Indoor fan motor		○		○													
	Room temperature sensor		○															
	Heat exchanger temperature sensor		○		○													
	Inter-unit cable		○			○	○	○	○	○								
	Switch circuit board	○		○														
Outdoor unit	Outdoor control circuit board		○			○	○	○	○	○	○							(1)
	Diode module		○			○												
	HIC		○			○												
	Electrolytic capacitor		○			○												
	Fuse		○			○												(2)
	Compressor		○			○	○	○	○	○								(3)
	Compressor protective sensor		○			○			○	○								(4)
	Outdoor fan motor		○			○	○				○							
	4-way valve							○										(5)
	Coil thermistor		○			○					○	○						(6)
Electric expansion valve												○	○	○			(7)	
Branch tubing temperature sensor		○															(8)	

Problems Inspection points		Indoor unit				Outdoor unit								Others		No. of Inspection Points for Each part	
		Indoor unit does not operate.	Operation lamp blinking.	Operation lamp does not illuminate.	Indoor fan dose not turn.	Outdoor unit does not operate.	Outdoor fan dose not turn.	4-way valve does not operate.	The compressor (only) does not operate.	The compressor stops on occasion.	The compressor speed does not increase.	The outdoor air temperature is high, however defrost operation occurs.	Defrost operation does not occur.	The electric expansion valve does not operate.	Does not cool or cooling performance is inadequate.		Does not heat or heating performance is inadequate.
Others	Breaker	<input type="radio"/>				<input type="radio"/>											(9)
	Refrigerant gas pressure								<input type="radio"/>						<input type="radio"/>	<input type="radio"/>	(10)

## 8-4-2. Inspection Points for Each Part

### (1) Outdoor control circuit board

Refer to "8-3-1. Checking the outdoor unit".

**NOTE** Do not remove or insert the outdoor control circuit board connector when power is being supplied to it.

(The controller will be damaged.)

### (2) Fuse

Check it visually or the continuity with a tester.

### (3) Compressor

Check for an open circuit in the compressor coil winding.

### (4) Compressor protective sensor (compressor discharge temperature thermistor)

Check that the sensor is securely contained in the thermostart holder.

### (5) 4-way valve


Short-circuit the T-RUN terminal to the COM terminal of TEST/T-RUN terminals. Perform a test run of the unit alone, and check whether the 4-way valve inside the outdoor unit produces a click sound.

### (6) Coil thermistor

Check that the sensor is securely contained in the thermostat holder.

## (7) Electric expansion valve

- When replacing the electric expansion valve and coil, be sure to attach the connectors in the correct positions. Labels are applied to the valve body and coil, corresponding to the connector colors, to identify them.

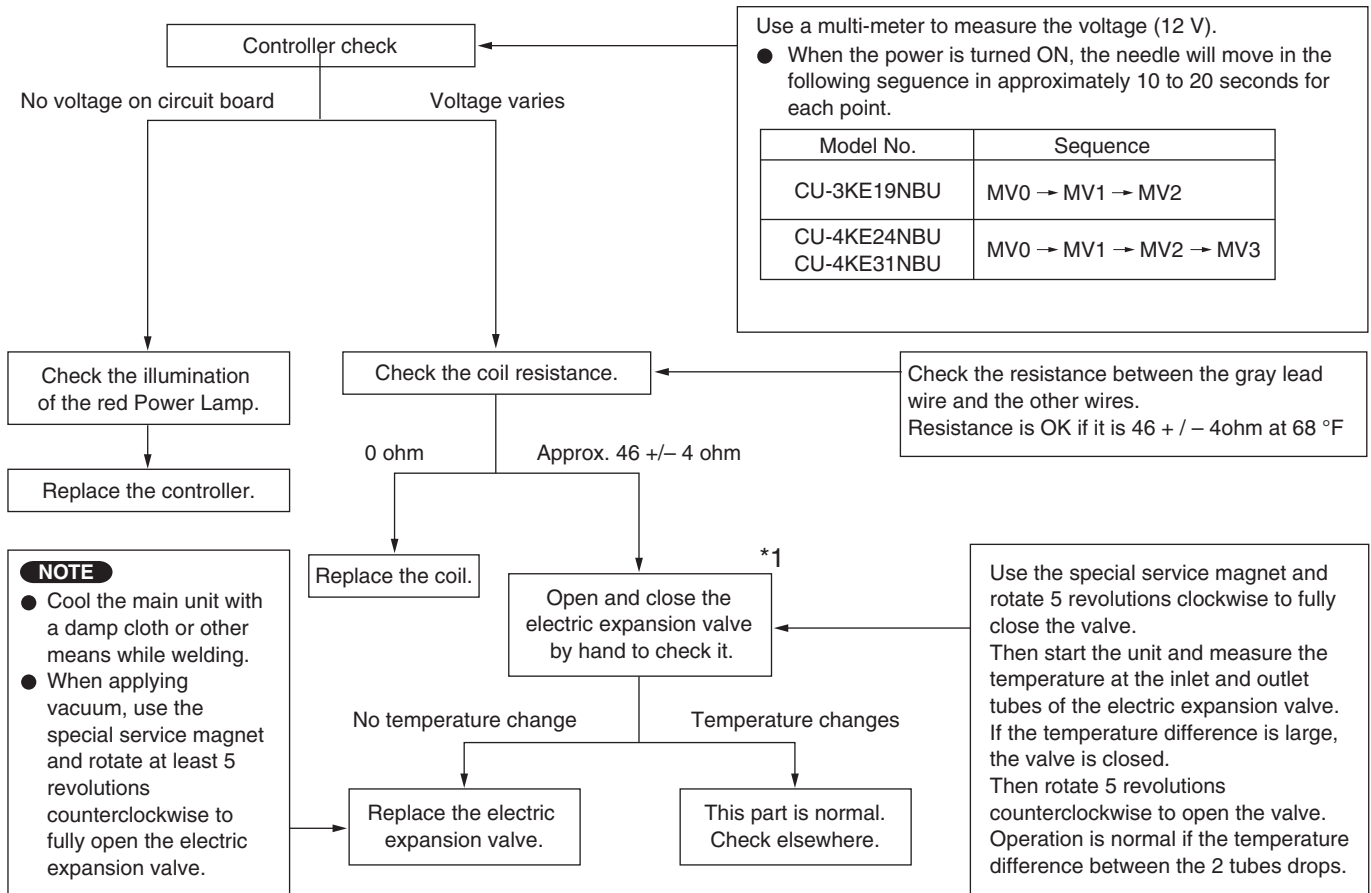

\*1 If you have manually checked the electric expansion valve, be sure to reapply the outdoor power after you have replaced the wiring. (The position of the electric expansion valve will change.)

### **(8) Branch tubing temperature sensor**

Check that the sensor is securely contained in the thermostat holder.

### **(9) Breaker**

Check whether or not the breaker has been tripped.

- Check that the breakers and fuses used are of the specified capacity.
- Check that the breaker and its line are exclusive for A/C use.

### **(10) Refrigerant gas pressure**

Start a COOL test run, and measure the temperatures of the A/C intake air and discharge air. Compare the values with the performance charts.

- If the values are higher than the performance charts:

Check for refrigerant shortage or blockage of the refrigerant circuit.

< Assessment of refrigerant shortage >

1. The pressure in the low-pressure section is 5 MPa or more below the value in the performance charts.
2. There is little condensation on the indoor heat exchanger, which overall appears dry.

< Distinguishing between refrigerant shortage and refrigerant circuit blockage >

If the pressure in the low-pressure section does not change when the circuit is charged 2 to 3 times with refrigerant gas (0.44 lbs each time), or if the change is small, then the problem may not be refrigerant shortage.

The problem may be a blockage of the refrigerant circuit.

1. Check that there is no internal leakage inside the 4-way valve:

At the low-pressure side tubing, check that there is no temperature difference between the intake and discharge of the 4-way valve.

2. Check that the electric expansion valve is not blocked. Check as described on the preceding page.

## 8-5. Trouble Diagnosis of Fan Motor

- This outdoor DC fan motor contains an internal control PCB. Therefore, it is not possible to measure the coil resistance, and the following procedure should be used to check the motor.
- Perform the trouble diagnosis by Test Run mode described on Installation Instructions of indoor unit.

**Important:** (A) Turn OFF the power before connecting or disconnecting the motor connectors.

(B) When performing voltage measurement at the outdoor controller connector for (3) in the table below, the DC motor will trip and voltage output will stop approximately 10 seconds after operation is started. For this reason, to measure the voltage again, first turn OFF the outdoor unit power, then, measure the voltage in Test Run mode.

**[Trouble symptom 1]** The fan does not stop when the outdoor unit stops. → Outdoor unit controller trouble

**[Trouble symptom 2]** The fan motor does not rotate when the outdoor unit is operating.

**(Diagnostic procedure)**

- \* Disconnect the motor connectors and measure the voltage at the DC motor connectors on the outdoor unit controller (3 locations).

Measurement location	Normal value
(1) Vm-Gnd: Between pin 1 and pin 4	DC 230V or more
(2) Vcc-Gnd: Between pin 5 and pin 4	DC 14V or more
(3) Vsp-Gnd: Between pin 7 and pin 4	After fluctuating 4 times between DC 1.7 to 6.1V (1 sec. ON) and DC 0 V (1 sec. OFF), the DC motor trips.

**(Diagnostic results)**

All of the above measured values are normal. → Fan motor trouble (Replace the motor.)

Any one of the above measured values is not normal. → Outdoor unit controller trouble  
(Replace the controller .)

**(Reference)** DC motor connector pin arrangement

- Pin 1: Vm (red)
- Pin 2: Not used
- Pin 3: Not used
- Pin 4: Gnd (blue)
- Pin 5: Vcc (brown)
- Pin 6: PG (white)
- Pin 7: Vsp (orange)

**[Trouble symptom 3]** Motor rotates for some time (several seconds), but then quickly stops, when the outdoor unit operates.

(There is trouble in the system that provides feedback of motor rotation speed from the motor to the outdoor unit controller.)

**[Trouble symptom 4]** Fan motor rotation speed does not change during outdoor unit operation.

**[Trouble symptom 5]** Fan motor rotation speed varies excessively during outdoor unit operation.

**(Remedy for symptom 3 to 5)**

It is not possible to identify whether the trouble is outdoor unit controller trouble or motor trouble. Therefore, first replace the outdoor unit controller, then (if necessary) replace the DC motor.

## 9. REFRIGERANT R410A: SPECIAL PRECAUTIONS WHEN SERVICING UNIT

### 9-1. Characteristics of New Refrigerant R410A

#### 9-1-1. What is New Refrigerant R410A?

R410A is a new refrigerant that contains two types of pseudo-non-azeotropic refrigerant mixture. Its refrigeration capacity and energy efficiency are about the same level as the conventional refrigerant, R22.

#### 9-1-2. Components (mixing proportions)

HFC32 (50%) / HFC125 (50%)

#### 9-1-3. Characteristics

- Less toxic, more chemically stable refrigerant
- The composition of refrigerant R410A changes whether it is in a gaseous phase or liquid phase. Thus, when there is a refrigerant leak the basic performance of the air conditioner may be degraded because of a change in composition of the remaining refrigerant. **Therefore, do not add new refrigerant.** Instead, recover the remaining refrigerant with the refrigerant recovery unit. Then, after evacuation, totally recharge the specified amount of refrigerant with the new refrigerant at its normal mixed composition state (in liquid phase).
- When refrigerant R410A is used, the composition will differ depending on whether it is in gaseous or liquid phase, and the basic performance of the air conditioner will be degraded if it is charged while the refrigerant is in gaseous state. **Thus, always charge the refrigerant while it is in liquid phase.**



CAUTION


**Ether-type oil is used for compressor oil for R410A-type units, which is different from the mineral oil used for R22. Thus more attention to moisture prevention and faster replacement work compared with conventional models are required.**

## 9-2. Checklist before Servicing

Use a clutch-type flare tool for R410A or the conventional flare tool. Note that sizes of the resultant flares differ between these two tools. Where a conventional flare tool is used, make sure to observe A Specification (amount of extrusion) by using the flare spacer.

Diameter of tube D	Specification A	
	Flare tool for R410A	Conventional flare tool (for R22)
Dia. 1/4" (6.35 mm)	0 to 0.0196" (0 to 0.5 mm)	0.0472" (1.2 mm)
Dia. 3/8" (9.52 mm)		
Dia. 1/2" (12.7 mm)		
Dia. 5/8" (15.88 mm)		

### ● Size of flare

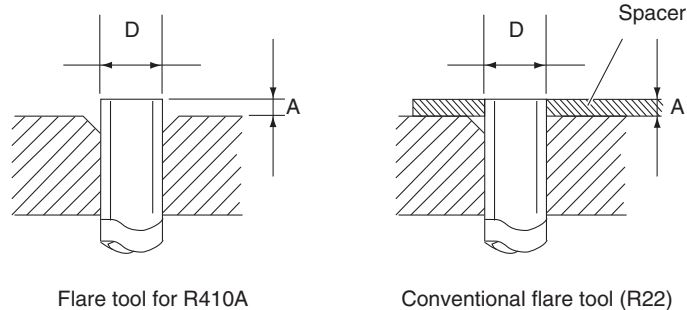

### ● Tubing precautions

- Refrigerant R410A is more easily affected by dust or moisture compared with R22, thus be sure to temporarily cover the ends of the tubing with caps or tape prior to installation.

Never use 0.0276" (0.7 mm)-thick copper tubing or tubing which is less than 0.0315" (0.8 mm) in thickness, since air conditioners with R410A are subject to higher pressure than those using R22 and R407C.

### ● No addition of compressor oil for R410A

No additional charge of compressor oil is permitted.

### ● No use of refrigerant other than R410A

Never use a refrigerant other than R410A.

### ● If refrigerant R410A is exposed to fire

Through welding, etc., toxic gas may be released when R410A refrigerant is exposed to fire. Therefore, be sure to provide ample ventilation during installation work.

### ● Caution in case of R410A leak

Check for possible leak points with the special leak detector for R410A. If a leak occurs inside the room, immediately provide thorough ventilation.

### 9-3. Tools Specifically for R410A

- For servicing, use the following tools for R410A

Tool Distinction	Tool Name
Tools specifically for R410A	<ul style="list-style-type: none"> <li>● Gauge manifold</li> <li>● Charging hose</li> <li>● Gas leak detector</li> <li>● Refrigerant cylinder</li> <li>● Charging cylinder</li> <li>● Refrigerant recovery unit</li> <li>● Vacuum pump with anti-reverse flow (*1) (Solenoid valve-installed type, which prevents oil from flowing back into the unit when the power is off, is recommended.)</li> <li>● Vacuum pump (*2)...can be used if the following adapter is attached.</li> <li>● Vacuum pump adapter (reverse-flow prevention adapter) (*3). (Solenoid valve-installed adapter attached to a conventional vacuum pump.)</li> <li>● Electronic scale for charging refrigerant</li> <li>● Flare tool</li> </ul>
Tools which can be commonly used for R22, R407C, and R410A	<ul style="list-style-type: none"> <li>● Bender</li> <li>● Torque wrench</li> <li>● Cutter, reamer</li> <li>● Welding tool, nitrogen gas cylinder</li> </ul>



**CAUTION**

- **The above tools specifically for R410A must not be used for R22 and R407C. Doing so will cause malfunction of the unit.**
- **For the above vacuum pump (\*1, \*2) and vacuum pump adapter (\*3), those for R22-type units can be used for R410A-type. However, they must be used exclusively for R410A and never alternately with R22 and R407C.**
- To prevent other refrigerants (R22, R407C) from being mistakenly charged to this unit, shape and external diameter of the service port screw has been altered.  
  - <External diameter of service port> R410A : 5/16"
  - R22, R407C : 1/4"

### 9-4. Tubing Installation Procedures

When the tubes are connected, **always apply HAB oil on the flare portions to improve the sealing of tubing.**

The following is the **HAB oil** generally used:

Esso: ZERICE S32

**NOTE** For details on tubing installation procedures, refer to the installation manuals attached to the indoor unit and outdoor unit.

## 9-5. In Case of Compressor Malfunction



### CAUTION

- Should the compressor malfunction, be sure to make the switch to a replacement compressor as quickly as possible.
- Use only the tools indicated exclusively for R410A. → See "9-3. Tools Specifically for R410A."

### 9-5-1. Procedure for Replacing Compressor

#### (1) Recovering refrigerant

- Any remaining refrigerant inside the unit should not be released to the atmosphere, but recovered using the refrigerant recovery unit for R410A.
- Do not reuse the recovered refrigerant, since it will contain impurities.

#### (2) Replacing Compressor


- Soon after removing seals of both discharge and suction tubes of the new compressor, replace it quickly.

#### (3) Checking for sealing

- Use nitrogen gas for the pressurized gas, and never use a refrigerant other than R410A. Also do not use oxygen or any flammable gas.

#### (4) Evacuation

- Use a solenoid valve-installed vacuum pump so that even if power is cut off in the middle of evacuation of air due to a power interruption, the valve will prevent the pump oil from flowing back.
- The equipment may be damaged if moisture remains in the tubing, thus carry out the evacuation thoroughly.
- When using a vacuum pump with exhaust air volume more than 0.883 cu.ft./min. and ultimate vacuum pressure rate of 50 micron Hg.

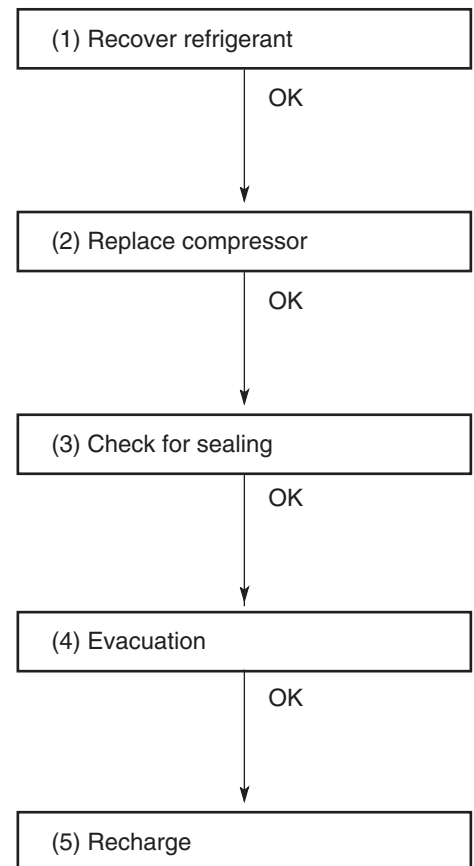

#### Standard time for evacuation

Length of tubing	Less than 33 ft. (10 m)	More than 33 ft. (10 m)
Evacuation time	More than 10 minutes	More than 15 minutes

## (5) Recharging

- **Be sure to charge the specified amount of refrigerant in liquid state** using the service port of the wide tube service valve. The proper amount is listed on the unit's nameplate.

When the entire amount cannot be charged all at once, charge gradually while operating the unit in Cooling Operation.



**CAUTION**

**Never charge a large amount of liquid refrigerant at once to the unit. This may cause damage to the compressor.**

- When charging with a refrigerant cylinder, use an electronic scale for charging refrigerant. In this case, if the volume of refrigerant in the cylinder becomes less than 20% of the fully-charged amount, the composition of the refrigerant starts to change. Thus, **do not use the refrigerant if the amount in the charging cylinder is less than 20%.**

Also, charge the minimum necessary amount to the charging cylinder before using it to charge the air conditioning unit.

### Example:

In case of charging refrigerant to a unit requiring 1.68 lb. (0.76 Kg) using a capacity of a 22 lb. (10 Kg) cylinder, the minimum necessary amount for the cylinder is:

$$1.68 + 22 \times 0.20 = 6.08 \text{ lb.}$$

$$(0.76 + 10 \times 0.20 = 2.76 \text{ Kg})$$

- **For the remaining refrigerant, refer to the instructions of the refrigerant manufacturer.**

If using a charging cylinder, transfer the specified amount of liquid refrigerant from the refrigerant cylinder to the charging cylinder.

Prepare an evacuated charging cylinder beforehand.




**CAUTION**

- **To prevent the composition of R410A from changing, never bleed the refrigerant gas into the atmosphere while transferring the refrigerant. (Fig. 3)**

**Do not use the refrigerant if the amount in the charging cylinder is less than 20%.**


## Configuration and characteristics of cylinders

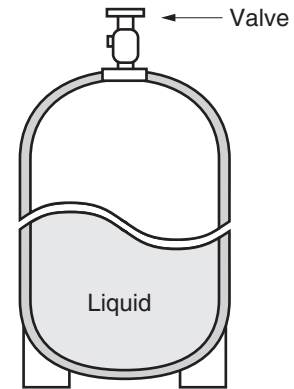

### Single valve

Charge liquid refrigerant with cylinder in up-side-down position.

Fig. 1

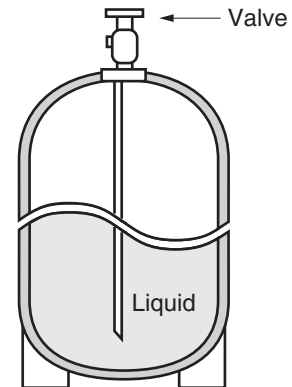

### Single valve (with siphon tube)

Charge with cylinder in normal position.

Fig. 2

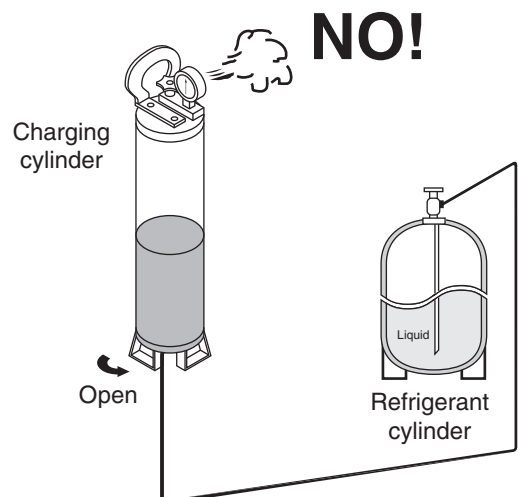


Fig. 3

## 9-6. In Case Refrigerant is Leaking



### CAUTION

Never attempt to charge additional refrigerant when refrigerant has been leaking from the unit. Follow the procedure described below to locate points of leaks and carry out repairs, then recharge the refrigerant.

#### (1) Detecting Leaks

- Use the detector for R410A to locate refrigerant leak points.

#### (2) Recovering refrigerant

- Never release the gas to the atmosphere; recover residual refrigerant using the refrigerant recovery unit for R410A, instead.
- Do not reuse the recovered refrigerant because its composition will have been altered.

#### (3) Welding leaking points

- Confirm again that no residual refrigerant exists in the unit before starting welding.
- Weld securely using flux and wax for R410A.
- Prevent oxide film from forming inside the tubes utilizing substitution with nitrogen (N<sub>2</sub>) in the refrigerant circuit of the unit. Leave ends of tubes open during welding.

#### (4) Checking for sealing

- Use nitrogen gas for the pressurized gas, and never use a refrigerant other than R410A. Also do not use oxygen or any flammable gas.

#### (5) Evacuation


- **Use a solenoid valve-installed vacuum pump** so that even if power is cut off in the middle of evacuation of air due to a power interruption, the valve will prevent the pump oil from flowing back.
- The equipment may be damaged if moisture remains in the tubing, thus carry out the evacuation thoroughly.
- When using a vacuum pump with exhaust air volume more than 0.883 cu.ft./min. and ultimate vacuum pressure rate of 50 micron Hg.

#### Standard time for evacuation

Length of tubing	Less than 33 ft. (10 m)	More than 33 ft. (10 m)
Evacuation time	More than 10 minutes	More than 15 minutes

#### (6) Recharging

- Recharge unit in the same manner explained on the previous page "(5) Recharging."

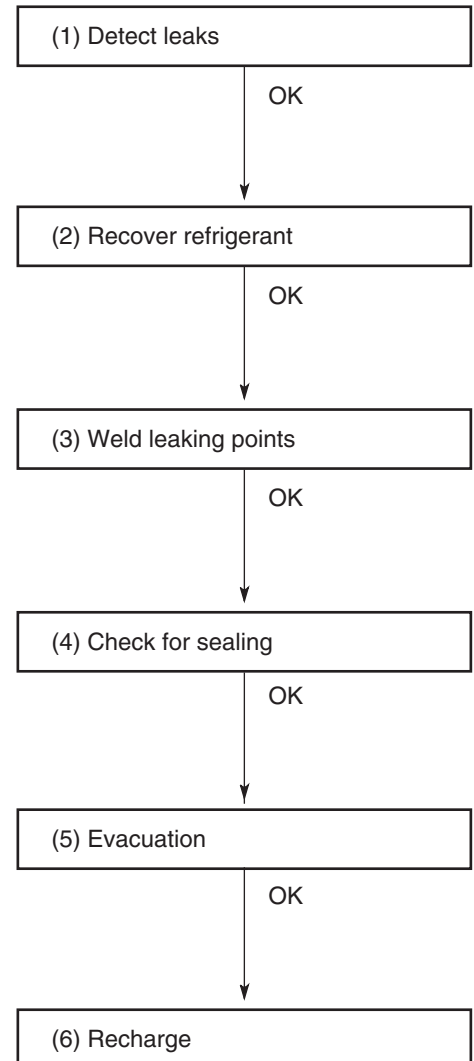

## 9-7. Charging Additional Refrigerant

### 9-7-1. When Tubes are Extended

- Observe the proper amount of refrigerant as stated in this service manual or the installation manual that came with the indoor unit. **Charge additional refrigerant in liquid state only.**



#### CAUTION

Never charge additional refrigerant if refrigerant is leaking from the unit. Follow instructions given in "9-6. In Case Refrigerant is Leaking" and completely carry out repairs. Only then should you recharge the refrigerant.

## 9-8. Retro-Fitting Existing Systems

### 9-8-1. Use of Existing Units

- **Never use new refrigerant R410A for existing units which use R22.** This will cause the air conditioner to operate improperly and may result in a hazardous condition.

### 9-8-2. Use of Existing Tubing

- If replacing an older unit that used refrigerant R22 with a R410A unit, **do not use its existing tubing.** Instead, completely new tubing must be used.



# **APPENDIX A** INSTALLATION INSTRUCTIONS

**CU-3KE19NBU**  
**CU-4KE24NBU**  
**CU-4KE31NBU**

(852-6-4190-584-00-2)

# INSTALLATION INSTRUCTIONS

## Split System Air Conditioner

### Contents

This air conditioner uses the refrigerant R410A.

**NOTE** External diameter of service port R410A: 5/16"

Page

**IMPORTANT!**  
Please Read Before Starting ..... 2

**Model Combinations**

Combine indoor and outdoor units only as listed below.

**Model No.**

<u>Indoor Unit</u>	<u>Outdoor Unit</u>
CS-MKE7NKH	CU-3KE19NBU
CS-MKE9NKH	CU-4KE24NBU
CS-MKE12NKH	CU-4KE31NBU
CS-MKE18NKH	
CS-MKE24NKH	
CS-MKE9NB4U	
CS-MKE12NB4U	
CS-KE18NB4UW	

Power Source:  
60 Hz, single-phase, 230 / 208 VAC

**1. GENERAL** ..... 4

1-1. Tools Required for Installation (not supplied)

1-2. Accessories Supplied with Unit

1-3. Optional Copper Tubing Kit

1-4. Type of Copper Tube and Insulation Material

1-5. Additional Materials Required for Installation

**2. INSTALLATION SITE SELECTION** ..... 5

2-1. Indoor Unit

2-2. Connecting Indoor Units

2-3. Outdoor Unit

2-4. Baffle Plate for the Outdoor Unit

2-5. Outer Dimensions of Outdoor Unit

2-6. Diagram of Outdoor Unit Installation

**3. INSTALLATION PROCESS** ..... 16

3-1. Embedding the Tubing and Wiring

3-2. Use of the Flaring Method

3-3. Flaring Procedure with a Flare Tool

3-4. Caution before Connecting Tubes Tightly

3-5. Tubing Connections

3-6. Insulation of Refrigerant Tubing

3-7. Taping the Tubes

3-8. Finishing the Installation

**4. AIR PURGING** ..... 19

■ Air Purging with a Vacuum Pump (for Test Run)

■ Pump Down

**5. WIRING INSTRUCTIONS** ..... 22

5-1. General Precautions on Wiring

5-2. Recommended Wire Length and Diameter

5-3. Wiring System Diagram

5-4. How to Connect Wiring to the Terminal


5-5. Wiring Instructions for the Outdoor Unit

**6. TEST RUN** ..... 26

**7. CONNECTING A HOME AUTOMATION DEVICE** ..... 27

**8. INSTALLATION CHECK SHEET** ..... 27

**Combination example**

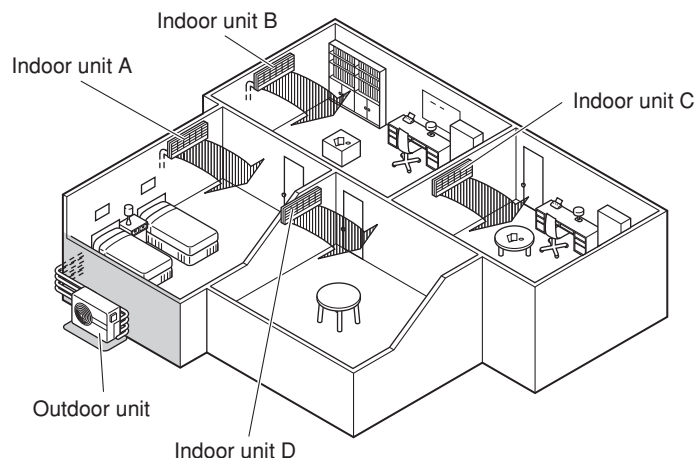

# IMPORTANT!

## Please Read Before Starting

This air conditioning system meets strict safety and operating standards. As the installer or service person, it is an important part of your job to install or service the system so it operates safely and efficiently.

### For safe installation and trouble-free operation, you must:

- Carefully read this instruction booklet before beginning.
- Follow each installation or repair step exactly as shown.
- Observe all local, state, and national electrical codes.
- Pay close attention to all warning and caution notices given in this manual.



**WARNING**

This symbol refers to a hazard or unsafe practice which can result in severe personal injury or death.



**CAUTION**

This symbol refers to a hazard or unsafe practice which can result in personal injury or product or property damage.

### If Necessary, Get Help

These instructions are all you need for most installation sites and maintenance conditions. If you require help for a special problem, contact our sales/service outlet or your certified dealer for additional instructions.

### In Case of Improper Installation

The manufacturer shall in no way be responsible for improper installation or maintenance service, including failure to follow the instructions in this document.

---

## SPECIAL PRECAUTIONS


---

**WARNING**

### When Wiring



**ELECTRICAL SHOCK CAN CAUSE SEVERE PERSONAL INJURY OR DEATH. ONLY A QUALIFIED, EXPERIENCED ELECTRICIAN SHOULD ATTEMPT TO WIRE THIS SYSTEM.**

- Do not supply power to the unit until all wiring and tubing are completed or reconnected and checked.
- Highly dangerous electrical voltages are used in this system. Carefully refer to the wiring diagram and these instructions when wiring. Improper connections and inadequate grounding can cause **accidental injury or death**.
- **Ground the unit** following local electrical codes.
- Connect all wiring tightly. Loose wiring may cause overheating at connection points and a possible fire hazard.
- To prevent possible hazards from insulation failure,  the unit must be grounded.

### When Transporting

---

Be careful when picking up and moving the indoor and outdoor units. Get a partner to help, and bend your knees when lifting to reduce strain on your back. Sharp edges or thin aluminum fins on the air conditioner can cut your fingers.

### When Installing...

---

Select an installation location which is rigid and strong enough to support or hold the unit, and select a location for easy maintenance.

#### ...In a Ceiling or Wall

Make sure the ceiling/wall is strong enough to hold the unit's weight. It may be necessary to construct a strong wood or metal frame to provide added support.

#### ...In a Room

Properly insulate any tubing run inside a room to prevent "sweating" that can cause dripping and water damage to walls and floors.



**CAUTION**

Keep the fire alarm and the air outlet at least 1.5 m away from the unit.

#### ...In Moist or Uneven Locations

Use a raised concrete pad or concrete blocks to provide a solid, level foundation for the outdoor unit. This prevents water damage and abnormal vibration.

#### ...In an Area with High Winds

Securely anchor the outdoor unit down with bolts and a metal frame. Provide a suitable air baffle.

#### ...In a Snowy Area

Install the outdoor unit on a raised platform that is higher than drifting snow. Provide snow vents.

### When Connecting Refrigerant Tubing

---




**WARNING**

- When performing piping work do not mix air except for specified refrigerant (R410A) in refrigeration cycle. It causes capacity down, and risk of explosion and injury due to high tension inside the refrigerant cycle.
- Refrigerant gas leakage may cause fire.
- Do not add or replace refrigerant other than specified type. It may cause product damage, burst and injury etc.
- Ventilate the room well, in the event that refrigerant gas leaks during the installation. Be careful not to allow contact of the refrigerant gas with a flame as this will cause the generation of poisonous gas.

- Use the flare method for connecting tubing.
- Apply refrigerant lubricant to the matching surfaces of the flare and union tubes before connecting them, then tighten the nut with a torque wrench for a leak-free connection.
- Check carefully for leaks before starting the test run.
- Do not leak refrigerant while piping work for an installation or re-installation, and while repairing refrigeration parts. Handle liquid refrigerant carefully as it may cause frost-bite.




### When Servicing

- Turn the power OFF at the main power box (mains) before opening the unit to check or repair electrical parts and wiring. 
- Keep your fingers and clothing away from any moving parts.
- Clean up the site after you finish, remembering to check that no metal scraps or bits of wiring have been left inside the unit being serviced.

### Others



**CAUTION**

- Ventilate any enclosed areas when installing or testing the refrigeration system. Escaped refrigerant gas, on contact with fire or heat, can produce dangerously toxic gas.
- Confirm upon completing installation that no refrigerant gas is leaking. If escaped gas comes in contact with a stove, gas water heater, electric room heater or other heat source, it can produce dangerously toxic gas.
- Do not install only a single indoor unit.
- Do not touch the air inlet or the sharp aluminum fins of the outdoor unit. You may get injured. 
- Do not sit or step on the unit, you may fall down accidentally. 
- Do not stick any object into the FAN CASE. You may be injured and the unit may be damaged. 



### NOTE

The illustrations are based on the typical appearance of a standard model. Consequently, the shape may differ from that of the air conditioner that you are installing.

# 1. General





This booklet briefly outlines where and how to install the air conditioning system. Please read over the entire set of instructions for the indoor and outdoor units and make sure all accessory parts listed are with the system before beginning. If the electric wiring diagram does not appear in this manual, please check for the diagram on the indoor unit.

## 1-1. Tools Required for Installation (not supplied)

- |                              |                       |                             |
|------------------------------|-----------------------|-----------------------------|
| 1. Standard screwdriver      | 7. Hacksaw            | 13. Torque wrench           |
| 2. Phillips head screwdriver | 8. Core bits          | 14. Adjustable wrench       |
| 3. Knife or wire stripper    | 9. Hammer             | 15. Reamer (for deburring)  |
| 4. Tape measure              | 10. Drill             | 16. Vacuum pump (For R410A) |
| 5. Carpenter's level         | 11. Tube cutter       | 17. Manifold valve          |
| 6. Sabre saw or key hole saw | 12. Tube flaring tool |                             |

## 1-2. Accessories Supplied with Unit

Table 1

Parts	Figure	Q'ty	Parts	Figure	Q'ty	Parts	Figure	Q'ty
Labels for inter-unit cable and tube		4 each	Cushion rubber		4	Reducer (1/2" x 3/8")		CU-4KE24NBU 1 CU-4KE31NBU 2
Reducer (3/8" x 1/2")		CU-3KE19NBU 1	Packed in the outdoor unit.					

## 1-3. Optional Copper Tubing Kit

Copper tubing for connecting the outdoor unit to the indoor unit is available in kits which contain the narrow and wide tubing, fittings and insulation. Consult your nearest sales outlet or air conditioning workshop.

## 1-4. Type of Copper Tube and Insulation Material

If you wish to purchase these materials separately from a local source, you will need:

- Deoxidized annealed copper tube for refrigerant tubing as detailed in Table 2.  
Cut each tube to the appropriate lengths 1' to 1'4" (30 cm to 40 cm) to dampen vibration between units.

2. Foamed polyethylene insulation for the specified copper tubes as required to precise length of tubing. Wall thickness of the insulation should be not less than 5/16" (8 mm).
3. Use insulated copper wire for field wiring. Wire size varies with the total length of wiring. Refer to 5. Wiring Instructions for details.



**CAUTION**

**Check local electrical codes and regulations before obtaining wire. Also, check any specified instructions or limitations.**

Table 2

Model	Narrow Tube		Wide Tube	
	Outer Dia.	Thickness	Outer Dia.	Thickness
CS-MKE7NKH, CS-MKE9NKH, CS-MKE12NKH	1/4" (6.35 mm)	0.0314" (0.8 mm)	3/8" (9.52 mm)	0.0314" (0.8 mm)
CS-MKE18NKH	1/4" (6.35 mm)	0.0314" (0.8 mm)	1/2" (12.70 mm)	0.0314" (0.8 mm)
CS-MKE24NKH	1/4" (6.35 mm)	0.0314" (0.8 mm)	5/8" (15.88 mm)	0.0393" (1.0 mm)
CS-MKE9NB4U, CS-MKE12NB4U	1/4" (6.35 mm)	0.0314" (0.8 mm)	3/8" (9.52 mm)	0.0314" (0.8 mm)
CS-KE18NB4UW	1/4" (6.35 mm)	0.0314" (0.8 mm)	1/2" (12.70 mm)	0.0314" (0.8 mm)

## 1-5. Additional Materials Required for Installation

1. Refrigeration (armored) tape
2. Insulated staples or clamps for connecting wire (See local codes.)
3. Putty
4. Refrigeration lubricant
5. Clamps or saddles to secure refrigerant tubing

## 2. Installation Site Selection

### 2-1. Indoor Unit



#### WARNING

To prevent abnormal heat generation and the possibility of fire, do not place obstacles, enclosures and grilles in front of or surrounding the air conditioner in a way that may block air flow.

#### AVOID:

- direct sunlight.
- nearby heat sources that may affect performance of the unit.
- areas where leakage of flammable gas may be expected.
- placing or allowing any obstructions near the air conditioner inlet or outlet.
- installing in rooms that contain instant-on (rapid-start) fluorescent lamps. (These may prevent the air conditioner from receiving signals.)
- places where large amounts of oil mist exist.
- installing in locations where there are devices that generate high-frequency emissions.

#### DO:

- select an appropriate position from which every corner of the room can be uniformly air-conditioned. (High on a wall is best for wall-mounted types.)
- select a location that will hold the weight of the unit.
- select a location where tubing and drain hose have the shortest run to the outside. (Fig. 1)
- allow room for operation and maintenance as well as unrestricted air flow around the unit. (Fig. 2a or 2b)
- install the unit within the maximum elevation difference (H1, H2, H3, H4) above or below the outdoor unit and within a total tubing length (L1+L2+L3, L1+L2+L3+L4) from the outdoor unit as detailed in Table 3 and Fig. 3a.


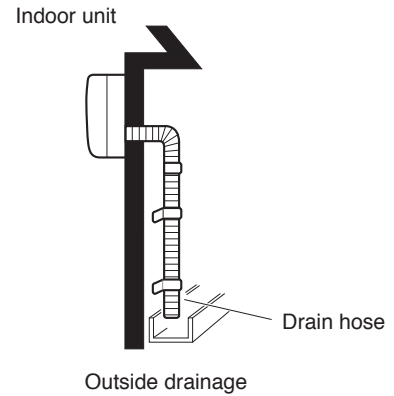


Fig. 1

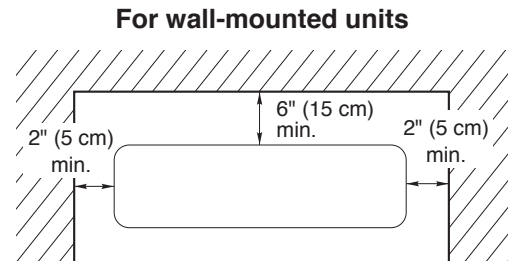

Front View

Fig. 2a

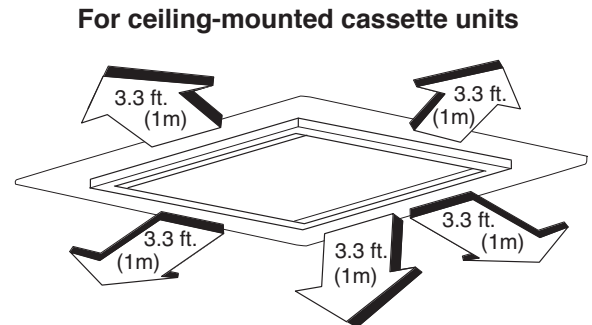


Fig. 2b



#### CAUTION

- Air delivery from a ceiling-mounted cassette unit will be degraded if the distance from the floor to the ceiling is greater than 10 ft. (3 m).
- For stable operation of the air conditioner, do not install wall-mounted units less than 5' (1.5 m) from floor level. (Fig. 3b)

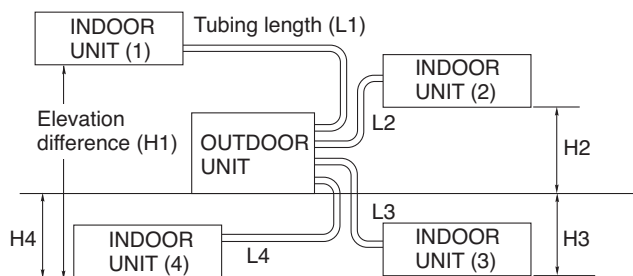


Fig. 3a

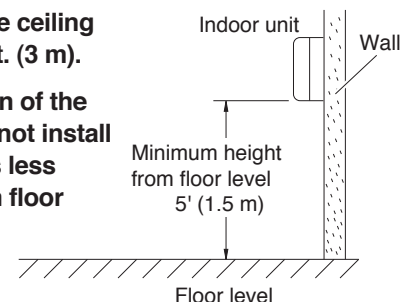


Fig. 3b

- install the indoor unit more than 3.3' (1 m) away from any antenna or power lines or connecting wires used for television, radio, telephone, security system, or intercom. Electrical noise from any of these sources may affect operation.
- install in a sturdy manner to avoid increased operating noise.

**Table 3**

Model	Max. Allowable Tubing Length Per Unit (ft.)	Max. Allowable Total Tubing Length at Shipment (L1+L2+L3) or (L1+L2+L3+L4) (ft.)	Limit of Total Tubing Length (L1+L2+L3) or (L1+L2+L3+L4) (ft.)	Limit of Elevation Difference (H1, H2, H3, H4) (ft.)	Required Amount of Additional Refrigerant (oz./ft.)*
CU-3KE19NBU	82	150 (L1+L2+L3)	150 (L1+L2+L3)	50	—
CU-4KE24NBU	82	150 (L1+L2+L3+L4)	200 (L1+L2+L3+L4)	50	0.22
CU-4KE31NBU	100	150 (L1+L2+L3+L4)	230 (L1+L2+L3+L4)	50	0.22

\* If total tubing length becomes 150 to 200 ft. (Max.) or 150 to 230 ft. (Max.), charge additional refrigerant (R410A) by 0.22 oz./ft. No additional charge of compressor oil is necessary. For more detailed charging information, refer to the Technical & Service Manual.

## 2-2. Connecting Indoor Units

Figures (4a) – (4k) show the different types of indoor unit connections, including the use of a reducer. To select the required indoor unit to be connected, refer to the Combination Table that was included in the outdoor unit package.

### (1) Connecting indoor unit for CU-3KE19NBU

(A)

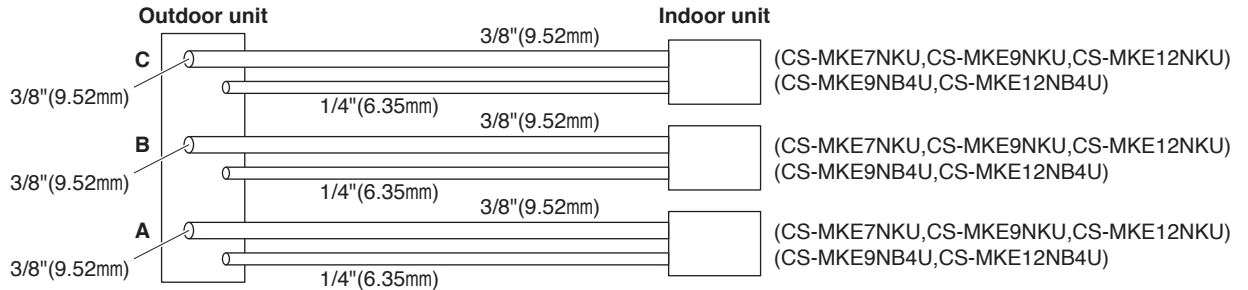


Fig. 4a

(B)

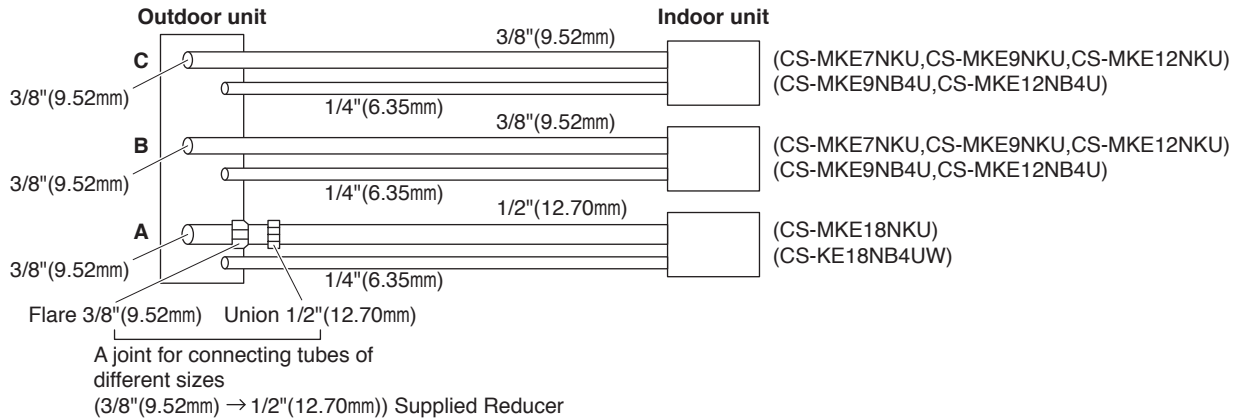


Fig. 4b

### (2) Connecting indoor unit for CU-4KE24NBU

(A)

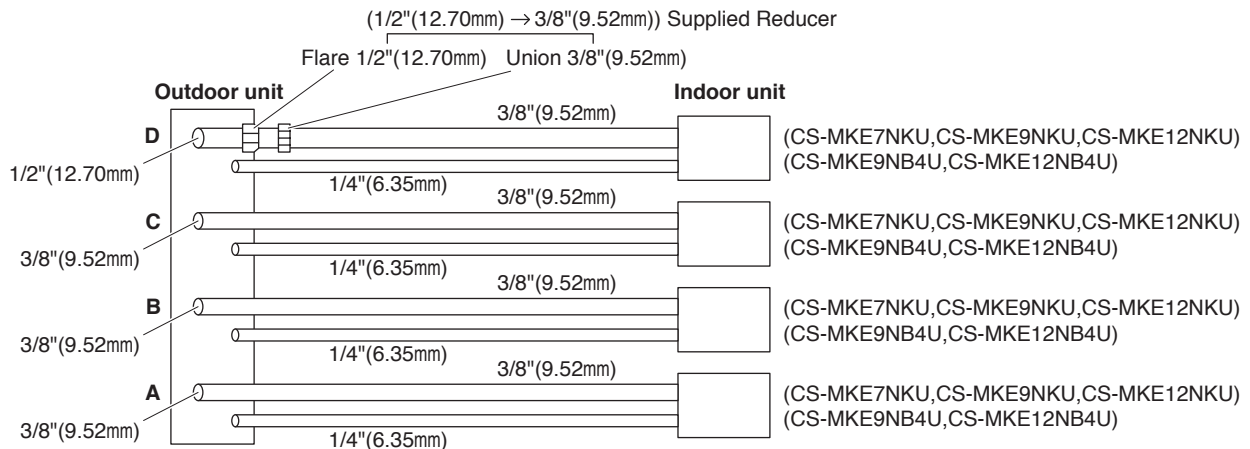


Fig. 4c

(B)

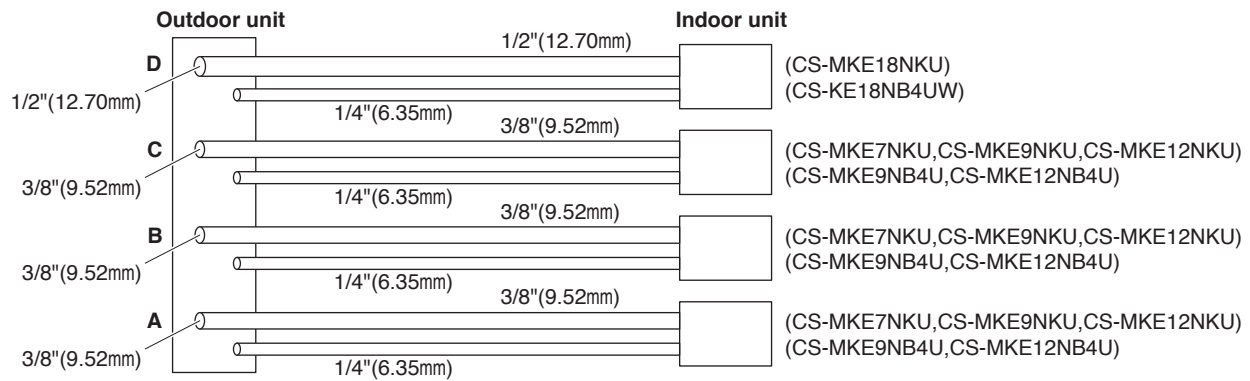


Fig. 4d

(C)

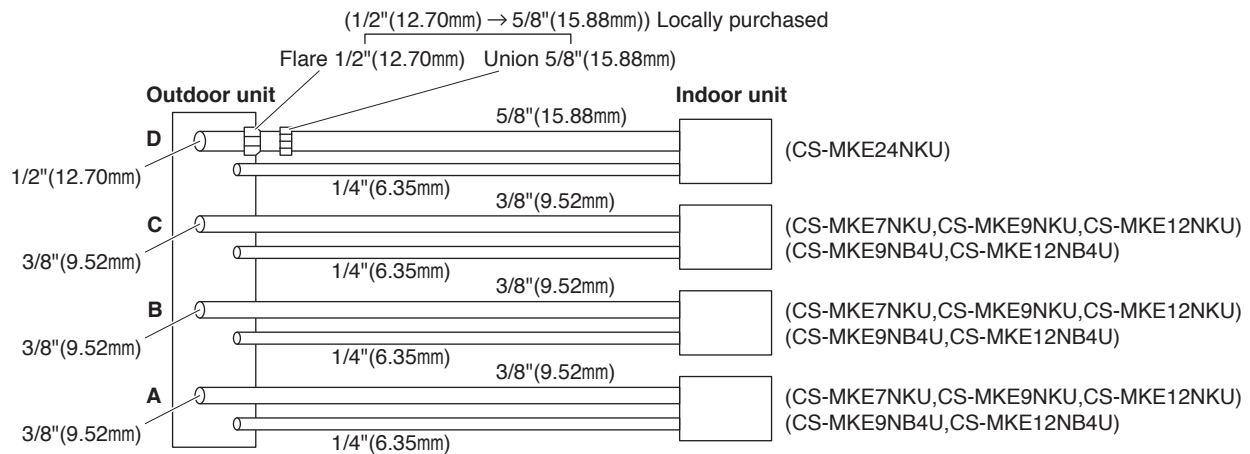


Fig. 4e

(D)

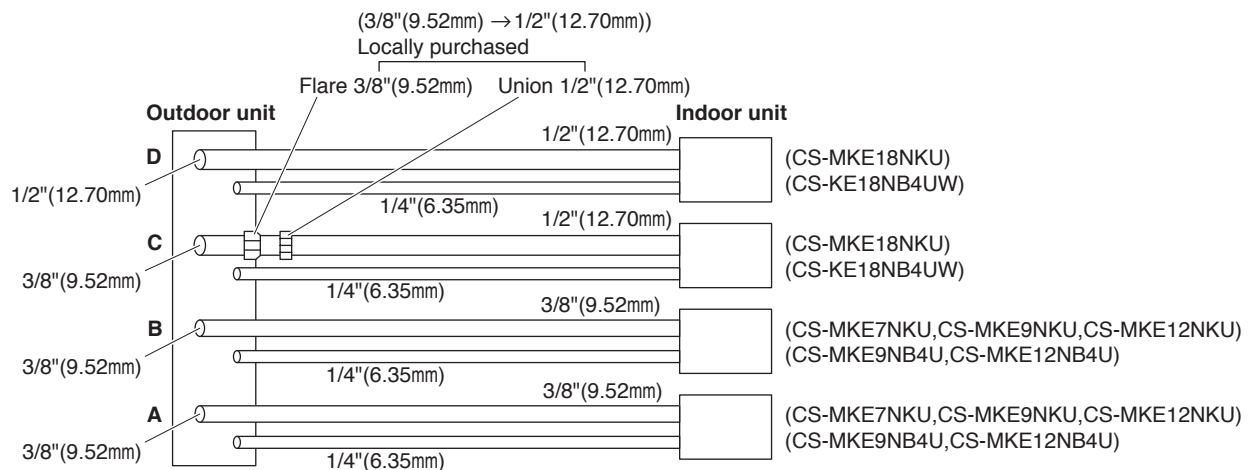


Fig. 4f

(3) Connecting indoor unit for CU-4KE31NBU

(A)

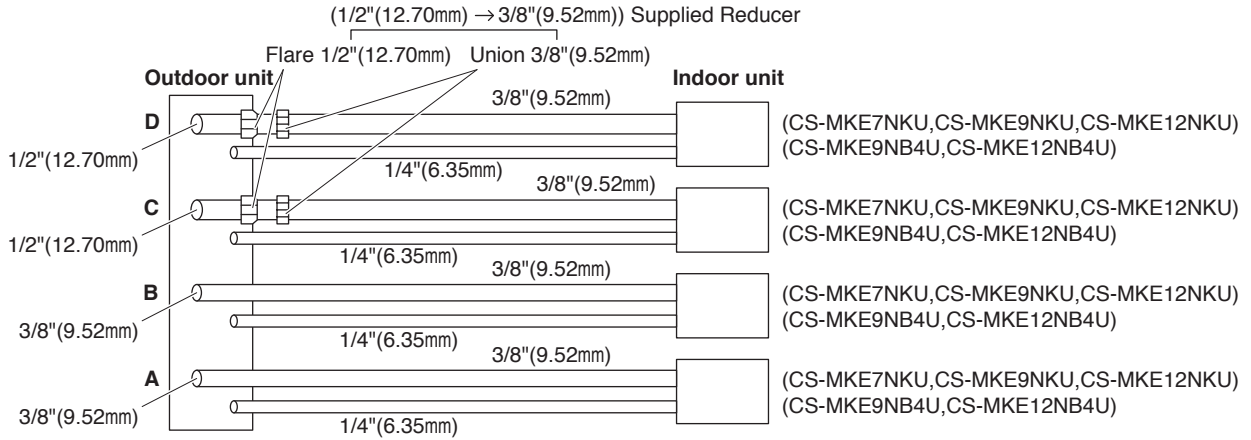


Fig. 4g

(B)

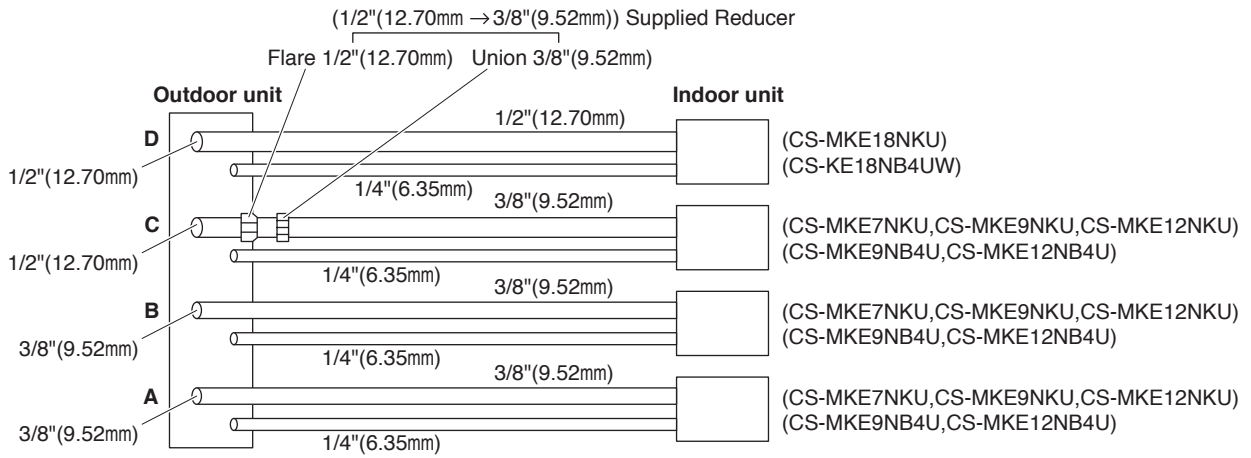


Fig. 4h

(C)

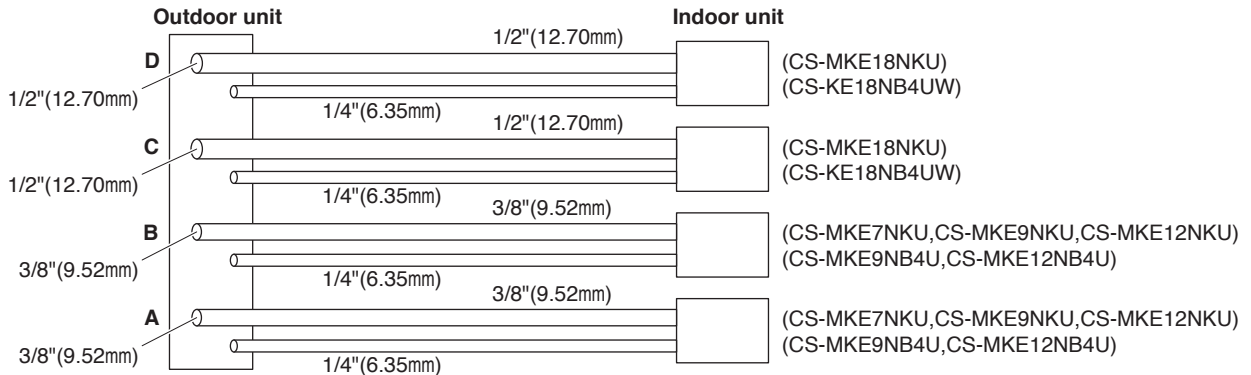


Fig. 4i

(D)

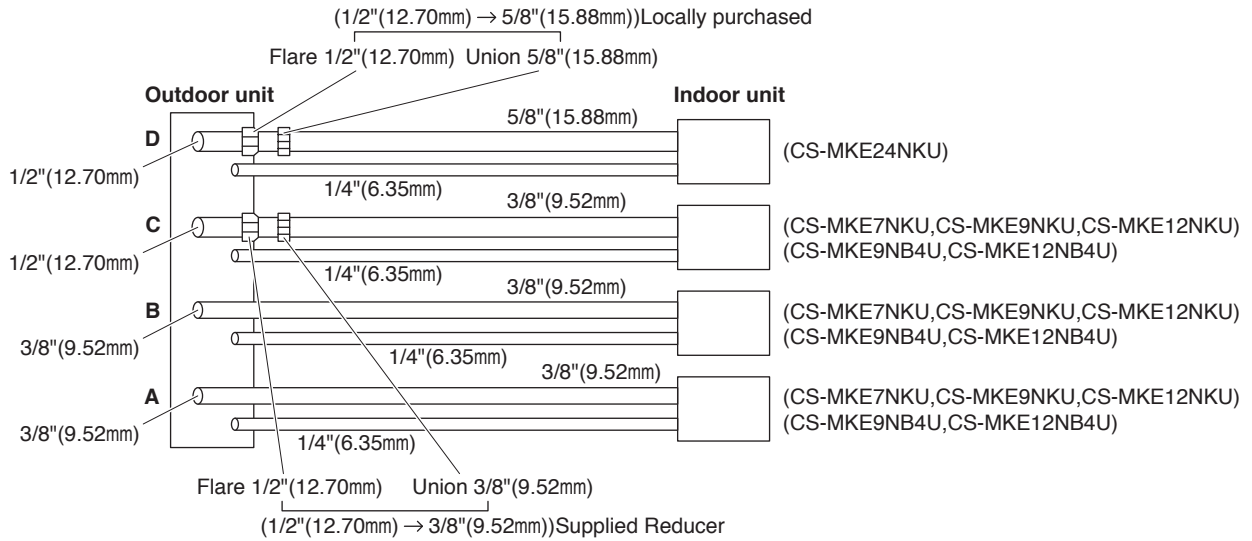


Fig. 4j

(E)

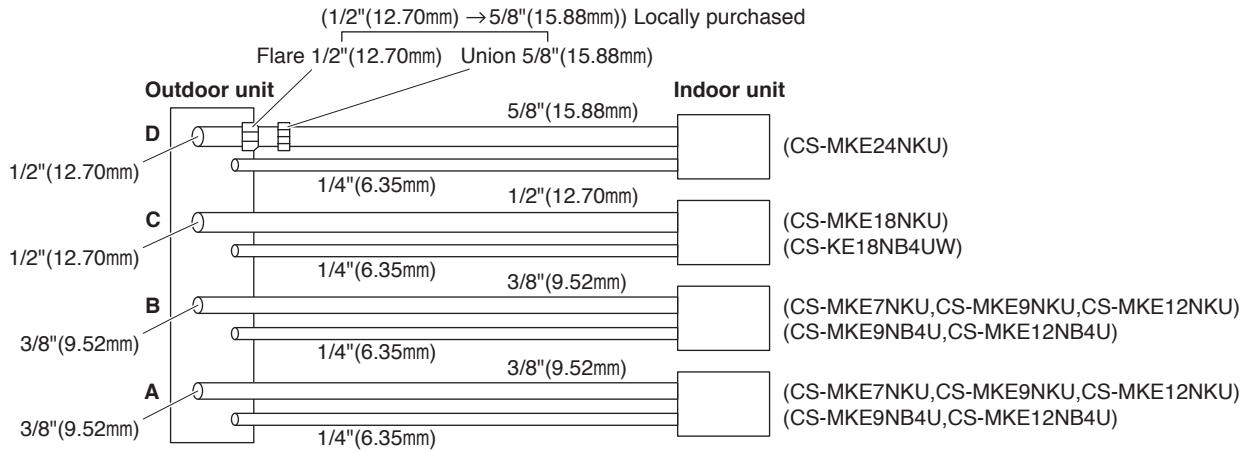


Fig. 4k

### 2-3. Outdoor Unit

#### AVOID:

- heat sources, exhaust fans, etc. (Fig. 5a)
- damp, humid or uneven locations.

#### DO:

- choose a place as cool as possible.
- choose a place that is well ventilated.
- install in a location where at least two sides are unobstructed, so that the flow of air at the intake port or exhaust port is not blocked, and so that sufficient space is ensured for maintenance to be carried out without trouble. In general the top also must be unobstructed. (Fig. 5b)
- provide a solid base (level concrete pad, concrete block, 6" × 1'4" (15 × 40 cm) beams or equal), a minimum of 6" (15 cm) above ground level to reduce humidity and protect the unit against possible water damage and decreased service life. (Figs. 5c and 5d)

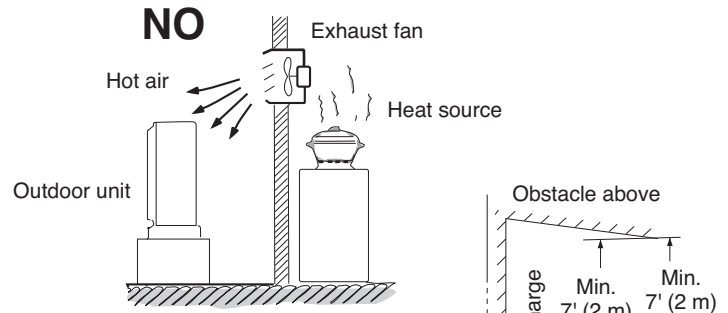


Fig. 5a

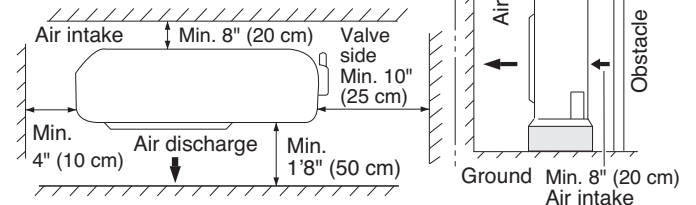


Fig. 5b

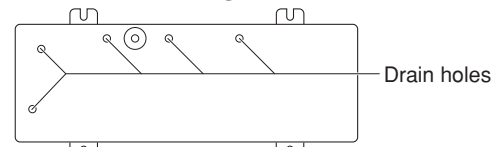


Fig. 5c



**CAUTION**

**A solid base must not cover the hole of the bottom plate.**

- install cushion rubber under unit's feet to reduce vibration and noise. (Fig. 5e)
- use lug bolts or equal to bolt down unit, reducing vibration and noise.
- install in a location where no antenna of a television or radio exists within 10' (3 m).

### 2-4. Baffle Plate for the Outdoor Unit

#### NOTE

It is recommended to use baffle plates.

When the outdoor unit is installed in a position exposed to strong wind (such as seasonal winds with low air temperature in winter), baffle plates must be installed on the outdoor unit. (Fig. 5f)

This unit is designed so that the fan of the outdoor unit runs at low speed when the air conditioner is operated at low outdoor air temperatures. When the outdoor unit is exposed to strong wind, the system pressure drops because of the freeze protector.

Install a pair of windbaffle plates at the front and back of the outdoor unit if it will be subject to strong wind during the winter. (Figs. 5f, 5g, 5h, 5i, and 5j)

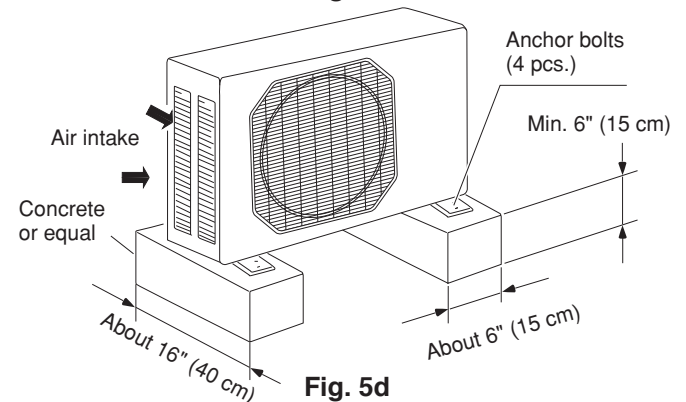


Fig. 5d

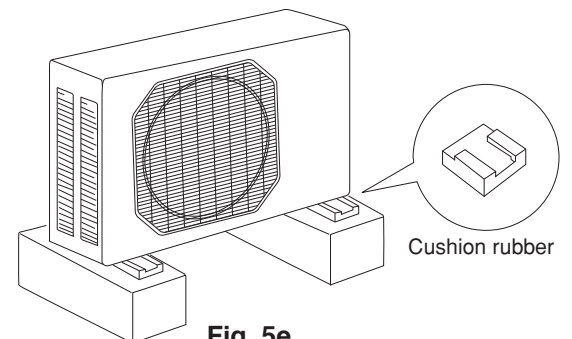


Fig. 5e



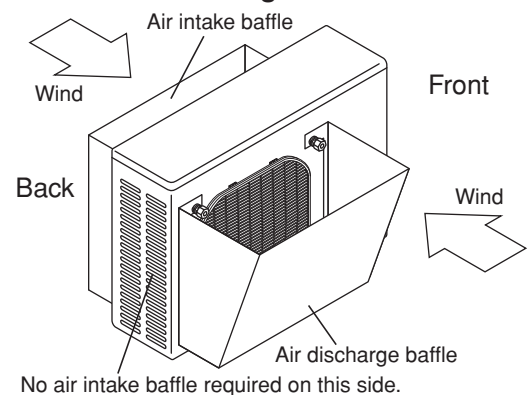


Fig. 5f

**(1) Recommended dimensions of the baffle plates**

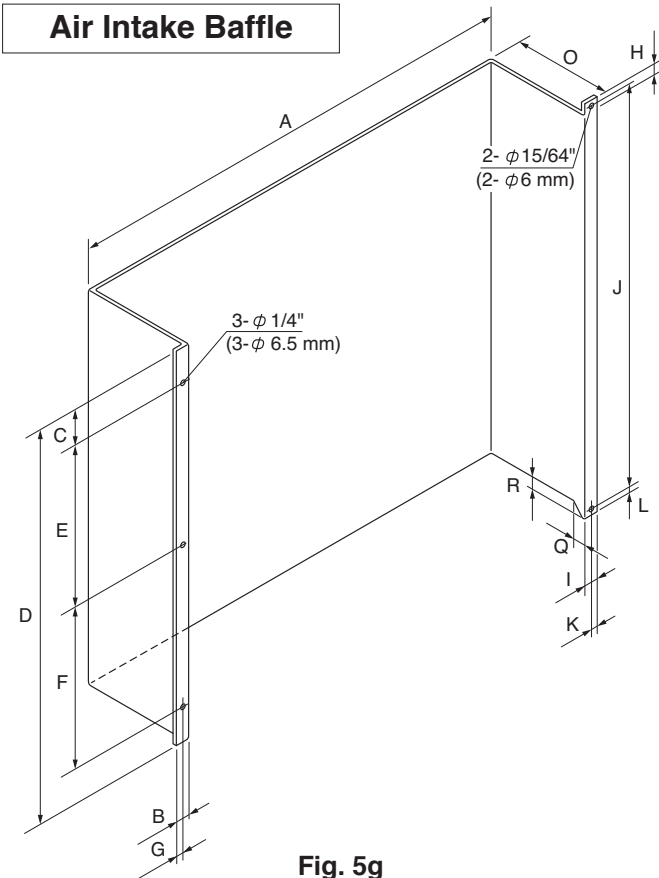

**Fig. 5g**

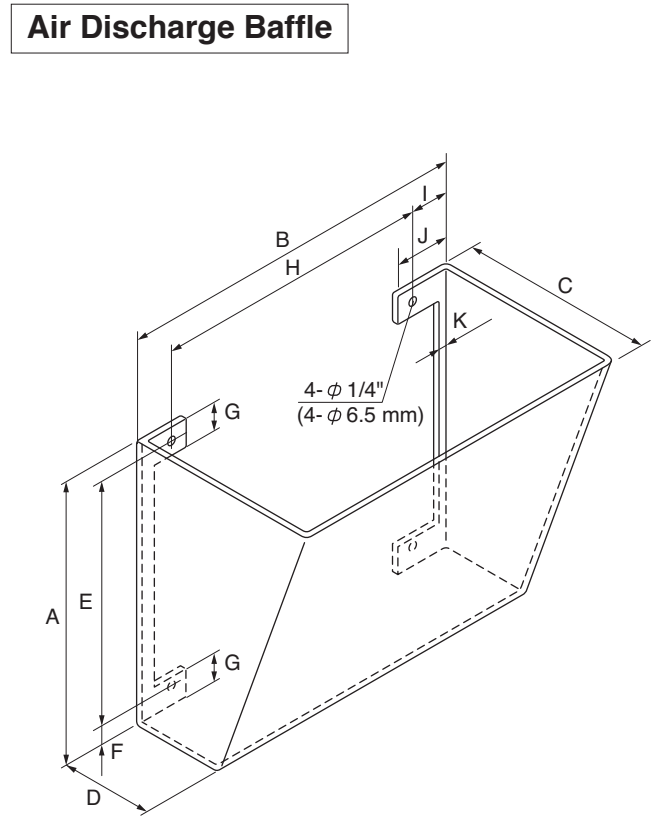

**Fig. 5h**

**For Air Intake**

Dimensions		A	B	C	D	E	F	G	H	I	J	K	L	O	Q	R
Model	(inch)	25-3/16	25/32	1-31/32	25	10-5/8	10-5/8	25/64	25/32	19/32	25-7/8	19/64	25/64	5-29/32	25/32	25/32
	(mm)	640	20	50	635	270	270	10	20	15	657	7.5	10	150	20	20
Model	(inch)	25-3/16	25/32	1-3/8	30-29/32	13-25/32	13-25/32	25/64	25/32	19/32	31-25/32	19/64	25/64	5-29/32	25/32	25/32
	(mm)	640	20	35	785	350	350	10	20	15	807	7.5	10	150	20	20

**For Air Discharge**

Dimensions		A	B	C	D	E	F	G	H	I	J	K
Model	(inch)	22-1/16	23-1/32	13-25/32	5-29/32	19-9/32	1-3/8	2-5/32	18-5/16	2-3/8	3-11/32	31/32
	(mm)	560	585	350	150	490	35	55	465	60	85	25

Material to be used: Metal plate with corrosion protection treatment

Plate thickness: 0.0394 to 0.0472" (1.0 to 1.2 mm)

**(2) Parts required (field supply except for screws)**

**Air Intake Baffle**

Item	Q'ty	Remarks
Baffle plate	1	
Screw 5/32 × 15/32" (4 × 12 mm) tapping	2	Attached to outdoor unit
Bolt 15/64 × 19/32 – 25/32" (M6 × 15 – 20 mm)	3	
Nut 15/64" (M6)	3	
Washer	3	
Spring washer	3	

**Air Discharge Baffle**

Item	Q'ty	Remarks
Baffle plate	1	
Bolt 15/64 × 13/32 – 19/32" (M6 × 10 – 15 mm)	4	
Nut 15/64" (M6)	4	
Washer	4	
Spring washer	4	

### (3) Installation procedure

#### 1. Air Intake Baffle

##### (1) Left side

1. Remove the top panel from the unit.
2. Remove the panel side L, and drill 3 holes of  $\varnothing 1/4$  inch (6.5 mm) at the prescribed position.
3. Install the windbaffle on the unit using field supply bolts and nuts.
4. Recommended bolts to be used are 15/64" (M6 ISO standard), and the recommended length of the bolts is between 19/32 – 25/32 inch (15 – 20 mm).
5. Use washers and spring washers to tightly fasten the windbaffle to the unit.

##### (2) Right side

1. Remove the top panel from the unit.
2. Use 2 preholes on the panel side R to install the baffle plate.
3. Remove the panel side R from the unit by removing the screws. These screws are used in step 4 below.
4. Put (sandwich) the windbaffle between the unit and the panel side R, then install the windbaffle on the unit using the above screws. Be careful not to damage the screw holes.

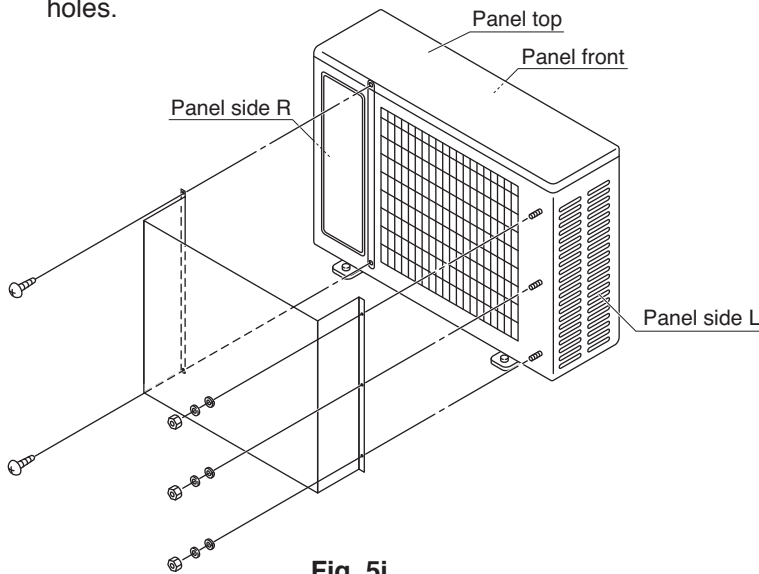


Fig. 5i

#### 2. Air Discharge Baffle

1. Remove the panels front, top, side L and R from the unit and drill 4 holes of  $\varnothing 1/4$  inch (6.5 mm) at the prescribed positions.
2. Install the windbaffle on the unit using field supply bolts and nuts.
3. Recommended bolts to be used are 15/64" (M6 ISO standard), and the recommended length of the bolts is between 13/32 – 19/32 inch (10 – 15 mm).
4. Use washers and spring washers to tightly fasten the windbaffle to the unit.

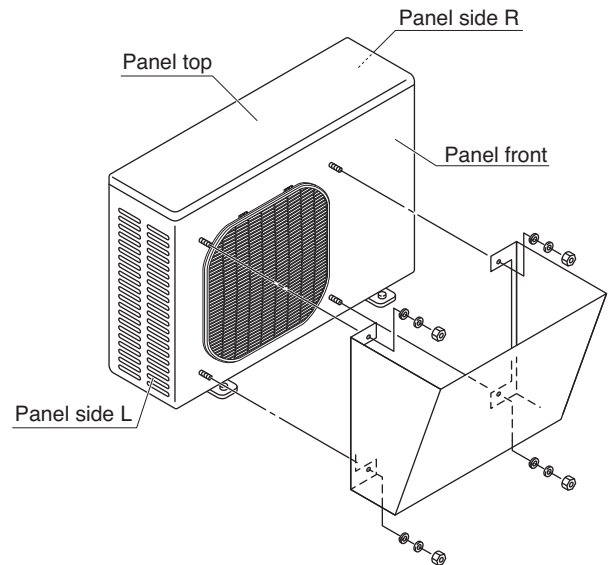


Fig. 5j

#### NOTE

- In order to prevent contact of the bolts and heat exchanger and other parts inside the unit, install the windbaffle using bolts from inside the unit and fasten the bolts with nuts from outside the unit.
- When the windbaffle is installed on the unit, the unit has higher wind resistance. In order to prevent the unit from falling over, anchor the legs of the unit using anchor bolts (or similar method).

#### (4) Precautions for installation

1. Be sure not to damage painted surfaces.
2. Finish the edges of the windbaffle to avoid cuts or injury.
3. Drilling of holes must be carefully done so that no damage is caused to external or internal parts of the unit. Particular care must be taken that drill chips do not drop into the unit.

## 2-5. Outer Dimensions of Outdoor Unit

### (1) CU-3KE19NBU

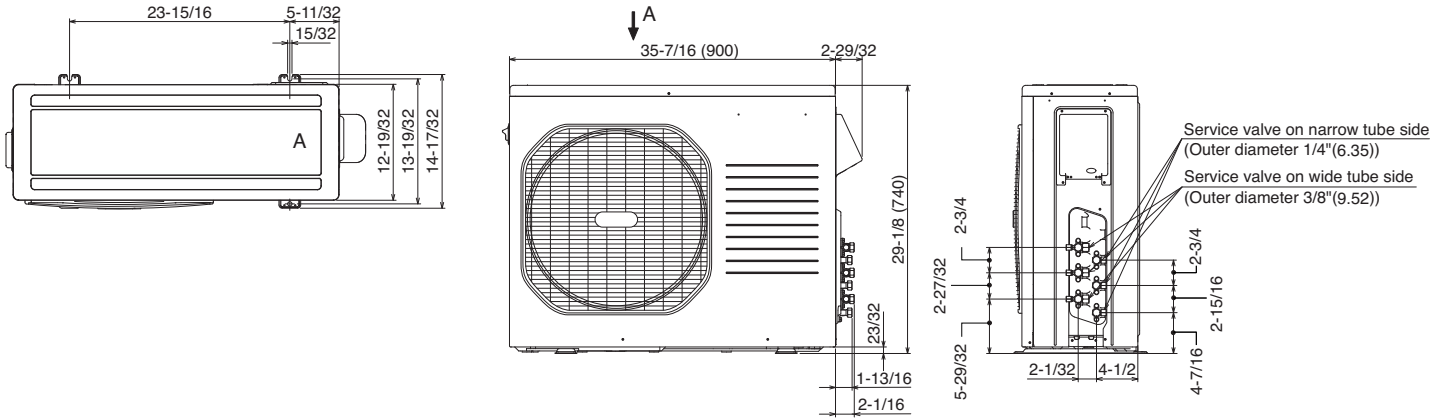


Fig. 6a

### (2) CU-4KE24NBU

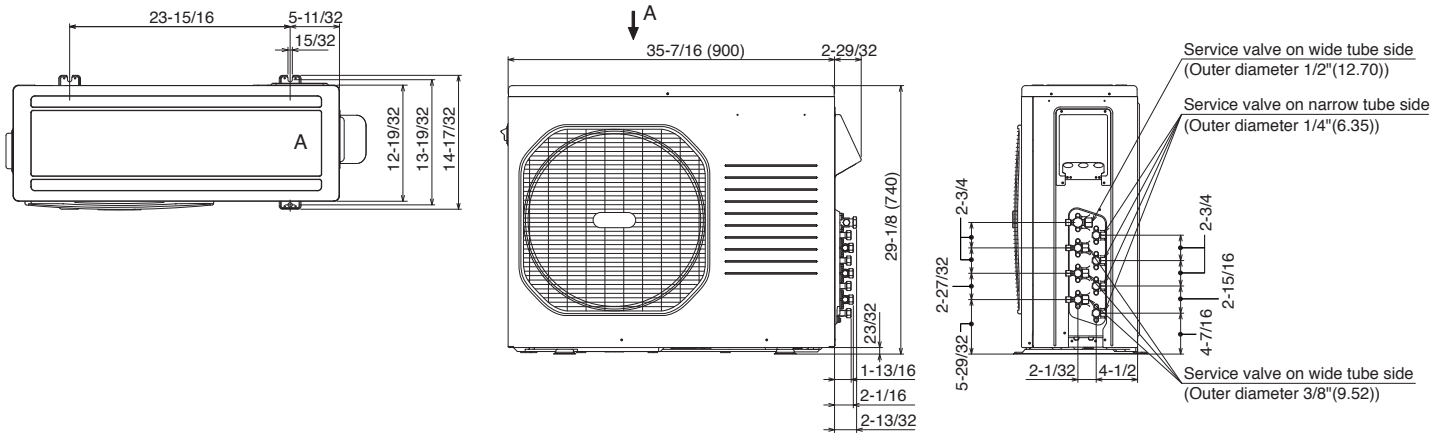


Fig. 6b

### (3) CU-4KE31NBU

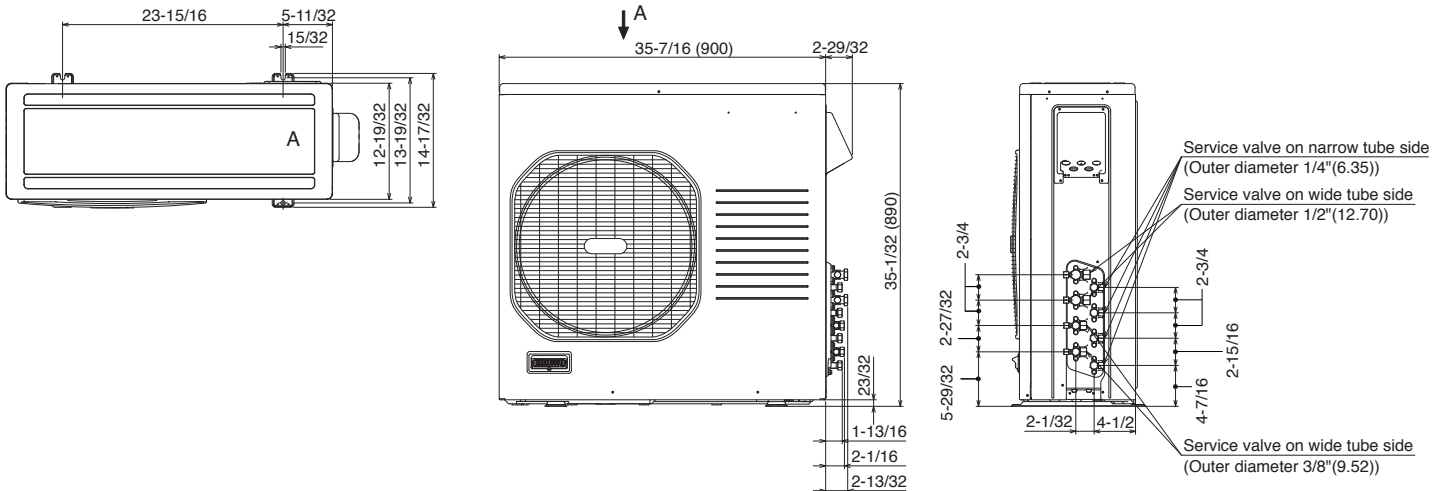


Fig. 6c

unit: inch (mm)

## 2-6. Diagram of Outdoor Unit Installation

Never install only a single indoor unit.

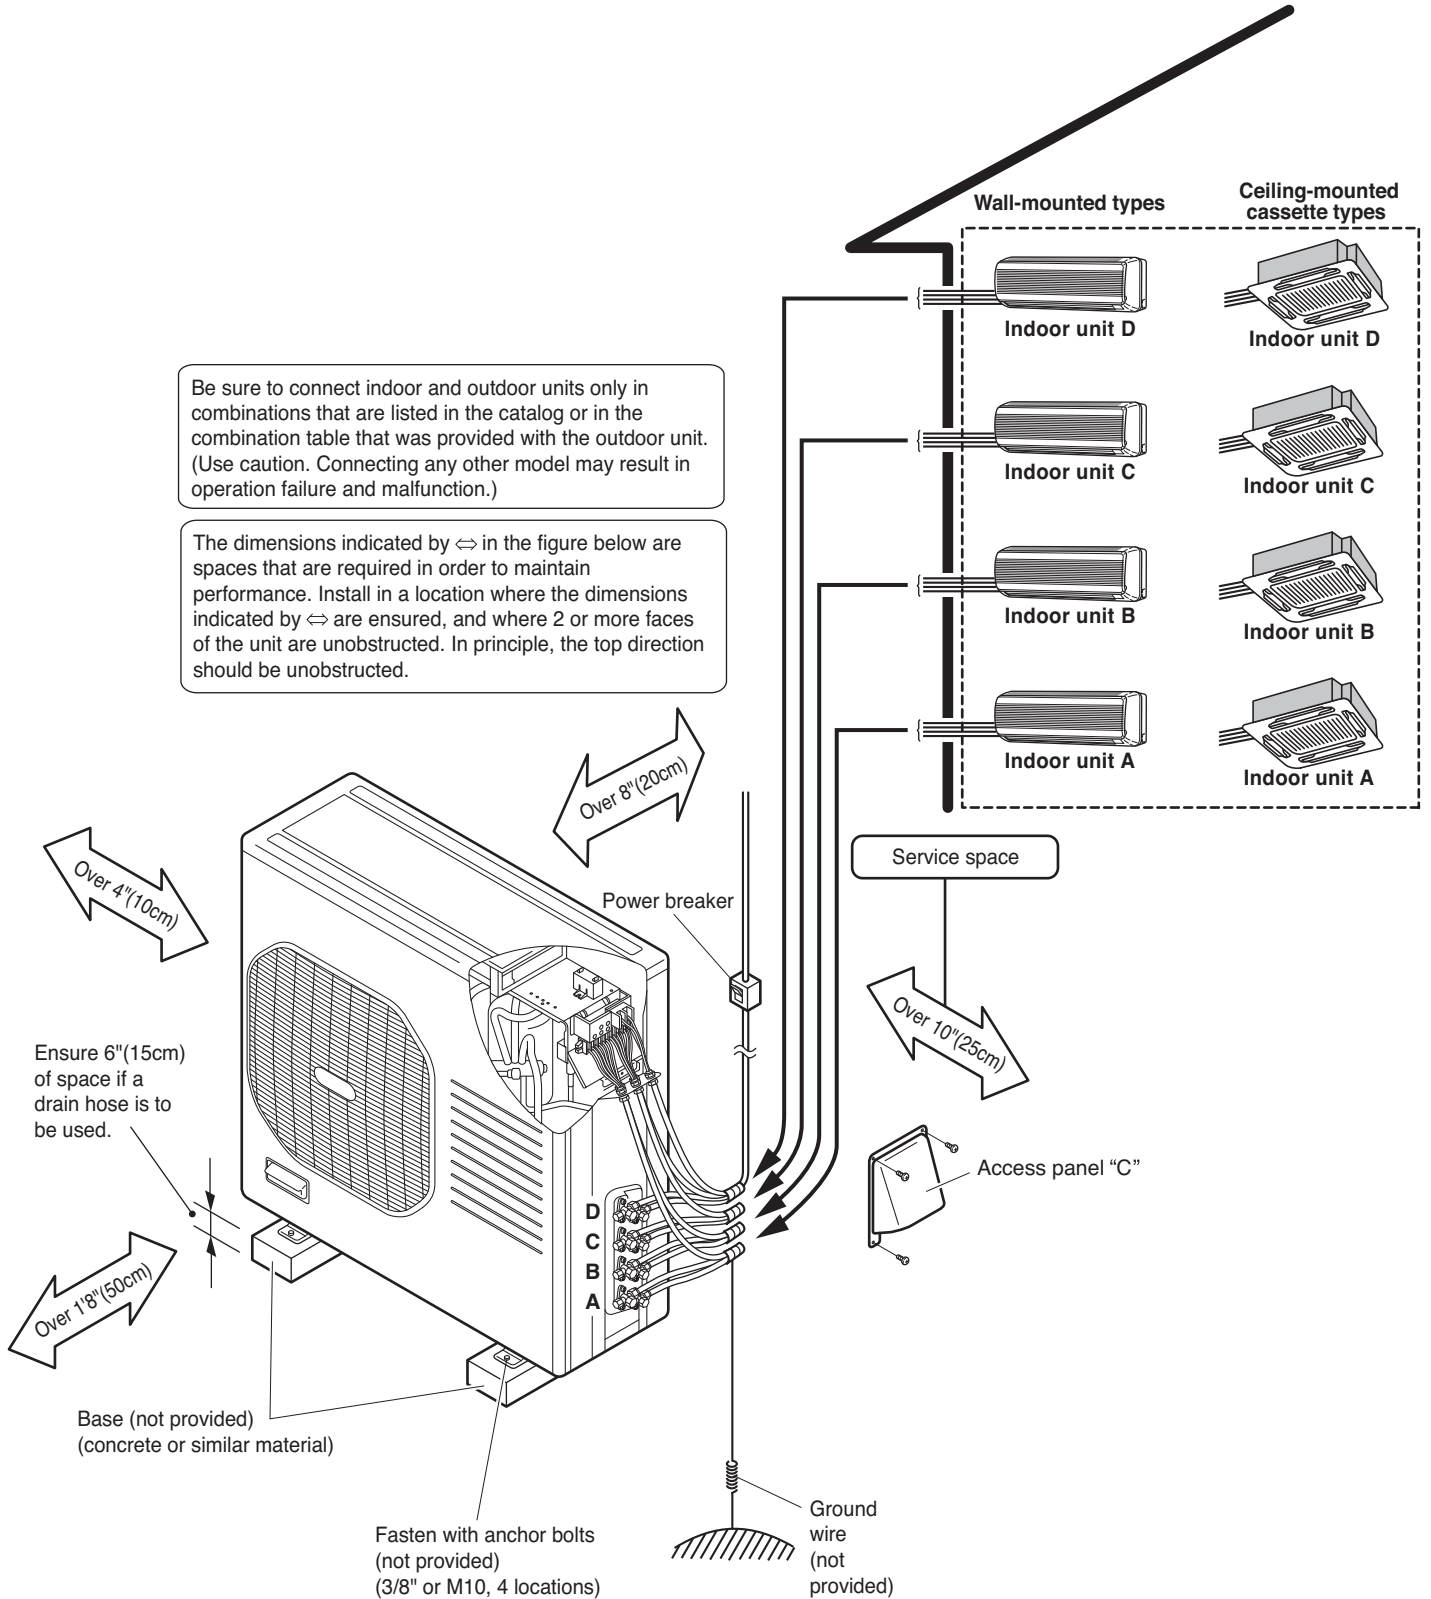


Fig. 7

### 3. Installation Process

#### 3-1. Embedding the Tubing and Wiring

- Do not connect tubes to locations that are embedded.
- Be sure to bind refrigerant tubing and inter-unit cables together with vinyl tape.
- The power cable must be obtained on-site.  
(#12: Less than 85 ft.)  
# ... AWG (American Wire Gauge)
- Be sure to apply the provided labels to both ends of the inter-unit cables to prevent miswiring.
- Securely seal the end of embedded tubing with vinyl tape in order to prevent dirt or moisture entry.
- In order to prevent insulation breakdown and ground faults, do not allow the wire ends to come in contact with rainwater, or be subject to dew condensation.

#### 3-2. Use of the Flaring Method

Many of the conventional split system air conditioners employ the flaring method to connect refrigerant tubes which run between indoor and outdoor units. In this method, the copper tubes are flared at each end and connected with flare nuts.

#### 3-3. Flaring Procedure with a Flare Tool

- (1) Cut the copper tube to the required length with a tube cutter. It is recommended to cut approx. 12" to 20" (30 to 50 cm) longer than the tubing length you estimate.
- (2) Remove burrs at the end of the copper tube with a tube reamer or file. This process is important and should be done carefully to make a good flare.  
(Fig. 8)

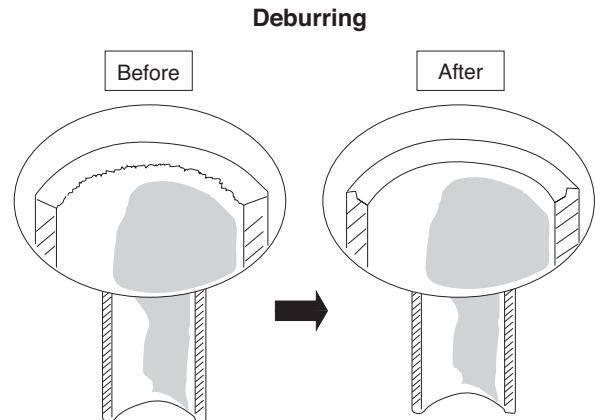


Fig. 8


**NOTE**

When reaming, hold the tube end downward and be sure that no copper scraps fall into the tube. (Fig. 9)

(3) Remove the flare nut from the unit and be sure to mount it on the copper tube.

(4) Make a flare at the end of copper tube with a flare tool.\* (Figs. 10 and 11)

(\*Use "RIDGID" or equivalent.)

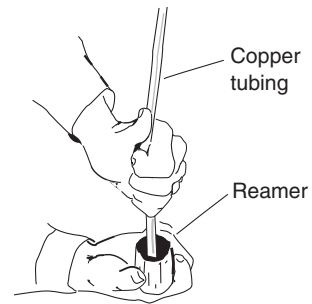


**Fig. 9**

**NOTE**


A good flare should have the following characteristics:

- inside surface is glossy and smooth.
- edge is smooth.
- tapered sides are of uniform length.

If the special R410A flare tool is used:



If the previous flare tool (clutch-type) is used:




Adjust so that the amount of tube protrusion is as shown in the figure.


**Fig. 10**

**3-4. Caution before Connecting Tubes Tightly**

- a) Be sure to apply a sealing cap or water-proof tape to prevent dust or water from getting into the tubes before they are used.
- b) Be sure to apply refrigerant lubricant to the matching surfaces of the flare and union before connecting them together. This is effective for reducing gas leaks. (Fig. 12)
- c) For proper connection, align the union tube and flare tube straight with each other, then screw in the flare nut lightly at first to obtain a smooth match. (Fig. 13)

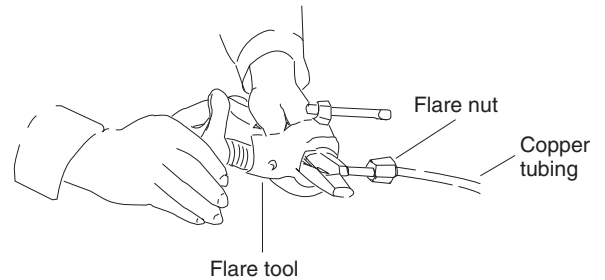

**Fig. 11**

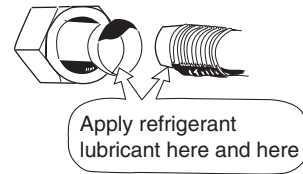


**Fig. 12**

**3-5. Tubing Connections**

- a) Temporary connection:  
Screw in 3 – 5 turns by hand. (Fig. 14)
- b) To fasten the flare nuts, apply specified torque as:

**Table 4**

Tube Dia.	Nut	Tightening Torque
1/4" (6.35 mm)	21/32" (17 mm)	Approx. 120 – 160 lbs·in (140 – 180 kgf·cm)
3/8" (9.52 mm)	7/8" (22 mm)	Approx. 300 – 360 lbs·in (340 – 420 kgf·cm)
1/2" (12.70 mm)	1-1/32" (26 mm)	Approx. 430 – 480 lbs·in (490 – 550 kgf·cm)
5/8" (15.88 mm)	1-5/32" (29 mm)	Approx. 590 – 710 lbs·in (680 – 820 kgf·cm)

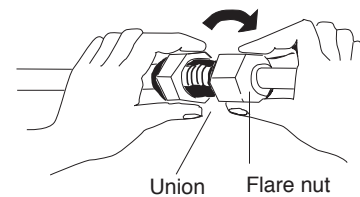


**Fig. 13**



Service valve on narrow tube side

Service valve on wide tube side

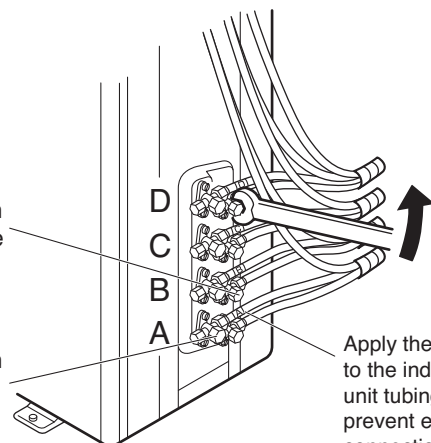


**Fig. 14**



**CAUTION**

Be sure to match refrigerant tubing and electric wiring between indoor and outdoor units.

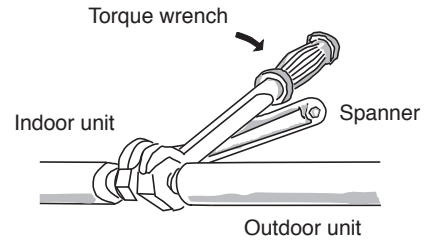


**Fig. 15**

**3-6. Insulation of Refrigerant Tubing**

**IMPORTANT**

To prevent heat loss and wet floors due to dripping of condensation, **both tubes must be well insulated with a proper insulation material.**


The thickness of the insulation should be a minimum 5/16" (8 mm). (Fig. 16)

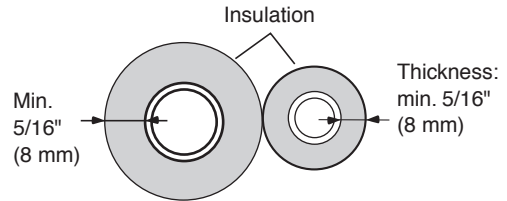

**Fig. 16**

**■ For wall-mounted units**


After connecting the refrigerant tubing to the outdoor unit and performing a leak test on the connecting part, insulate it with the tubing insulation. (Fig 17a)

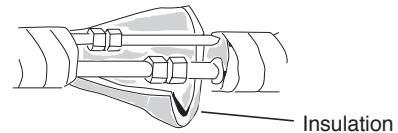

**Fig. 17a**

**■ For ceiling-mounted cassette units**


Wind the insulation tape around the flare nuts at the tube connections. Secondly cover up the tubing connections with the flare insulation (1/8" (T3, supplied)). Then wind the other flare insulation (3/16" (T5, supplied)). Finally, fasten the insulation at both ends with the supplied vinyl ties. (Fig. 17b)

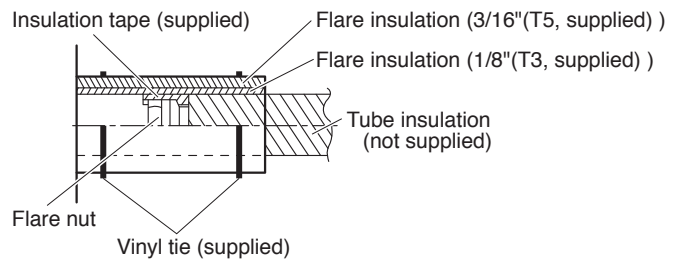

**Fig. 17b**

**Insulation material**

The material used for insulation must have good insulation characteristics, be easy to use, be age resistant, and must not easily absorb moisture.

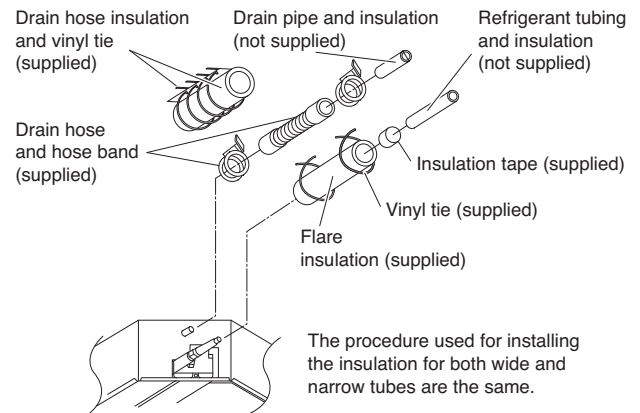

**Fig. 17c**

**Never grasp the drain or refrigerant connecting outlets when moving the unit.**

### 3-7. Taping the Tubes



#### CAUTION

After a tube has been insulated, never try to bend it into a narrow curve, as this may cause the tube to break or crack.

- (1) At this time, the 2 refrigerant tubes (and electrical wire if local codes permit) should be taped together with armoring tape. The drain hose may also be included and taped together as 1 bundle with the tubing.
- (2) Wrap the armoring tape from the bottom of the outdoor unit to the top of the tubing where it enters the wall. As you wrap the tubing, overlap half of each previous tape turn. (Fig. 18)
- (3) Clamp the tubing bundle to wall, using 1 clamp approx. every 47" (120 cm).

#### NOTE

Do not wind the armoring tape too tightly, since this will decrease the heat insulation effect. Also, be sure the condensation drain hose splits away from the bundle and drips clear of the unit and the tubing.

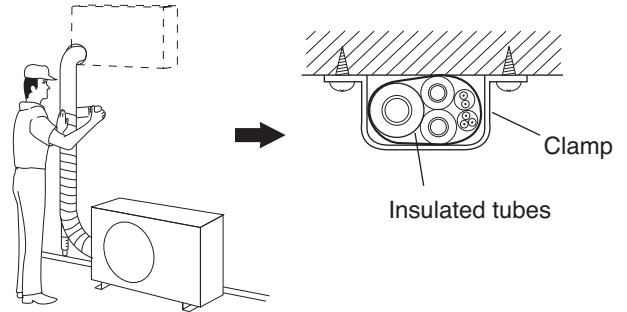


Fig. 18




Fig. 19

### 3-8. Finishing the Installation

After finishing insulating and taping over the tubing, use sealing putty to seal off the hole in the wall to prevent rain and draft from entering. (Fig. 19)

## 4. Air Purging

Air and moisture remaining in the refrigerant system have undesirable effects as indicated below. Therefore, they must be purged completely.

- pressure in the system rises
- operating current rises
- cooling efficiency drops
- moisture in the air may freeze and block capillary tubing
- water may lead to corrosion of parts in the refrigerant system

### ■ Air Purging with a Vacuum Pump (for Test Run)

- In order to protect the earth's environment, be sure to use a vacuum pump to perform the air purge. (Never perform an air purge by using the refrigerant gas cylinder or other external gas, or by using the gas inside the outdoor unit.)

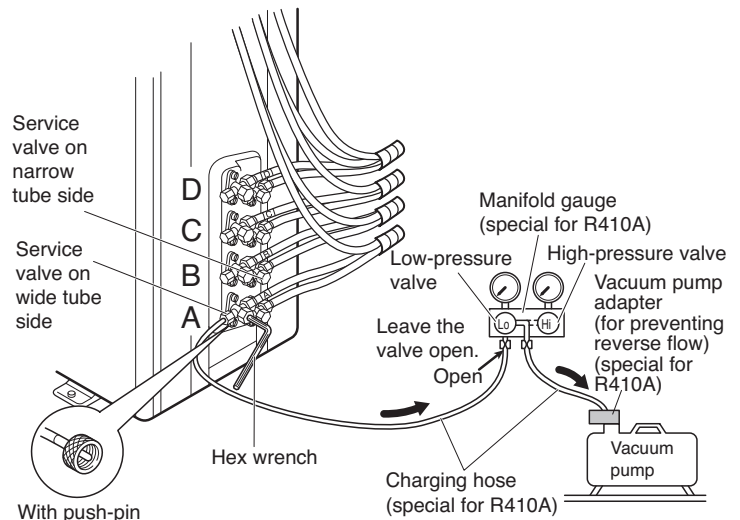


Fig. 20




#### CAUTION

In order to prevent charging errors with the air conditioner that uses R410A, the screw diameter at the service valve charging port has been changed. When recharging or performing other servicing, use the special charging hose and manifold gauge.

Perform the air purge for tubes A, B, C, and D. Use the same procedures for all tubes.

- (1) Check that each tube (both narrow and wide tubes) between the indoor and outdoor units have been properly connected and all wiring for the test run has been completed. Note that both narrow and wide tube service valves on the outdoor unit are kept closed at this stage.
- (2) Using an adjustable wrench or box wrench, remove the valve caps from the service valve on both narrow and wide tubes.
- (3) Connect a vacuum pump and a manifold valve (with pressure gauges) to the service port on the wide tube service valve. (Fig. 20).

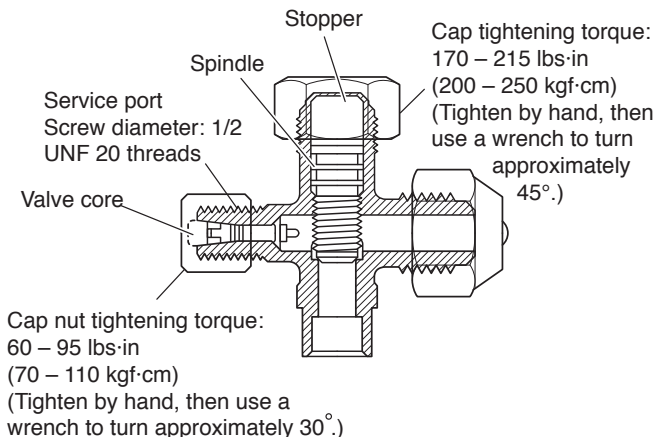

<Structure of service valve on wide tube side>

**NOTE**

External diameter of service port  
R410A: 5/16"

**Fig. 21**



**CAUTION**

Before using the vacuum pump adapter, read the vacuum pump adapter manual, and use the adapter correctly.



**CAUTION**

Be sure to use a manifold valve for air purging. If it is not available, use a stop valve for this purpose. The "Hi" knob of the manifold valve must always be kept closed.

- When using a hex wrench to open the spindle, an extremely small amount of refrigerant may leak. This does not indicate a problem.
- Use a hex wrench of a type to which force can be easily applied.

- (4) With the "Lo" knob of the manifold valve open and high-pressure valve ("Hi") closed completely, run the vacuum pump. Run the pump until the pressure is -101 kPa (-76 cmHg). The operation time for the vacuum pump varies with tubing length and the capacity of the pump. The following table shows the amount of time required for evacuation:

**Table 5**

Required time for evacuation when capacity of 100 liter/h vacuum pump is used
20 min. or more

**NOTE**

The required time in Table 5 is calculated based on the assumption that the ideal (or target) vacuum condition is around 10 mmHg abs.

- (5) With the vacuum pump still running, close the "Lo" knob of the manifold valve. Then stop the vacuum pump. Fully close the low-pressure valve and stop the vacuum pump. (Wait 1 – 2 minutes and check that the manifold gauge pointer does not return. If it does return, find and repair the leak, then apply the vacuum again.)
- (6) With a hex wrench, turn the valve stem on the narrow tube service valve counter-clockwise by 90 degrees (1/4 turn) for 10 seconds, and then turn the stem clockwise to close it again.



**CAUTION**

Be sure to completely insert the hex wrench before attempting to turn the valve.

- (7) With a standard screwdriver, turn the wide tube service valve stem counterclockwise to fully open the valve.
- (8) Turn the narrow tube service valve stem counter-clockwise to fully open the valve.
- (9) Loosen the vacuum hose connected to the wide tube service port slightly to release the pressure. Then, remove the hose.
- (10) Leak test all joints at the tubing (both indoor and outdoors) with liquid soap. Bubbles indicate a leak. Be sure to wipe off the soap with a clean cloth.



**CAUTION**

If a CFC gas detector is used, use a special detector for HFC refrigerant (such as R410A and R134a).

- (11) Replace the flare nut on the wide tube service port and fasten the flare nut securely with an adjustable wrench or box wrench. Next, mount the valve cap and tighten it with a torque wrench (the cap needs to be tightened with the torque of 180 lbs-in (200 kgf-cm)). This process is very important to prevent gas from leaking from the system.
- (12) Test run the air conditioner. (See page 26.)
- (13) While the air conditioner is running, apply liquid soap to check for any gas leaks around the service valves or caps.
- (14) If there is no leakage, stop the air conditioner.
- (15) Wipe off the soap on the tubing.

This completes air purging with a vacuum pump and the air conditioner is ready for actual operation.


## ■ Pump Down

**In order to protect the earth's environment, be sure to perform pump-down to recover refrigerant gas without releasing it into the atmosphere.**

- When relocating or disposing of the air conditioner, request this service from the dealer where the unit was purchased, or from an appropriate agent. Perform pump-down as described below.

### What is pump-down?


- Pump-down refers to recovering the refrigerant gas from the refrigerant cycle at the outdoor unit. This work must be performed during cooling operation. The refrigerant gas cannot be recovered during heating operation.
- During winter, or if the temperature sensor prevents cooling operation, perform "forced cooling operation."

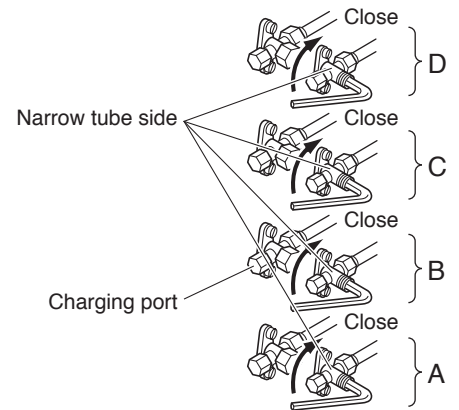


**Fig. 22**

### Pump-down procedure

- (1) Fully close the spindles at the valves on the narrow tube side of tubes A, B, C and D. (Refer to Fig. 22.)
- (2) Connect the manifold gauge to the charging port at the valve on the wide tube side of tube D. Purge the air from the charging hose. (Refer to Fig. 23.)
- (3) Perform cooling operation or forced cooling operation. When the pressure at the low-pressure side is 0.05 – 0.1 MPaG (0.5 – 1 kg/cm<sup>2</sup>G), fully close the spindles at the valves on the wide tube side of tubes A, B, C, and D, and immediately stop operation. (Refer to Fig. 23.)  
In the winter, the outdoor unit may stop after 5 - 10 minutes of operation. This is in order to protect the indoor unit heat exchanger from freezing and does not indicate a problem.
- (4) Disconnect the manifold gauge and the inter-unit tubes, and attach the caps and flare nuts. At this point, pump-down is completed. (If the caps and flare nuts are not reattached, there is the danger of gas leakage.) (Refer to Fig. 24.)

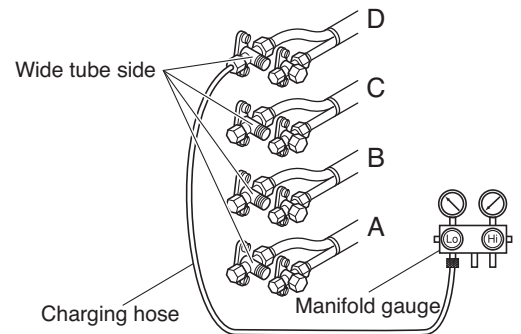

**Fig. 23**

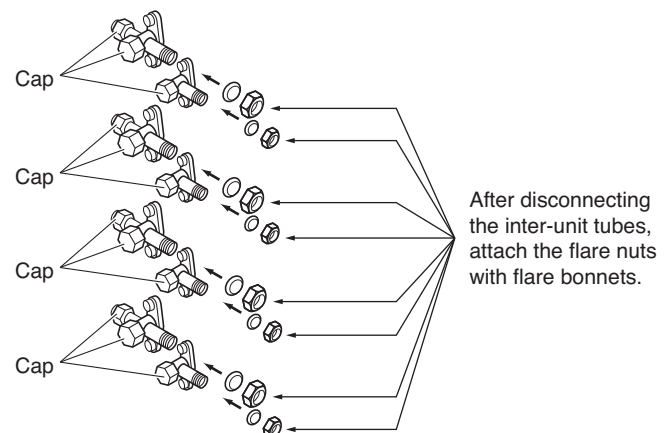

**Fig. 24**

### If pump-down is not possible

If the air conditioner cannot be operated because of a malfunction or other cause, use a refrigerant recovery device to recover the refrigerant.

## 5. Wiring Instructions

### 5-1. General Precautions on Wiring

- (1) Before wiring, confirm the rated voltage of the unit as shown on its nameplate, then carry out the wiring closely following the wiring diagram.
- (2) Provide a power outlet to be used exclusively for each unit, with a power supply disconnect and circuit breaker for overcurrent protection provided in the exclusive line.
- (3) To prevent possible hazard due to insulation failure, the unit must be grounded.
- (4) Each wiring connection must be done tightly and in accordance with the wiring system diagram. Wrong wiring may cause the unit to misoperate or become damaged.
- (5) Do not allow wiring to touch the refrigerant tubing, compressor, or any moving parts of the fan.
- (6) Unauthorized changes in the internal wiring can be very dangerous. The manufacturer will accept no responsibility for any damage or misoperation that occurs as a result of such unauthorized changes.

### 5-2. Recommended Wire Length and Diameter

Regulations on wiring diameter differ from locality to locality. For field wiring requirements, please refer to your local electrical codes. Carefully observe these regulations when carrying out the installation.

Table 6 shows maximum wire lengths for control line and power line and fuse or circuit capacity.

#### NOTE

Refer to the wiring system diagram (Fig. 25a or 25b) for the meaning of (A), (B), and (C) in Table 6.

Refer to your local codes or in the absence of local codes see the National Electric Code: ANSI/NFPA70.

**Table 6**

Model	AWG	Max. Power Line Length (ft.) (A)	Max. Control Line Length (ft.) (B) (C)	Fuse or Circuit Capacity
		(#12)	(#14)	
CU-3KE19NBU		85 (Max.)	82 (Max.)	15 A
CU-4KE24NBU		85 (Max.)	82 (Max.)	20 A
CU-4KE31NBU		85 (Max.)	100 (Max.)	20 A

# ... AWG (American Wire Gauge)



**WARNING**

- Be sure to comply with local codes on running the wire from the indoor unit to the outdoor unit (size of wire and wiring method, etc.).
- Each wire must be firmly connected.
- No wire should be allowed to touch refrigerant tubing, the compressor, or any moving part.
- Be sure to connect power wires correctly matching up numbers on terminals of the outdoor unit and respective indoor units A – D.



**CAUTION**

- Be sure to connect the power supply line to the outdoor unit as shown in the wiring diagram. The indoor unit draws its power from the outdoor unit.
- Do not run wiring for antenna, signal, or power lines of television, radio, stereo, telephone, security system, or intercom any closer than 3'4" (1 m) from the power cable and wires between the indoor and outdoor units. Electrical noise may affect the operation.



**WARNING**

- To avoid the risk of electric shock, each air conditioner unit must be grounded.
- For the installation of a grounding device, please observe local electrical codes.
- Grounding is necessary, especially for units using inverter circuits, in order to release charged electricity and electrical noise caused by high tension. Otherwise, electrical shock may occur.
- Place a dedicated ground more than 7' (2 m) away from other grounds and do not have it shared with other electric appliances.

**\* NOTE**

Disconnect switch may be required by national or local codes.




**CAUTION**

Always comply with national and local code requirements.


**5-3. Wiring System Diagram**

**3 indoor units with CU-3KE19NBU**

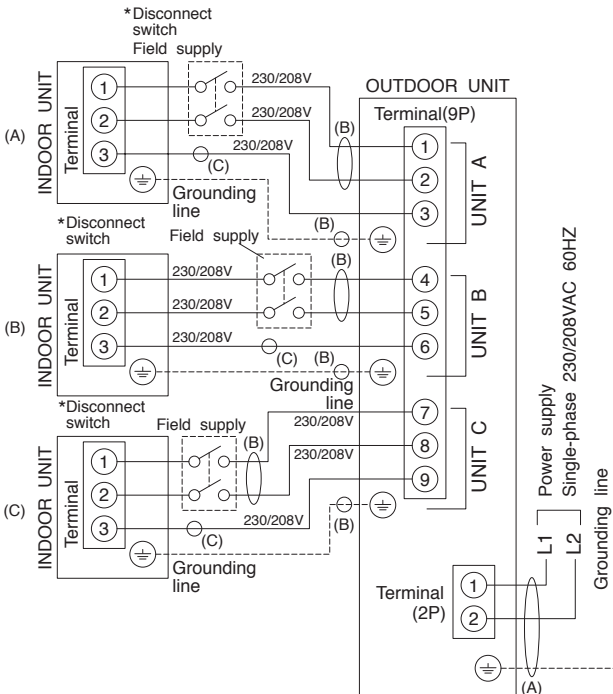

**Fig. 25a**

**4 indoor units with CU-4KE24NBU, CU-4KE31NBU**

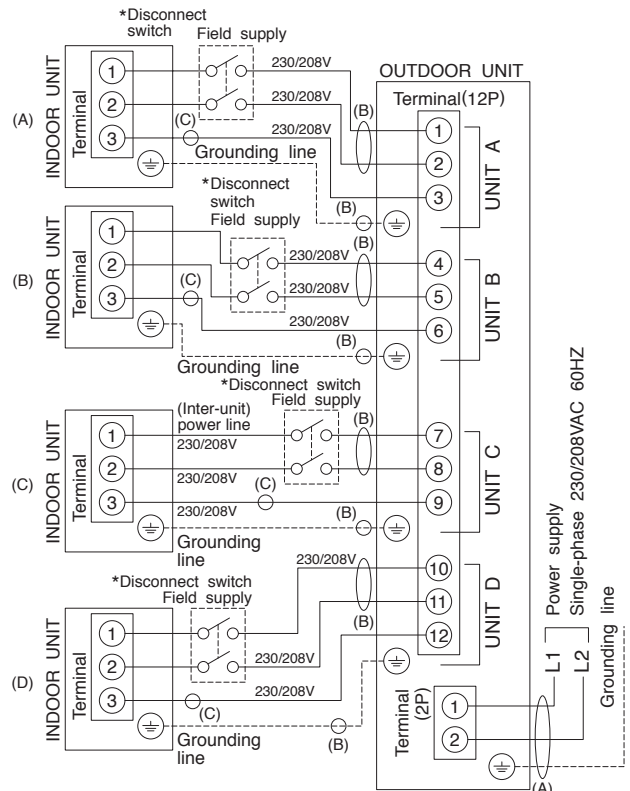

**Fig. 25b**

## 5-4. How to Connect Wiring to the Terminal



### WARNING

Loose wiring may cause the terminal to overheat or result in unit malfunction. A fire hazard may also exist. Therefore, be sure all wiring is tightly connected.

When connecting each power wire to the corresponding terminal, follow the instructions “How to connect wiring to the terminal” and fasten the wire securely tight with the fixing screw of the terminal plate.

### How to connect wiring to the terminal

#### a) For Indoor Unit

- (1) Cut the wire end with a cutting pliers, then strip the insulation to expose the wire about  $9/32$ " (7 mm). See the label (Fig. 26) near the terminal plate.
- (2) Using a screwdriver, loosen the terminal screw on the terminal plate.
- (3) Insert the wire and tighten the terminal screw completely using a screwdriver.

#### b) For Outdoor Unit

##### ■ For solid core wiring (or F-cable)

- (1) Cut the wire end with a cutting pliers, then strip the insulation to expose the solid wire about  $15/16$ " (25 mm). (Fig. 27)
- (2) Using a screwdriver, remove the terminal screw(s) on the terminal plate.
- (3) Using the pliers, bend the solid wire to form a loop suitable for the terminal screw.
- (4) Shape the loop wire properly, place it on the terminal plate and fix it securely with the removed terminal screw using a screwdriver.

##### ■ For stranded wiring

- (1) Cut the wire end with a cutting pliers, then strip the insulation to expose the stranded wiring about  $3/8$ " (10 mm) and tightly twist the wire ends. (Figs. 28 and 29)
- (2) Using a screwdriver, remove the terminal screw(s) on the terminal plate.
- (3) Using a ring connector fastener or pliers, securely clamp each stripped wire end with a ring connector. (Fig. 28)
- (4) Place the ring connector wire, and replace and tighten the removed terminal screw using a screwdriver. (Fig. 30)

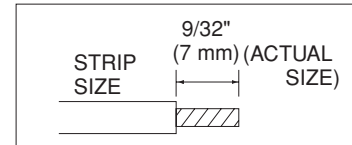


Fig. 26

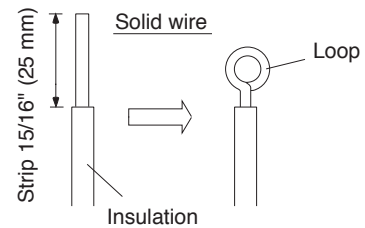


Fig. 27

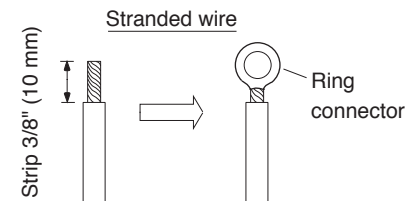


Fig. 28

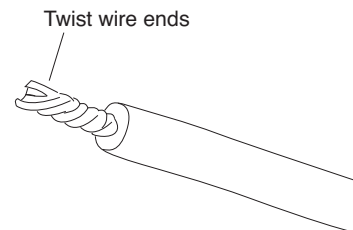


Fig. 29

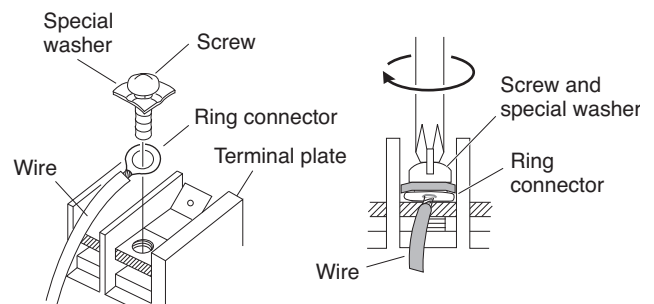


Fig. 30

## 5-5. Wiring Instructions for the Outdoor Unit



### CAUTION

- Be sure to correctly align inter-unit cables A, B, C and D.

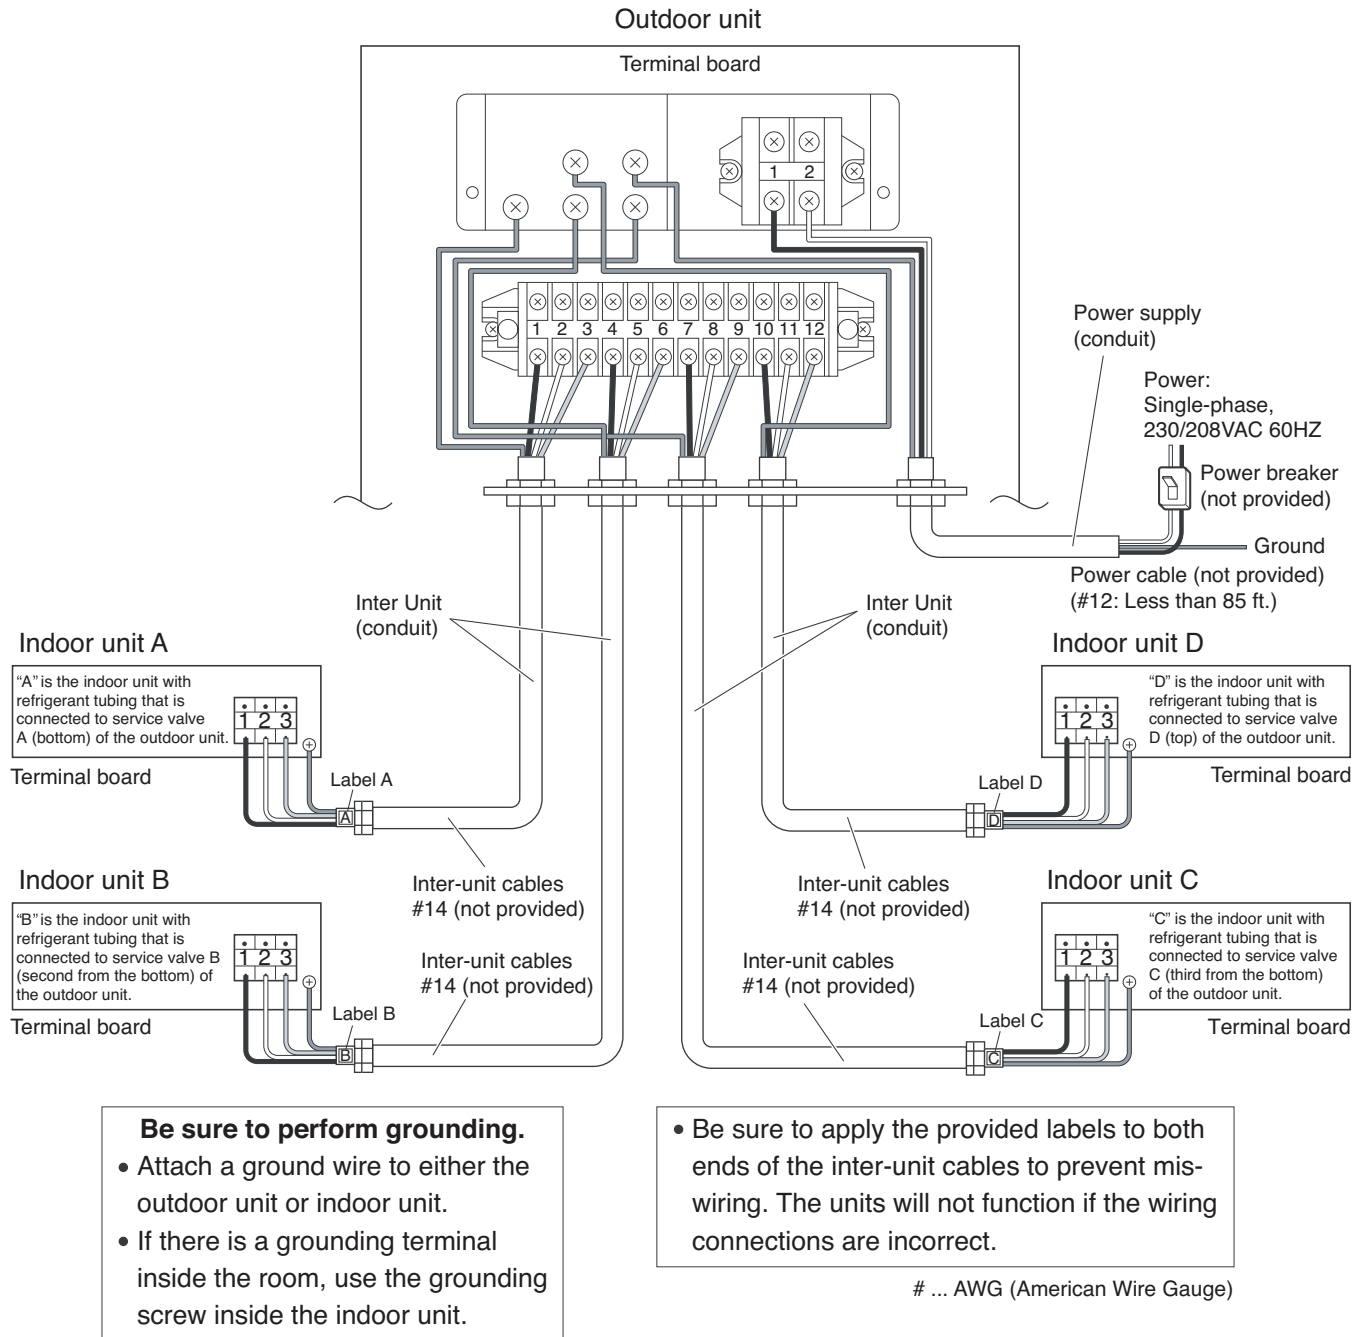


Fig. 31

- Use a dedicated air conditioner circuit for power.
- To make connections to the outdoor unit, remove the inspection panel and tubing panel.
- Do not bring the inter-unit cables or power cable into contact with tubing or service valves.
- Use outdoor unit cable fasteners and fasten the inter-unit cables at the location where the cables are double-sheathed.
- Arrange the wiring so that the inter-unit cables are contained in the inspection panel and tubing panel, as shown in Fig. 31.

Regulations on wire size differ from locality to locality. For field wiring requirements, please refer to your local electrical codes. Make sure that the installation fully complies with all local and national regulations.

- (1) Remove access panel "C". (Fig. 32)
- (2) Connect the inter-unit and power supply line according to the drawing on the panel side.
- (3) Be sure to size each wire allowing approx. 4" (10 cm) longer than the required length for wiring. Store excess wiring inside the cabinet.
- (4) When connections are completed, check that all connections are correct as shown in the wiring system diagram on panel side.
- (5) Be sure to ground the unit according to your local codes.

## 6. Test Run

### Performing a test run

- Refer to the test run procedures in the indoor unit installation manual.
- Perform the test run separately for each connected indoor unit. If 2 units are operated simultaneously, it is not possible to correctly check for errors in tubing and wiring.
- If the room temperature is 59°F (15°C) or below, it may not be possible to check for tubing errors with cooling operation. If this occurs, perform heating operation for each unit individually, and check that warm air is discharged from each unit. If there is cold air mixed in with the warm air, check the tubing connections again.

### Checking tubing and wiring

Perform the test run and check that operation is normal. If there is an error in tubing or wiring, the refrigerant may flow to indoor unit B when indoor unit A is operated (for example).



- Stop operation immediately if there is an error in tubing or wiring. Turn the power (breaker) to OFF, and check whether the inter-unit cables are connected incorrectly, or whether the narrow tubes A and B are connected in reverse. Correct the connections.
- If there is an error in tubing, pump-down must be performed. Be sure to perform pump-down. After making corrections, again purge the air from the tubes.

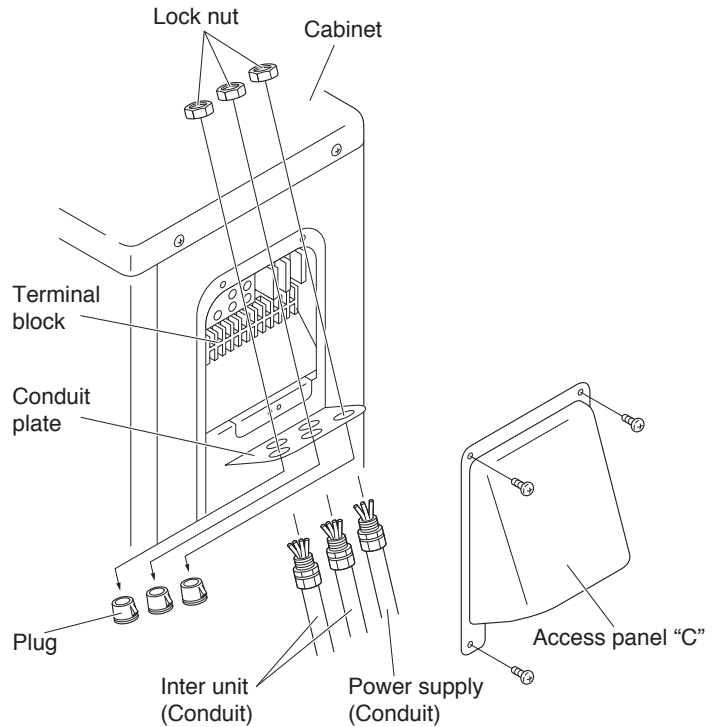


Fig. 32

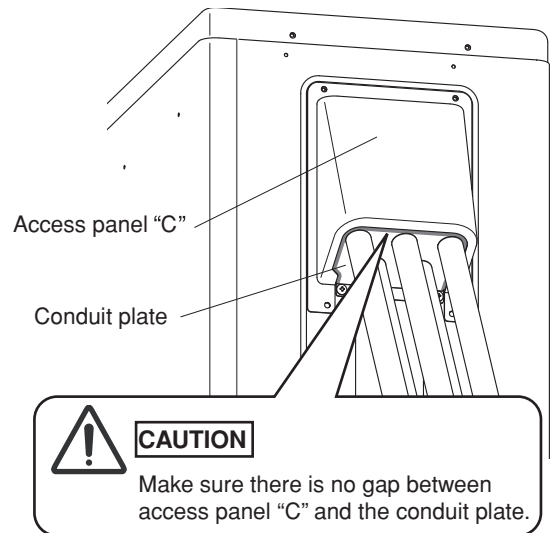


Fig. 33

## 7. Connecting a Home Automation Device

The HA (white) 4P terminal is located on the indoor unit PCB. If a HA device will be used, connect it to this terminal.

## 8. Installation Check Sheet

- The strength of the installation location is sufficient to support the air conditioner weight.
- The indoor and outdoor units are installed level and vertically.
- The power and voltage are as specified.
- Inter-unit cables are securely fastened to the terminal board.
- Inter-unit cables are securely fixed.
- The power cable and inter-unit cables are not connected anywhere along their paths.
- The ground wire is securely connected.
- An air purge of the refrigerant circuit has been conducted.
- A leak test of the tubing connections has been performed.
- Thermal insulation has been applied to the tubing connections.
- Drain connections are secure and water drains properly.
- Putty has been used to close the hole in the wall.
- All service valves are fully open.
- Remote controller signals are being positively received.

